


LOCATION SKETCH

DEPARTMENT OF TRANSPORTATION CITY OF ROSWELL

PLAN AND PROFILE OF PROPOSED

OXBO DRIVE ONE-WAY PAIR @ SR 9/SR 120/ATLANTA STREET

LOCAL LET PROJECT

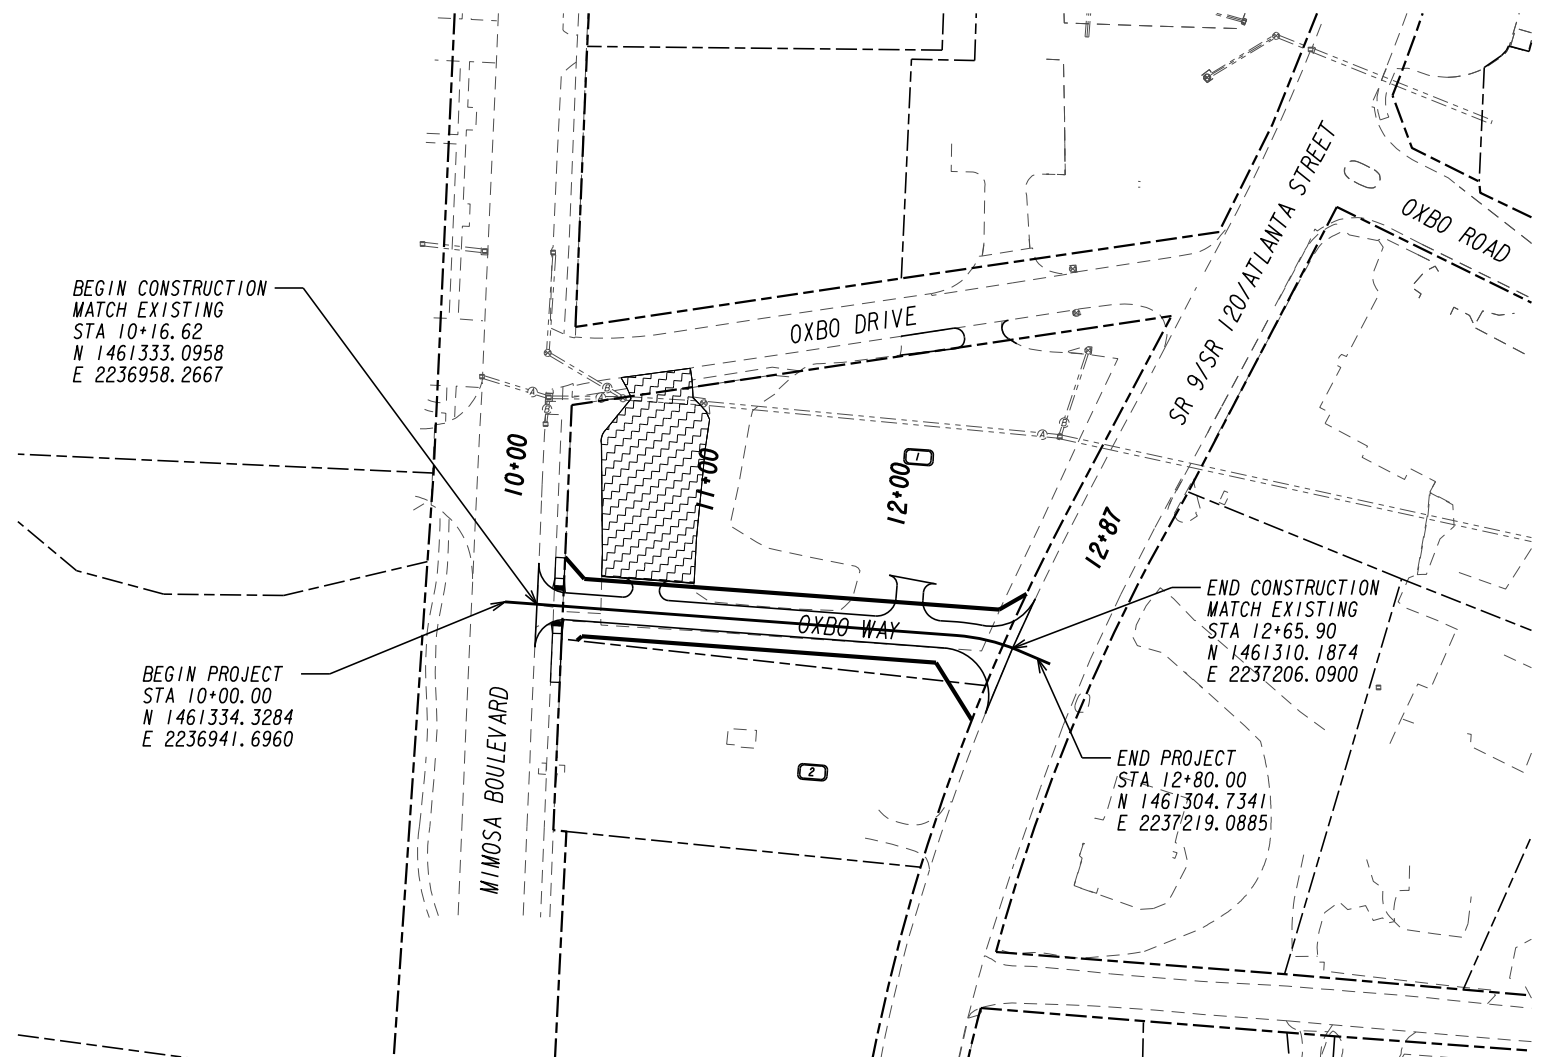

BEGIN CONSTRUCTION
MATCH EXISTING
STA 10+16.62
N 1461333.0958
E 2236958.2667

BEGIN PROJECT
STA 10+00.00
N 1461334.3284
E 2236941.6960

END CONSTRUCTION
MATCH EXISTING
STA 12+65.90
N 1461310.1874
E 2237206.0900

END PROJECT
STA 12+80.00
N 1461304.7341
E 2237219.0885

THE TOTAL AREA FOR THIS PROJECT IS 0.24 ACRES. THE TOTAL DISTURBED AREA FOR THIS PROJECT IS 0.19 ACRES. A NOTICE OF INTENT (NOI) IS NOT REQUIRED.

THIS PROJECT HAS BEEN PREPARED USING THE HORIZONTAL GEORGIA COORDINATE SYSTEM OF 1984 (NAD 1983/94 WEST ZONE, AND THE NORTH AMERICAN VERTICAL DATUM (NAVD) OF 1988.

THE DATA, TOGETHER WITH ALL OTHER INFORMATION SHOWN ON THESE PLANS OR IN ANYWAY INDICATED THEREBY, WHETHER BY DRAWINGS OR NOTES, OR IN ANY OTHER MANNER, ARE BASED UPON FIELD INVESTIGATIONS AND ARE BELIEVED TO BE INDICATIVE OF ACTUAL CONDITIONS. HOWEVER, THE SAME ARE SHOWN AS INFORMATION ONLY, ARE NOT GUARANTEED, AND DO NOT BIND THE DEPARTMENT OF TRANSPORTATION IN ANY WAY. THE ATTENTION OF BIDDER IS SPECIFICALLY DIRECTED TO SUBSECTIONS 102.04, 102.05, AND 104.03 OF THE SPECIFICATIONS.





CITY OF ROSWELL
DEPARTMENT OF TRANSPORTATION
38 HILL STREET, SUITE 235
ROSWELL, GA 30075
770-594-6420



DATE	GREGORY NICOLAS, P.E., 770-641-3704
PLANS COMPLETED	2-5-2016
REVISIONS	

LENGTH OF PROJECT	COUNTY No.
	Project No.
MILES	
NET LENGTH OF ROADWAY	0.05
NET LENGTH OF BRIDGES	0.00
NET LENGTH OF PROJECT	0.05
NET LENGTH OF EXCEPTIONS	0.00
GROSS LENGTH OF PROJECT	0.05



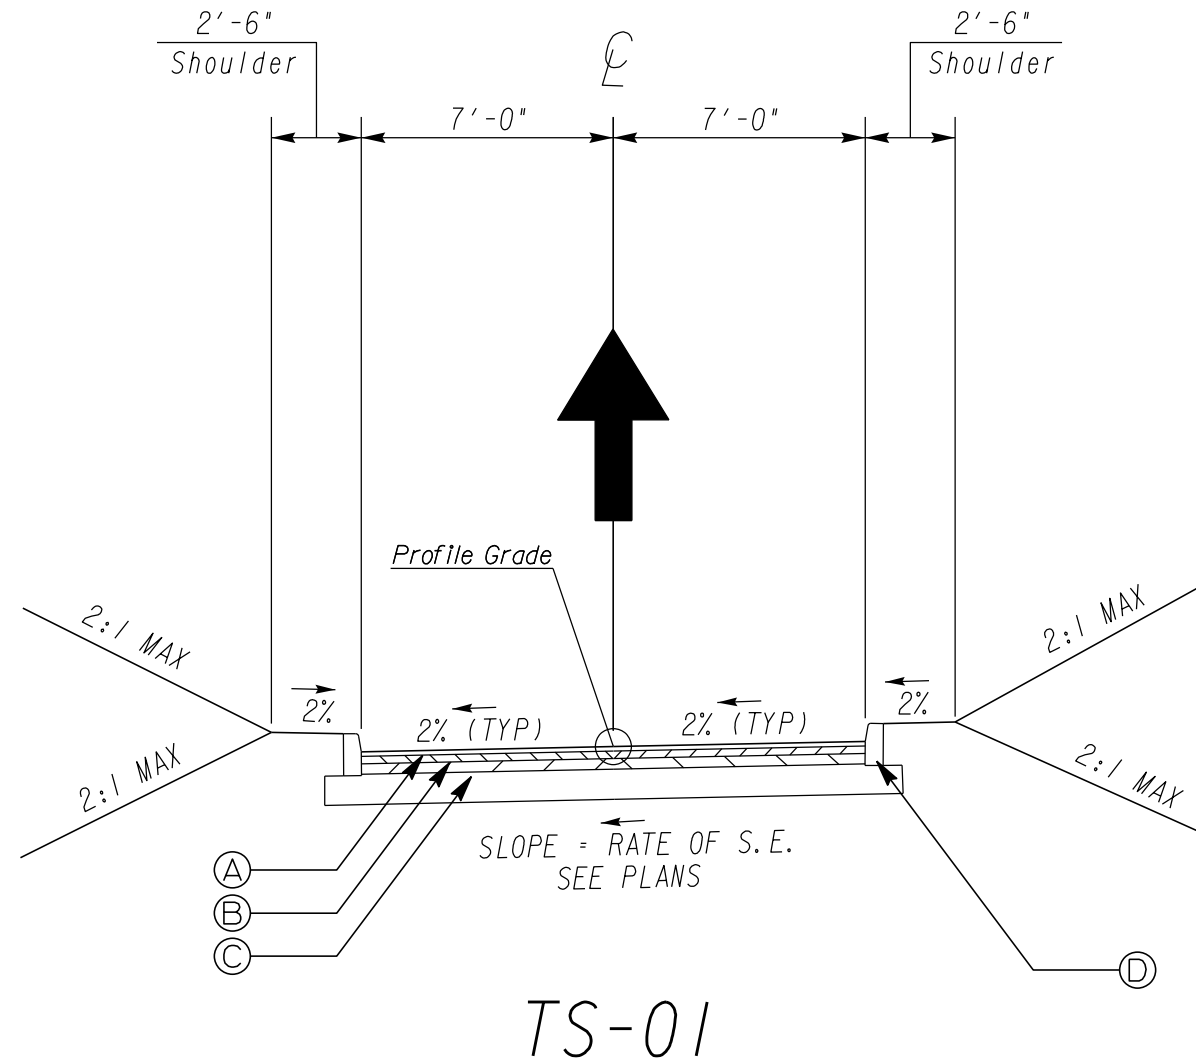

REQUIRED PAVEMENT SECTION	
A	1 1/2" RECYCLED ASPH. CONC. 9.5mm SUPERPAVE, TYPE II, GP 2 ONLY, INCL BITUM MATL & H LIME (165 LB/SQ YD)
B	2" RECYCLED ASPH. CONC. 19mm SUPERPAVE, GP 1 OR 2, INCL BITUM MATL & H LIME (220 LB/SQ YD)
C	8" GRADED AGGREGATE BASE
D	6" CONCRETE HEADER CURB, GA. STD. 9032B, TYPE 2



NOT TO SCALE

REVISION DATES

NO.	DATE	DESCRIPTION

TYPICAL SECTIONS

CHECKED:	DATE:	DRAWING No.
BACKCHECKED:	DATE:	
CORRECTED:	DATE:	
VERIFIED:	DATE:	

05-001

SUMMARY OF QUANTITIES

GRADING COMPLETE

LUMP SUM

INCLUDES CLEARING AND GRUBBING (0.19 AC. EST.)
SEE SECTION 210 - GA. STD. SPECIFICATIONS
ESTIMATED EARTHWORK: 95 CU. YDS.
UNCL. EXCAVATION AND 85 CU. YDS. OF
BORROW. A 15% SHRINKAGE FACTOR HAS
BEEN APPLIED TO CUT & BORROW EXCAVATION.

TRAFFIC CONTROL

LUMP SUM

CONCRETE SIDEWALK, 4 IN

TOTAL 35 SY

CONCRETE HEADER CURB 6 IN, TP 2 - GA STD 9032B

TOTAL 750 LF

SAWED JOINTS IN EXIST PAVEMENT (ASPHALT)

TOTAL 350 LF

SURFACING QUANTITIES

ITEMS	UNIT	ROADWAY	TOTALS
GRADED AGGREGATE BASE COURSE	TON	260	260
RECYCLED ASPH CONC. 19 MM SUPERPAVE, GP 1 OR 2, INCL BITUM MATL & H LIME	TON	55	55
RECYCLED ASPH CONC. 9.5 MM SUPERPAVE, TYPE 11, GP 2 ONLY, INCL BITUM MATL & H LIME	TON	45	45
BITUMINOUS TACK COAT	GAL	35	35
HA-5 MINERAL BOND SURFACE TREATMENT	SY	600	600

EROSION CONTROL QUANTITIES

DESCRIPTION	UNIT	QUANTITY
MULCH	TN	35
SOD	SY	450
EROSION CONTROL MATS, SLOPES	SY	300
AGRICULTURAL LIME	TN	1
FERTILIZER MIXED GRADE	TN	1
FERTILIZER NITROGEN CONTENT	LB	10
TEMPORARY SILT FENCE, TYPE C	LF	425
MAINTENANCE OF SILT FENCE, TYPE C	LF	212.5

SUMMARY OF QUANTITIES - STANDARD SIGNS

INSTL NO.	STATION	SIDE	CODE	SIGNS (TYPE III REFLECTIVE SHEETING)				SIGNS (TYPE IX REFLECTIVE SHEETING)				SQUARE TUBE POST								
				TYPE 1 (0.08)		TYPE 2 (0.10)		TYPE 1 (0.08)		TYPE 2 (0.10)		TYPE 7		TYPE 8		TYPE 9				
				SIZE	QTY	SQ. FEET	SIZE	QTY	SQ. FEET	SIZE	QTY	SQ. FEET	SIZE	QTY	LENGTH (FEET)	QTY	TOTAL LENGTH	LENGTH (FEET)	QTY	TOTAL LENGTH
OXBO DRIVE																				
	10+93	LT	R3-1	24x24	1	4				30x30	6.25				13	1	13			
	12+52	LT	R3-1	24x24	1	4									12	1	12			
Oxbo Way																				
	9+75	LT	M4-5	24x12		2									15	1	15			
			M1-5 (9)	24x24		4														
			M5-1L	21x15		2.2														
	10+21	LT	R6-2L	24x30		5									13	1	13			
			R6-2R	24x30		5														
			D3-1 (Oxbo Way)	24x12																
			D3-1 (Mimosa Blvd)	24x12																
	10+22	RT	M4-5	24x12		2									15	1	15			
			M1-5 (9)	24x24		4														
			M5-1R	21x15		2.2														
	11+00	RT	W3-1							30x30	6.25				14	1	14			
	12+52	RT	R1-1							30x30	6.25				13	1	13			
	12+57	RT	R6-1L							36x12	3				14	1	14			
			R5-1							30x30	6.25									
	12+60	LT	R6-1R							36x12	3				14	1	14			
			R5-1							30x30	6.25									
TOTAL						34.4					37.25					123				

THERMOPLASTIC TRAFFIC STRIPE

DESCRIPTION	UNIT	QUANTITY
5" SOLID WHITE	LF	475
TRAFFIC STRIPE WHITE	SY	56
24" SOLID WHITE	LF	37
8" SOLID WHITE	LF	75
HANDICAP SYMBOL MARKING	EA	3
TYPE 1 ARROW PAVEMENT MARKING	EA	3
REMOVE EXISTING STRIPE	LF	400

ADD ALTERNATE #1


DESCRIPTION	UNIT	QUANTITY
GRADING COMPLETE	LS	1
GRADED AGGREGATE BASE	TN	66
9.5 MM SUPERPAVE, TYPE 11	TN	15
CONCRETE HEADER CURB, 6 IN, TP 2	LF	120

ADD ALTERNATE #2


DESCRIPTION	UNIT	QUANTITY
GRADING COMPLETE	LF	1
AGGREGATE SURFACE CRS-*89 STONE	TN	50

REVISION DATES		SUMMARY QUANTITIES	
CHECKED:	DATE:	CHECKED:	DATE:
BACKCHECKED:	DATE:	CORRECTED:	DATE:
CORRECTED:	DATE:	VERIFIED:	DATE:
		DRAWING No. 06-001	




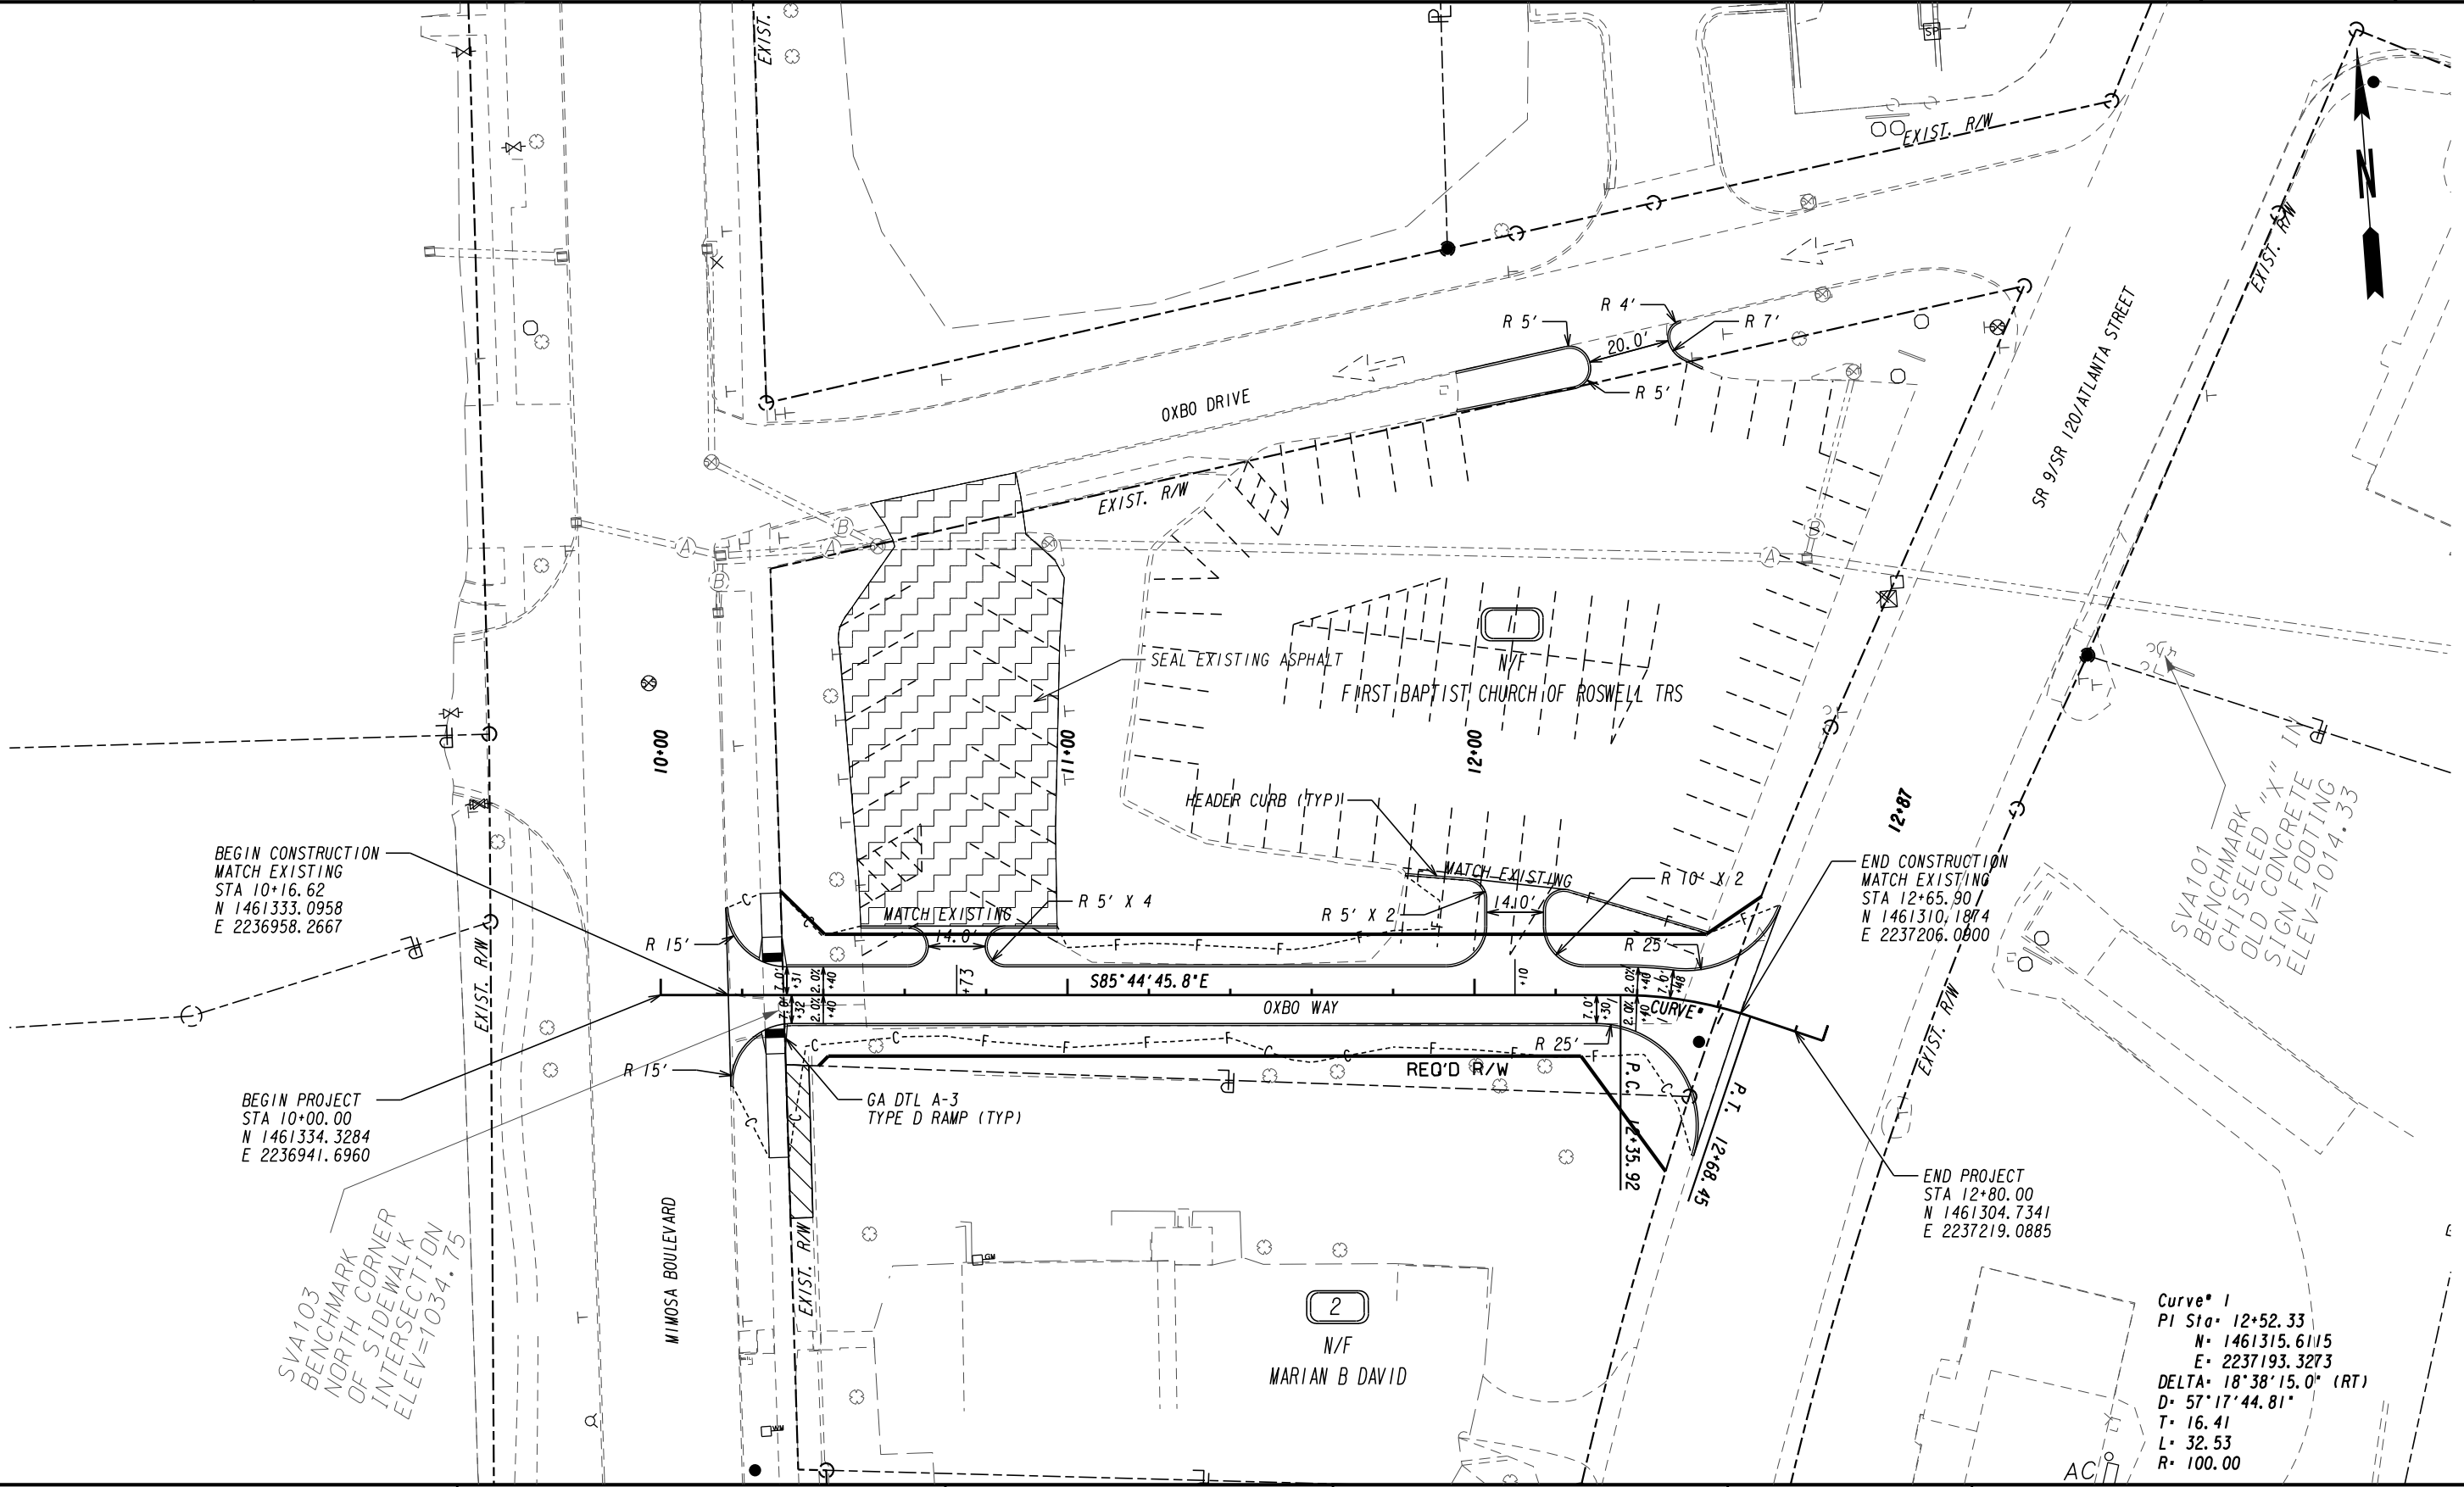


PROPERTY AND EXISTING R/W LINE	
REQUIRED R/W LINE	
CONSTRUCTION LIMITS	
EASEMENT FOR CONSTR & MAINTENANCE OF SLOPES	
EASEMENT FOR CONSTR OF SLOPES	
EASEMENT FOR CONSTR OF DRIVES	




REVISION DATES	

MAINLINE PLAN		
CHECKED:	DATE:	DRAWING No.
BACKCHECKED:	DATE:	13-001
CORRECTED:	DATE:	
VERIFIED:	DATE:	

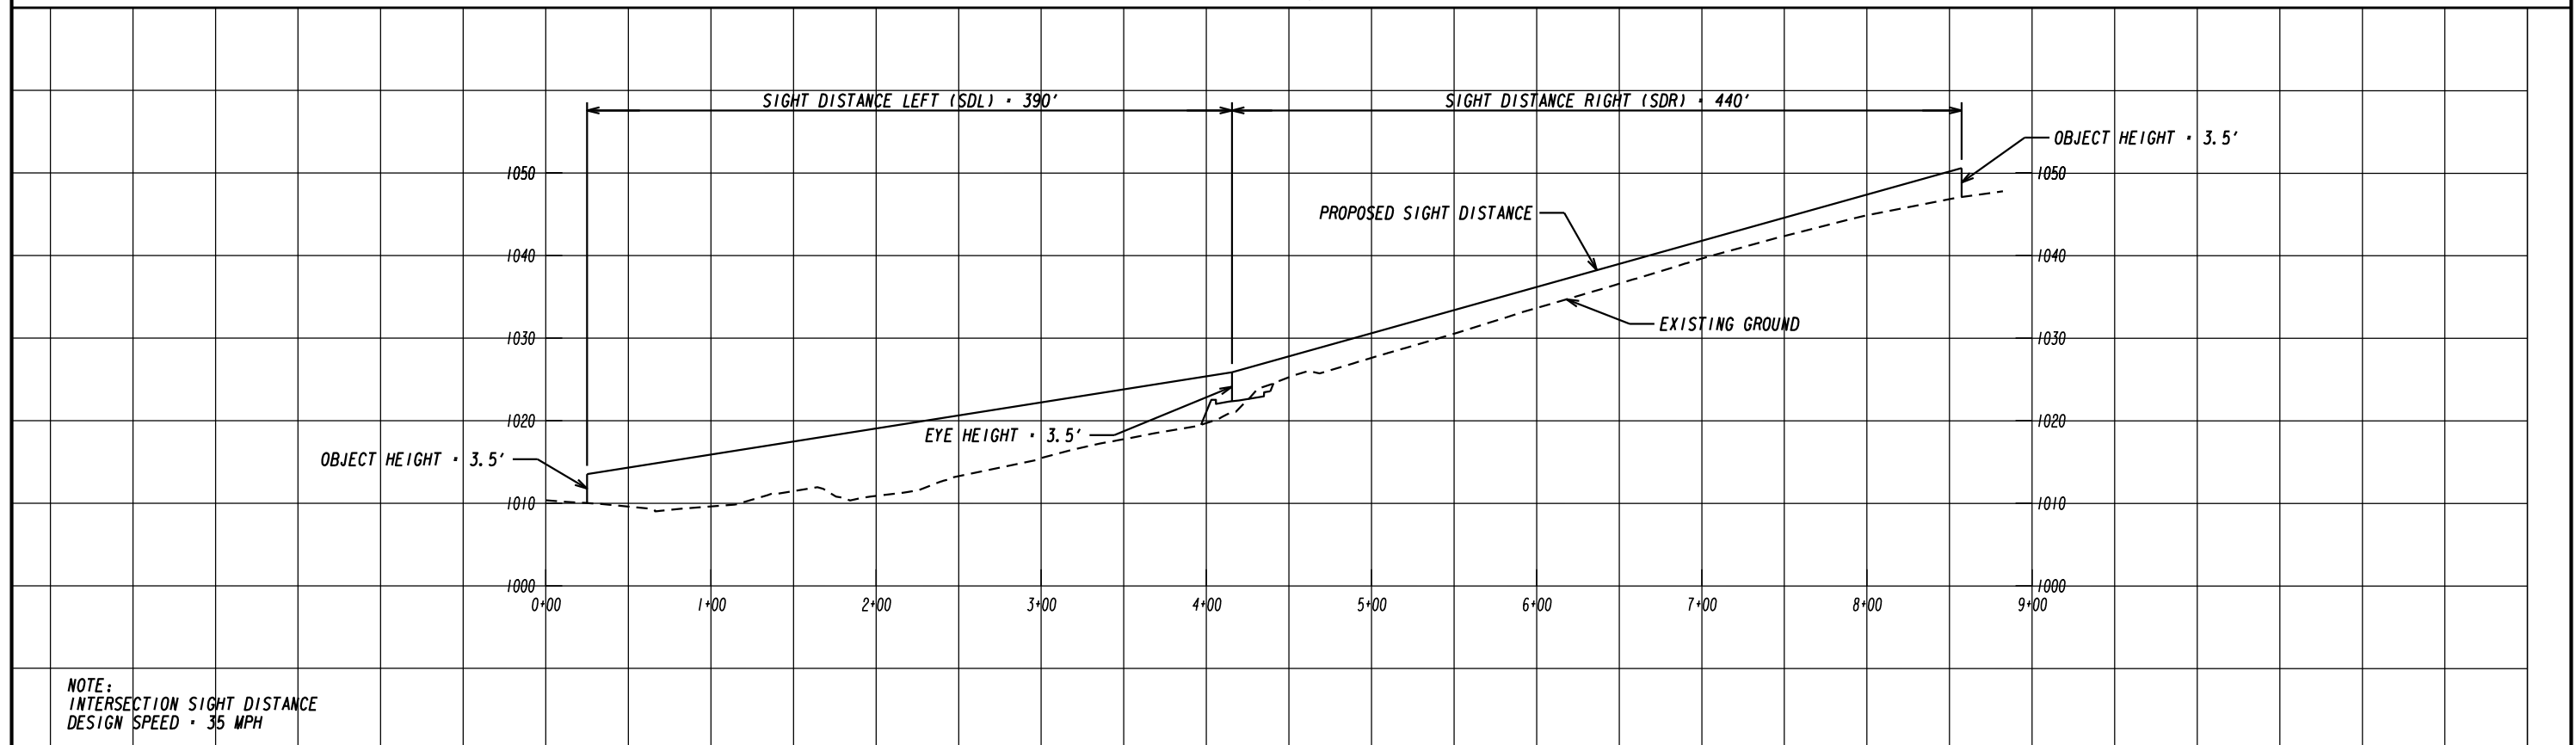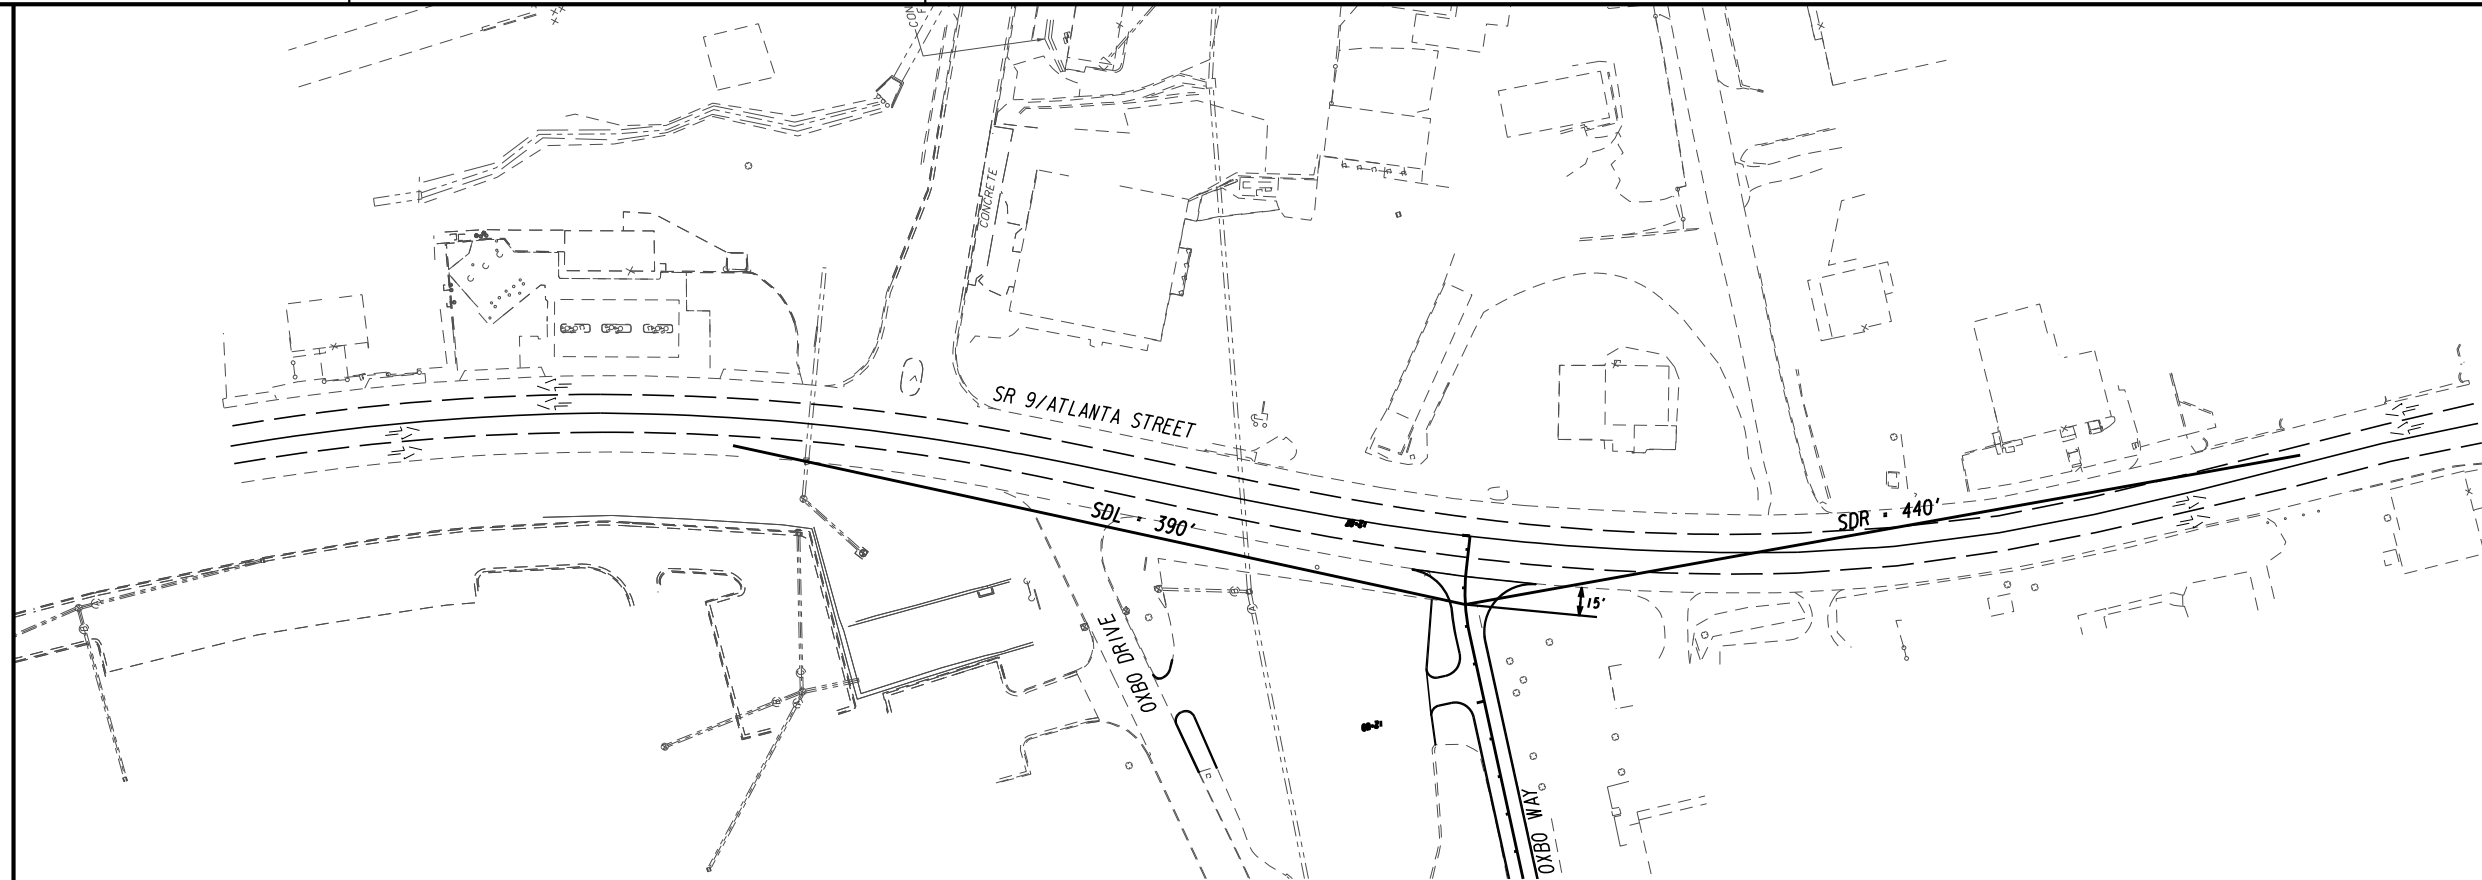

NOTE:
INTERSECTION SIGHT DISTANCE
DESIGN SPEED = 35 MPH




REVISION DATES

MAINLINE PLAN

CHECKED:	DATE:	DRAWING No.
BACKCHECKED:	DATE:	13-002
CORRECTED:	DATE:	
VERIFIED:	DATE:	




PROPERTY AND EXISTING R/W LINE	---
REQUIRED R/W LINE	---
CONSTRUCTION LIMITS	---
EASEMENT FOR CONSTR & MAINTENANCE OF SLOPES	▨
EASEMENT FOR CONSTR OF SLOPES	▩
EASEMENT FOR CONSTR OF DRIVES	▧



REVISION DATES	

MAINLINE PLAN ADD ALTERNATE # 1		
CHECKED:	DATE:	DRAWING No.
BACKCHECKED:	DATE:	13-003
CORRECTED:	DATE:	
VERIFIED:	DATE:	

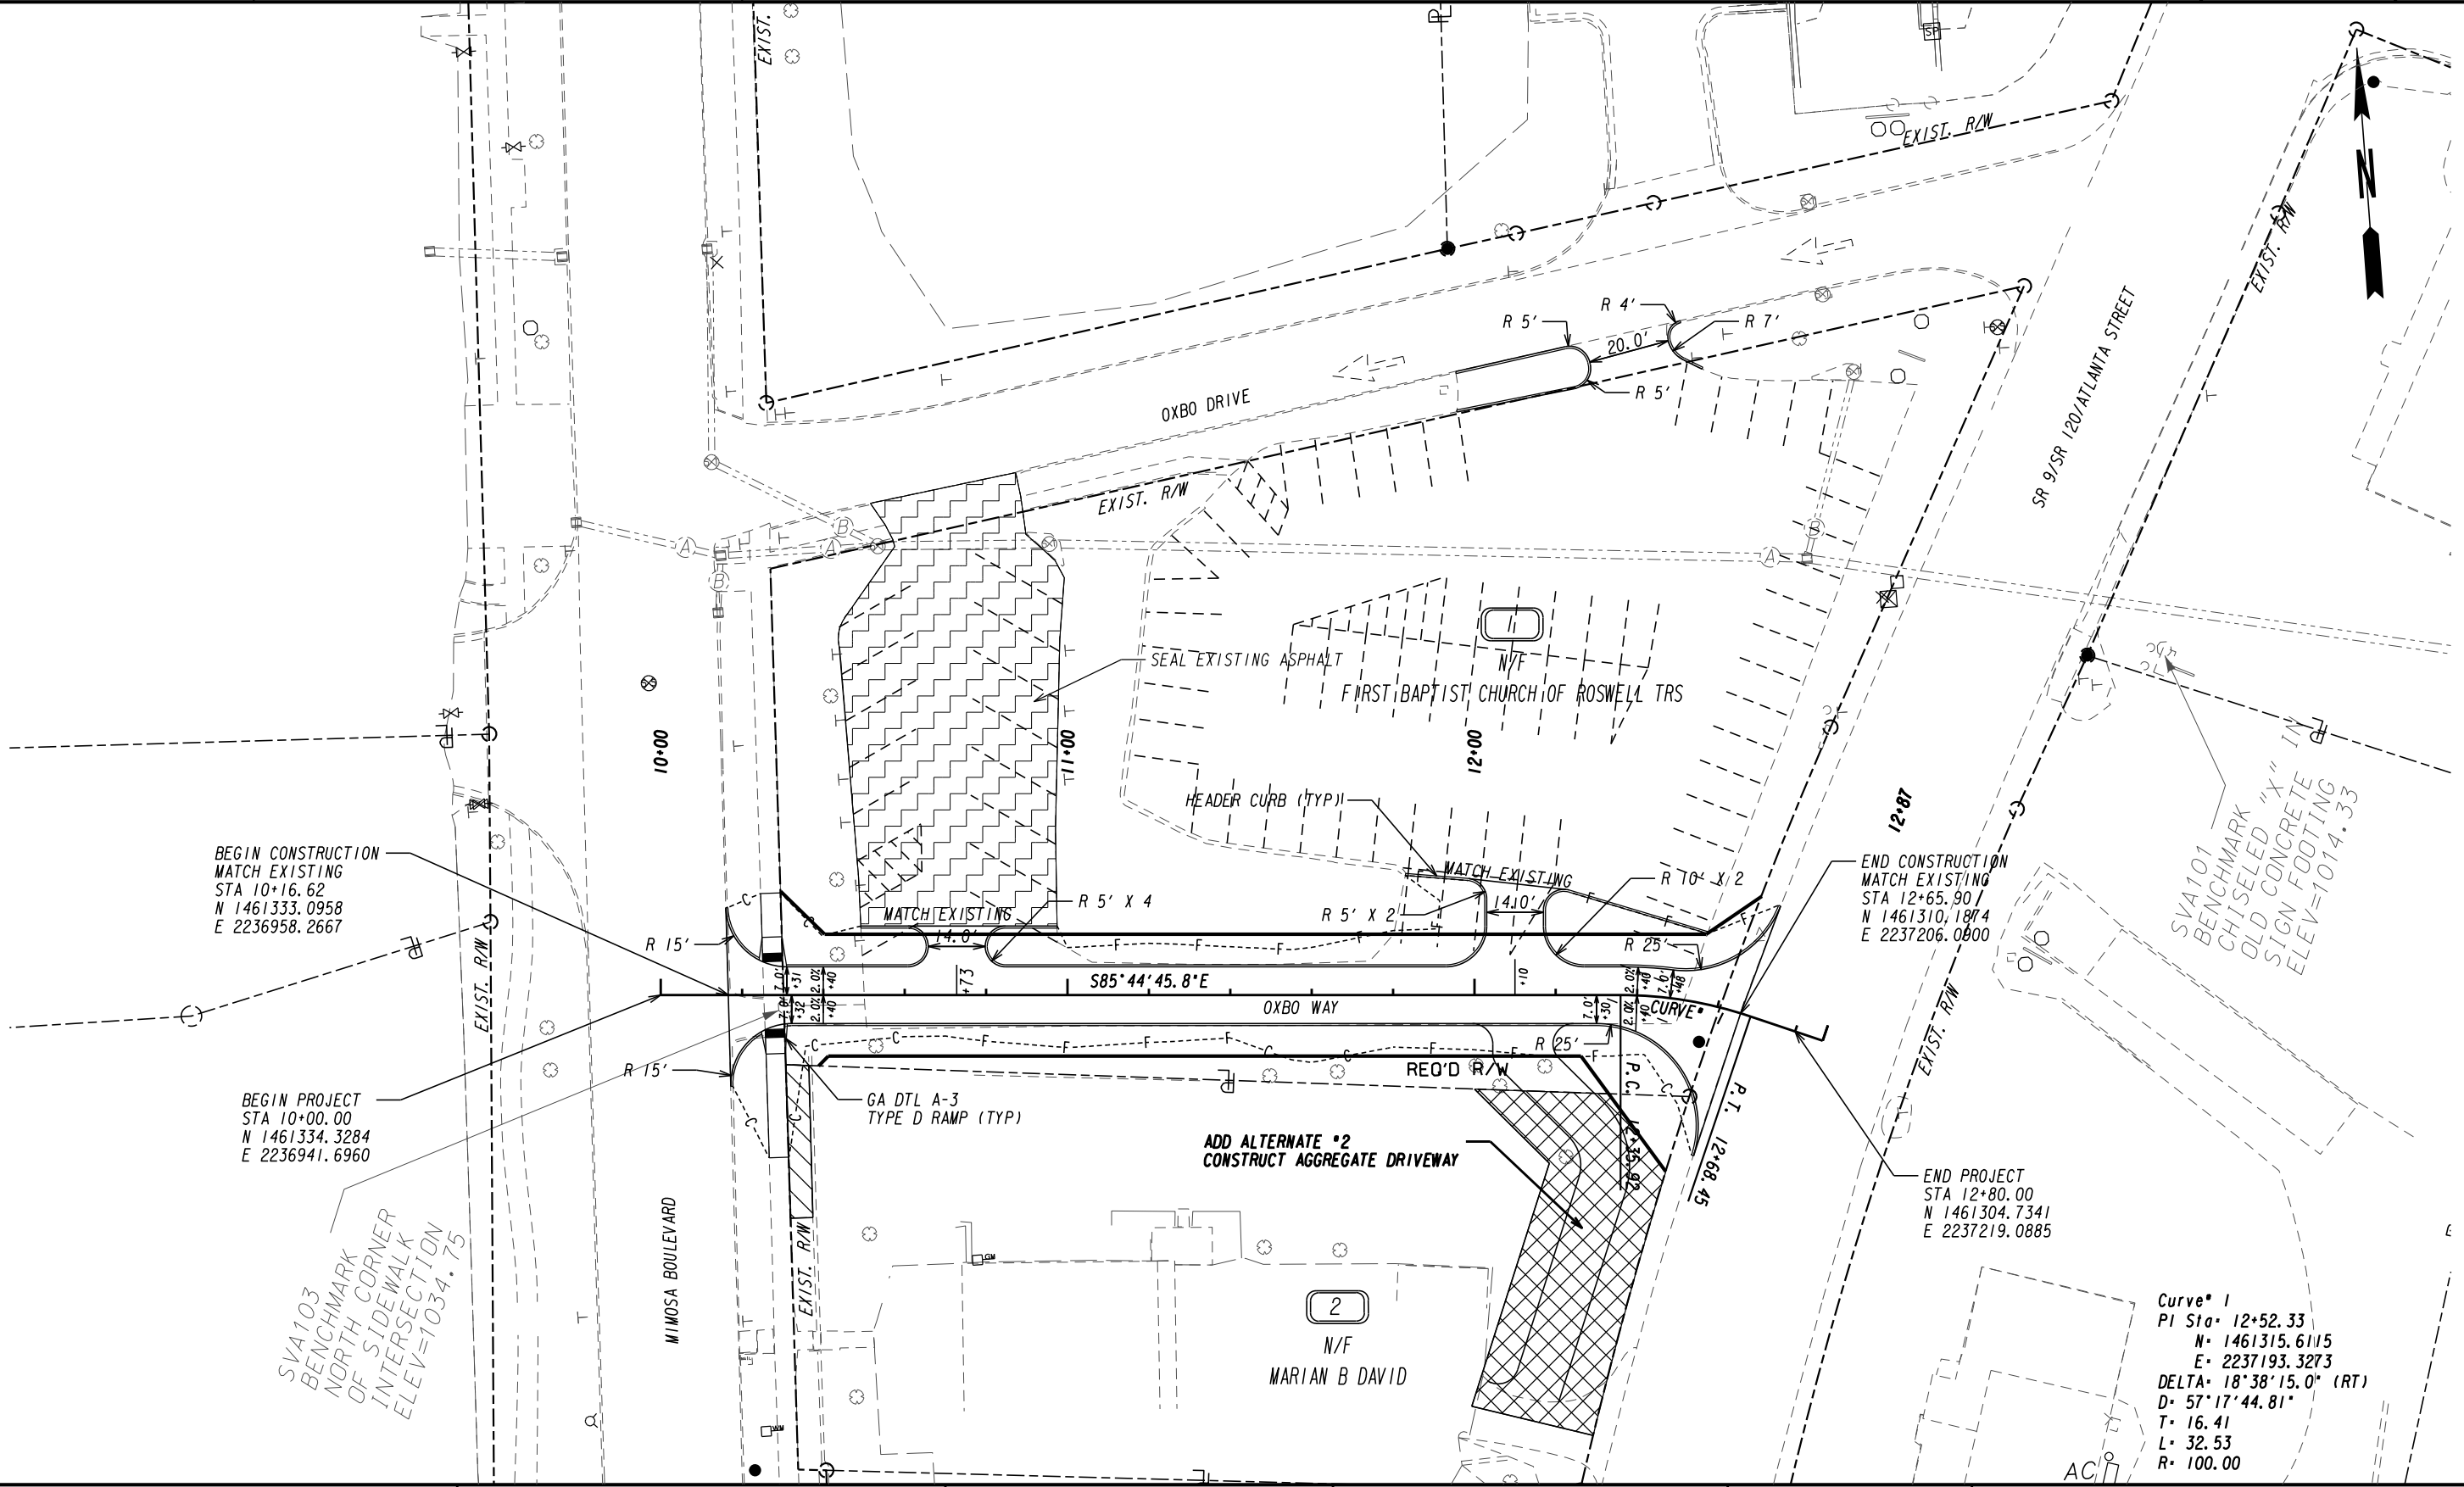

BEGIN CONSTRUCTION
MATCH EXISTING
STA 10+16.62
N 1461333.0958
E 2236958.2667

BEGIN PROJECT
STA 10+00.00
N 1461334.3284
E 2236941.6960


SVA103
BENCHMARK
NORTH CORNER
OF SIDEWALK
INTERSECTION
ELEV=1034.75

END CONSTRUCTION
MATCH EXISTING
STA 12+65.90/
N 1461310.1874
E 2237206.0800

END PROJECT
STA 12+80.00
N 1461304.7341
E 2237219.0885


Curve # 1
PI Sta= 12+52.33
N= 1461315.6115
E= 2237193.3273
DELTA= 18°38'15.0" (RT)
D= 57'17"44.81"
T= 16.41
L= 32.53
R= 100.00

PROPERTY AND EXISTING R/W LINE	
REQUIRED R/W LINE	
CONSTRUCTION LIMITS	
EASEMENT FOR CONSTR & MAINTENANCE OF SLOPES	
EASEMENT FOR CONSTR OF SLOPES	
EASEMENT FOR CONSTR OF DRIVES	




REVISION DATES	

MAINLINE PLAN		ADD ALTERNATE # 2	
CHECKED:	DATE:	DRAWING No.	
BACKCHECKED:	DATE:	13-004	
CORRECTED:	DATE:		
VERIFIED:	DATE:		

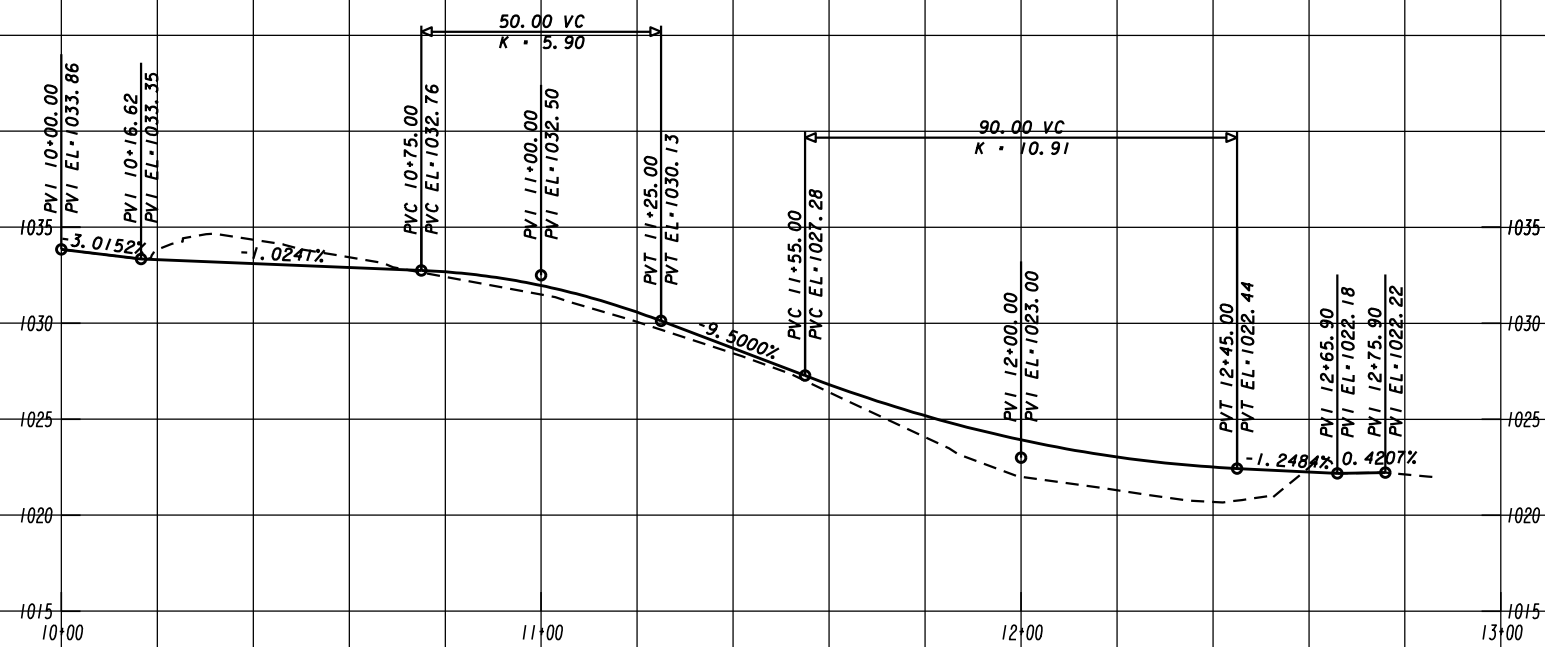

NOTES:

1. PROPOSED SPEED DESIGN = 15 MPH
2. MINIMUM K CREST = 3
3. MINIMUM K SAG = 10



REVISION DATES

NO.	DATE	DESCRIPTION

MAINLINE PROFILE

CHECKED:	DATE:	DRAWING No.
BACKCHECKED:	DATE:	15-001
CORRECTED:	DATE:	
VERIFIED:	DATE:	

1030

1020

STA 12+10 LT

1010
4+50



4+60

4+70

4+80

4+90

5+00


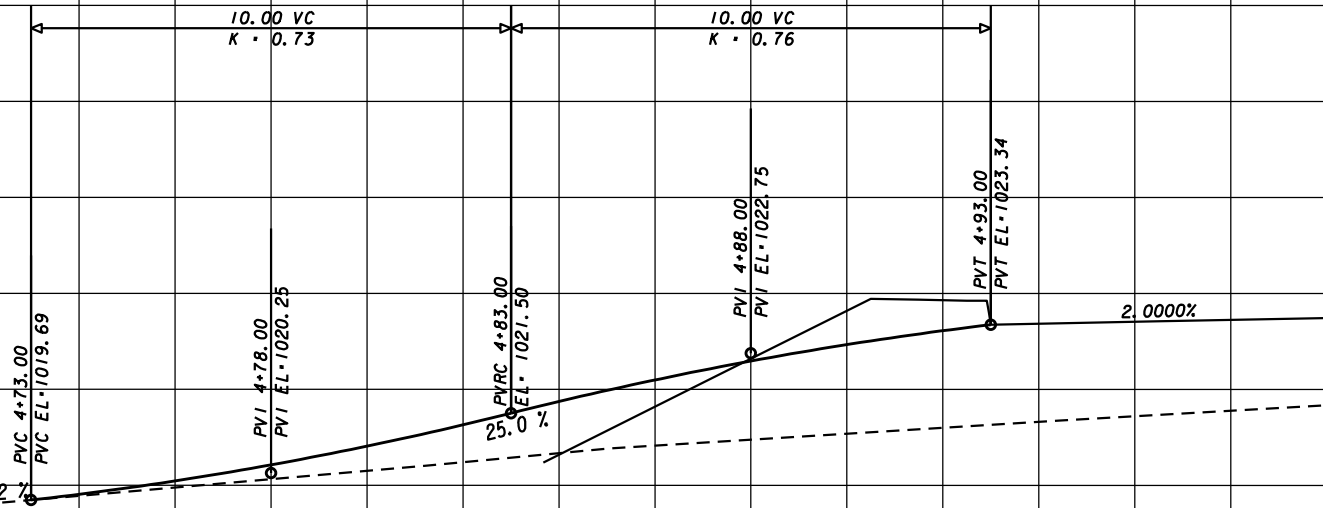


REVISION DATES

NO.	DATE	DESCRIPTION

DRIVEWAY PROFILE

CHECKED:	DATE:	DRAWING No.
BACKCHECKED:	DATE:	17-001
CORRECTED:	DATE:	
VERIFIED:	DATE:	


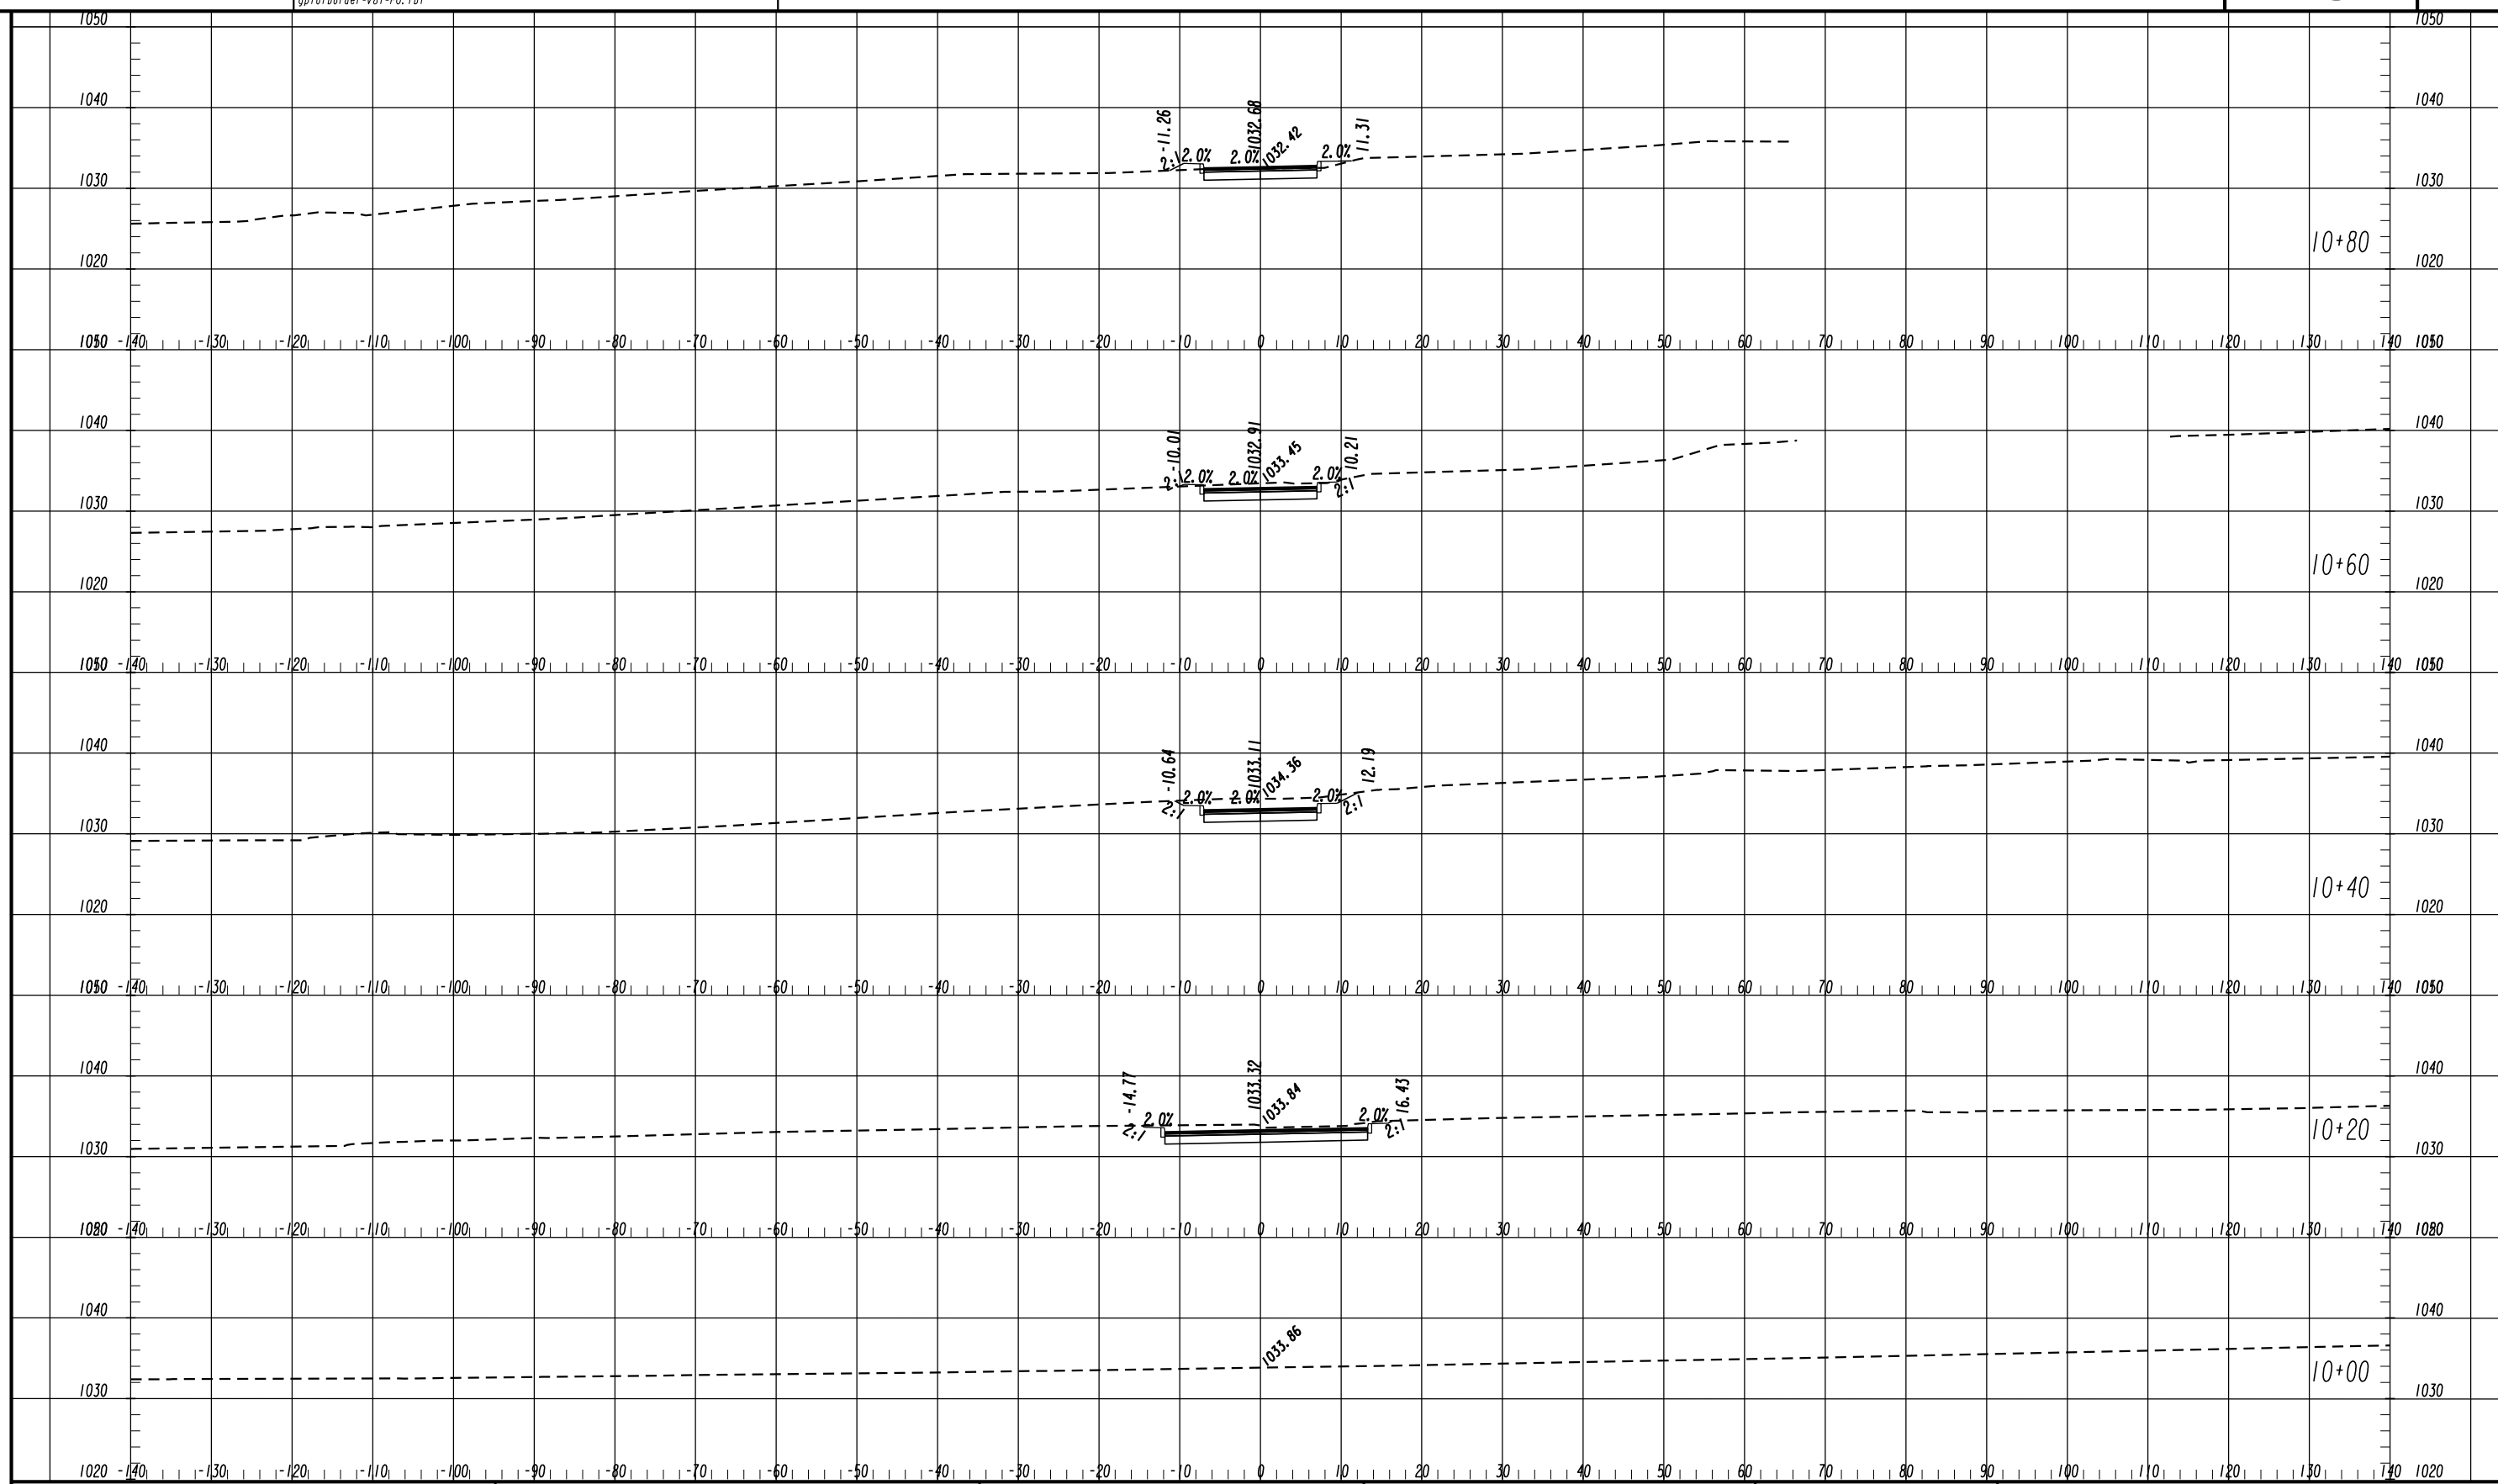


REVISION DATES

NO.	DATE	DESCRIPTION

CROSS SECTIONS



CHECKED:	DATE:	DRAWING No.
BACKCHECKED:	DATE:	23-001
CORRECTED:	DATE:	
VERIFIED:	DATE:	

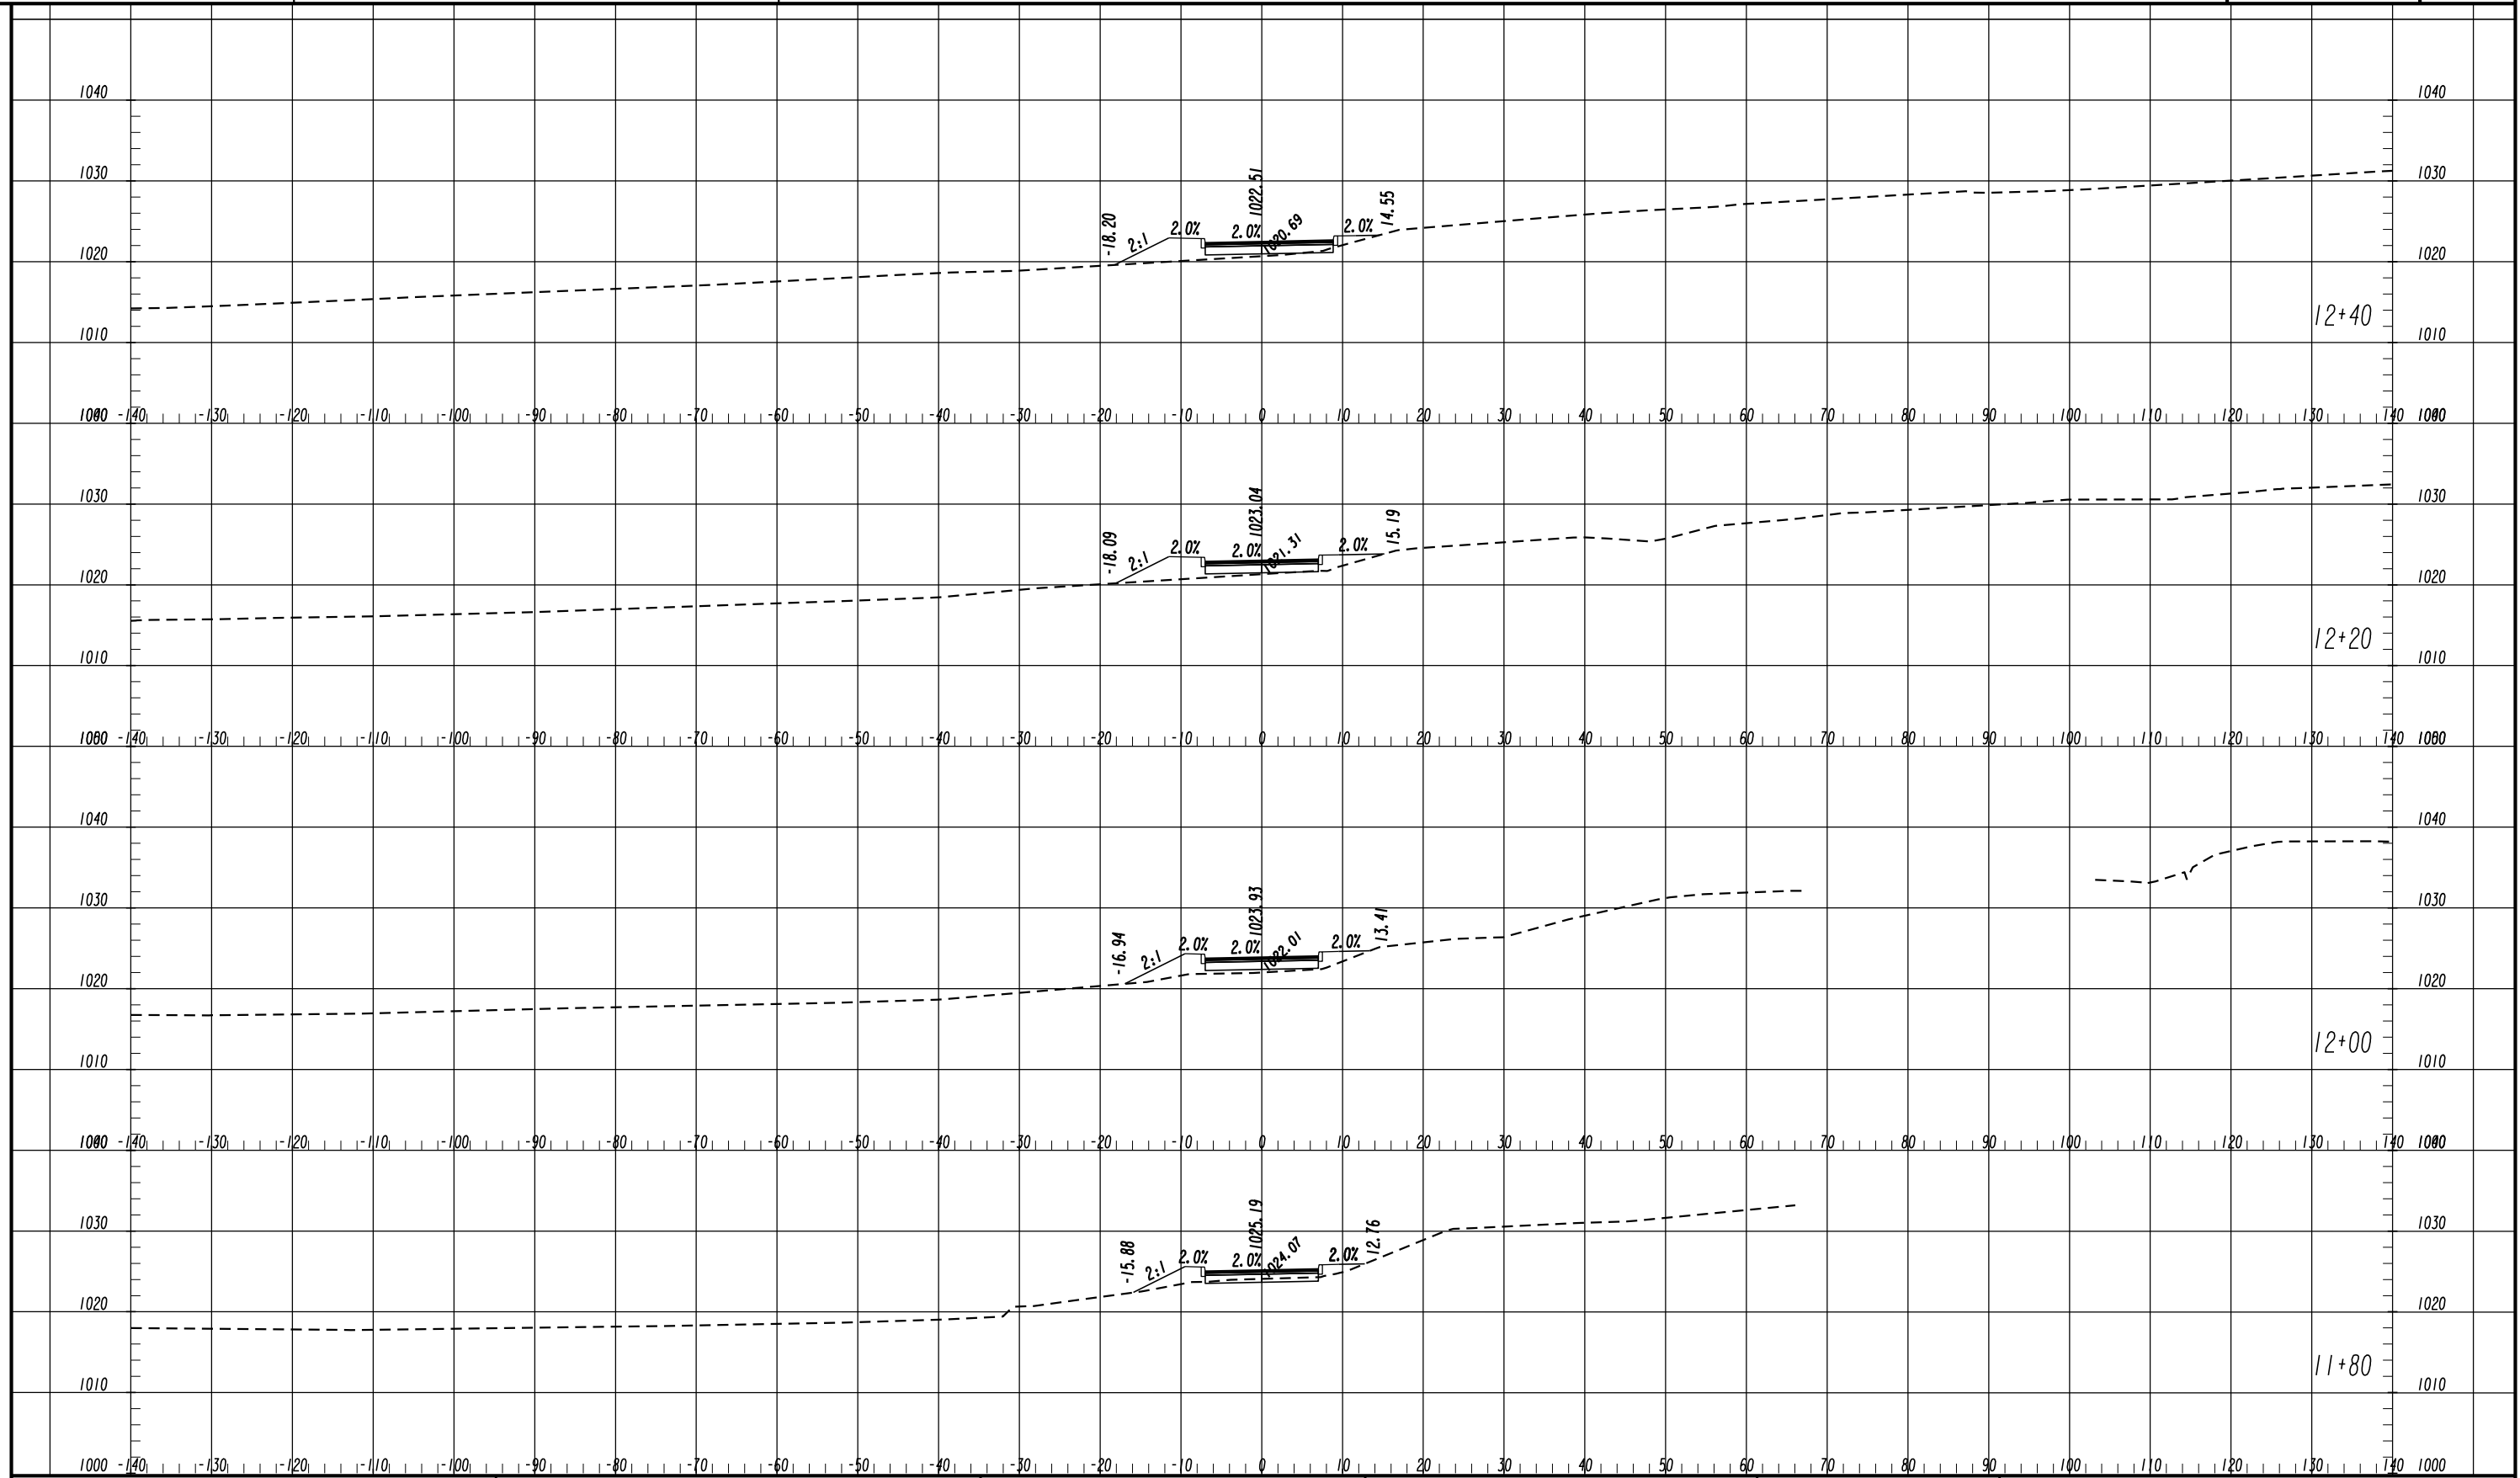

REVISION DATES


CROSS SECTIONS

CHECKED:		DATE:		DRAWING No.
BACKCHECKED:		DATE:		23-003
CORRECTED:		DATE:		
VERIFIED:		DATE:		

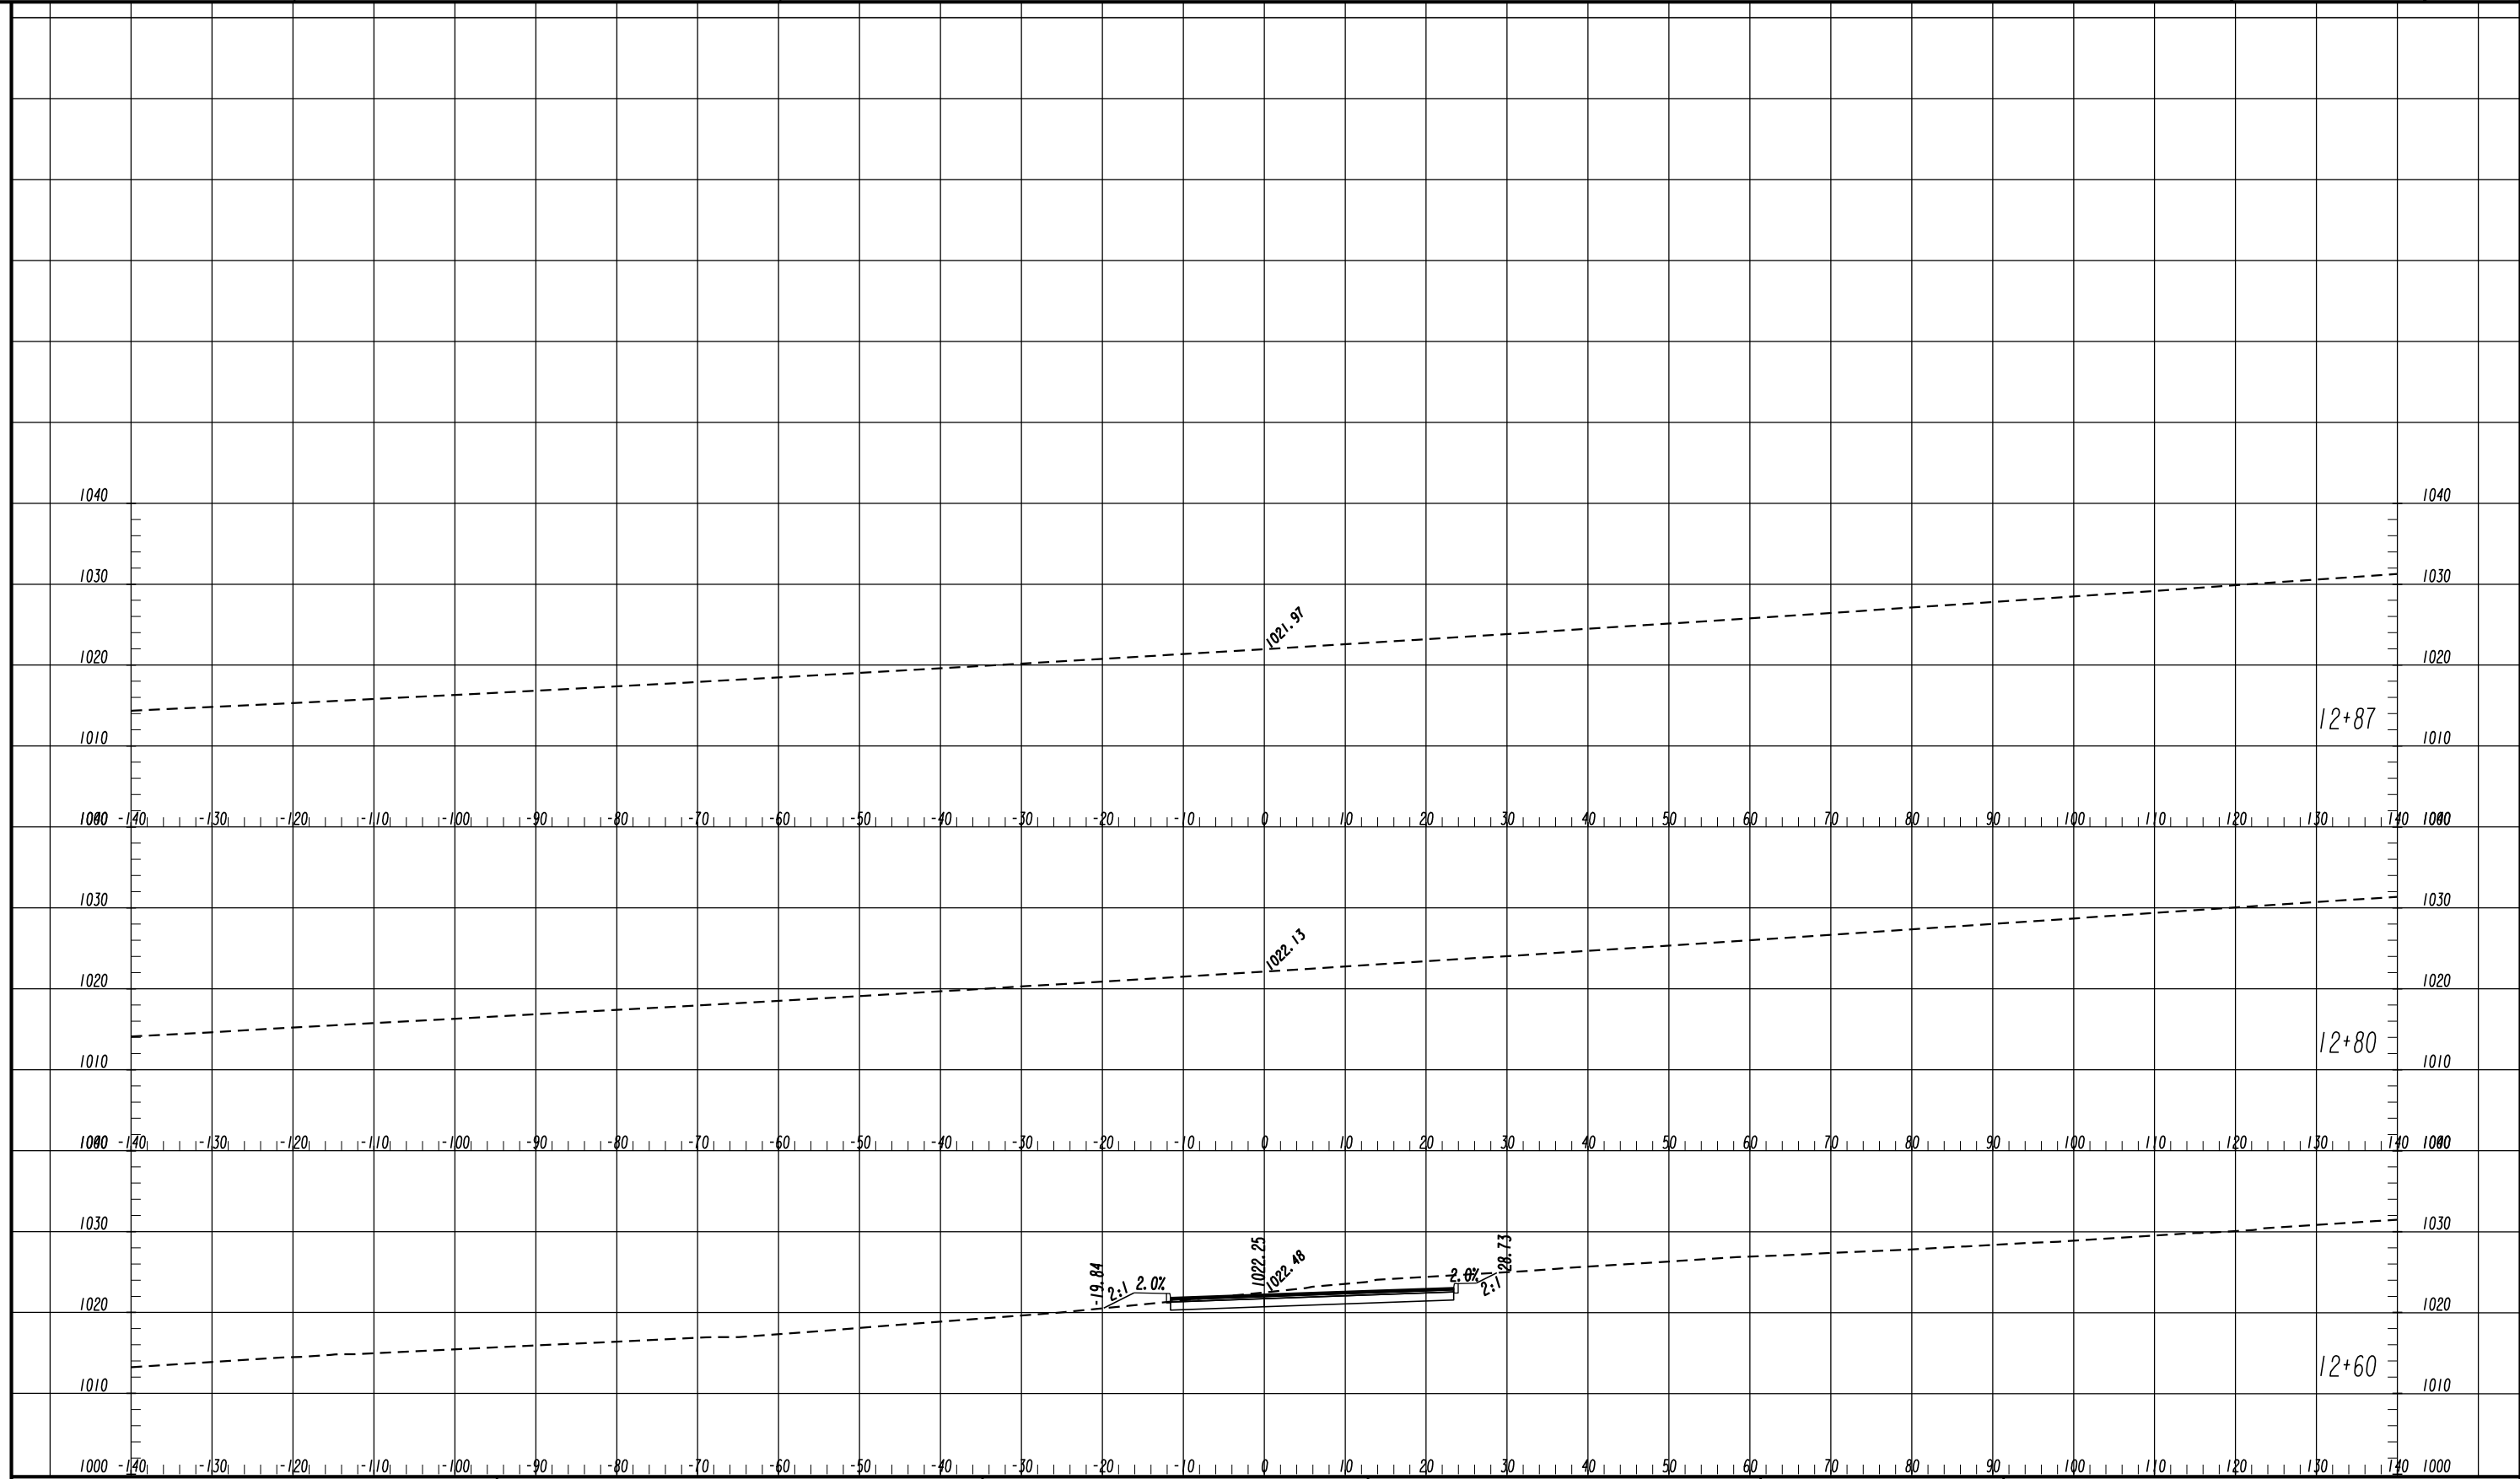


REVISION DATES	

CROSS SECTIONS			
CHECKED:		DATE:	
BACKCHECKED:		DATE:	
CORRECTED:		DATE:	
VERIFIED:		DATE:	
DRAWING No.			23-004

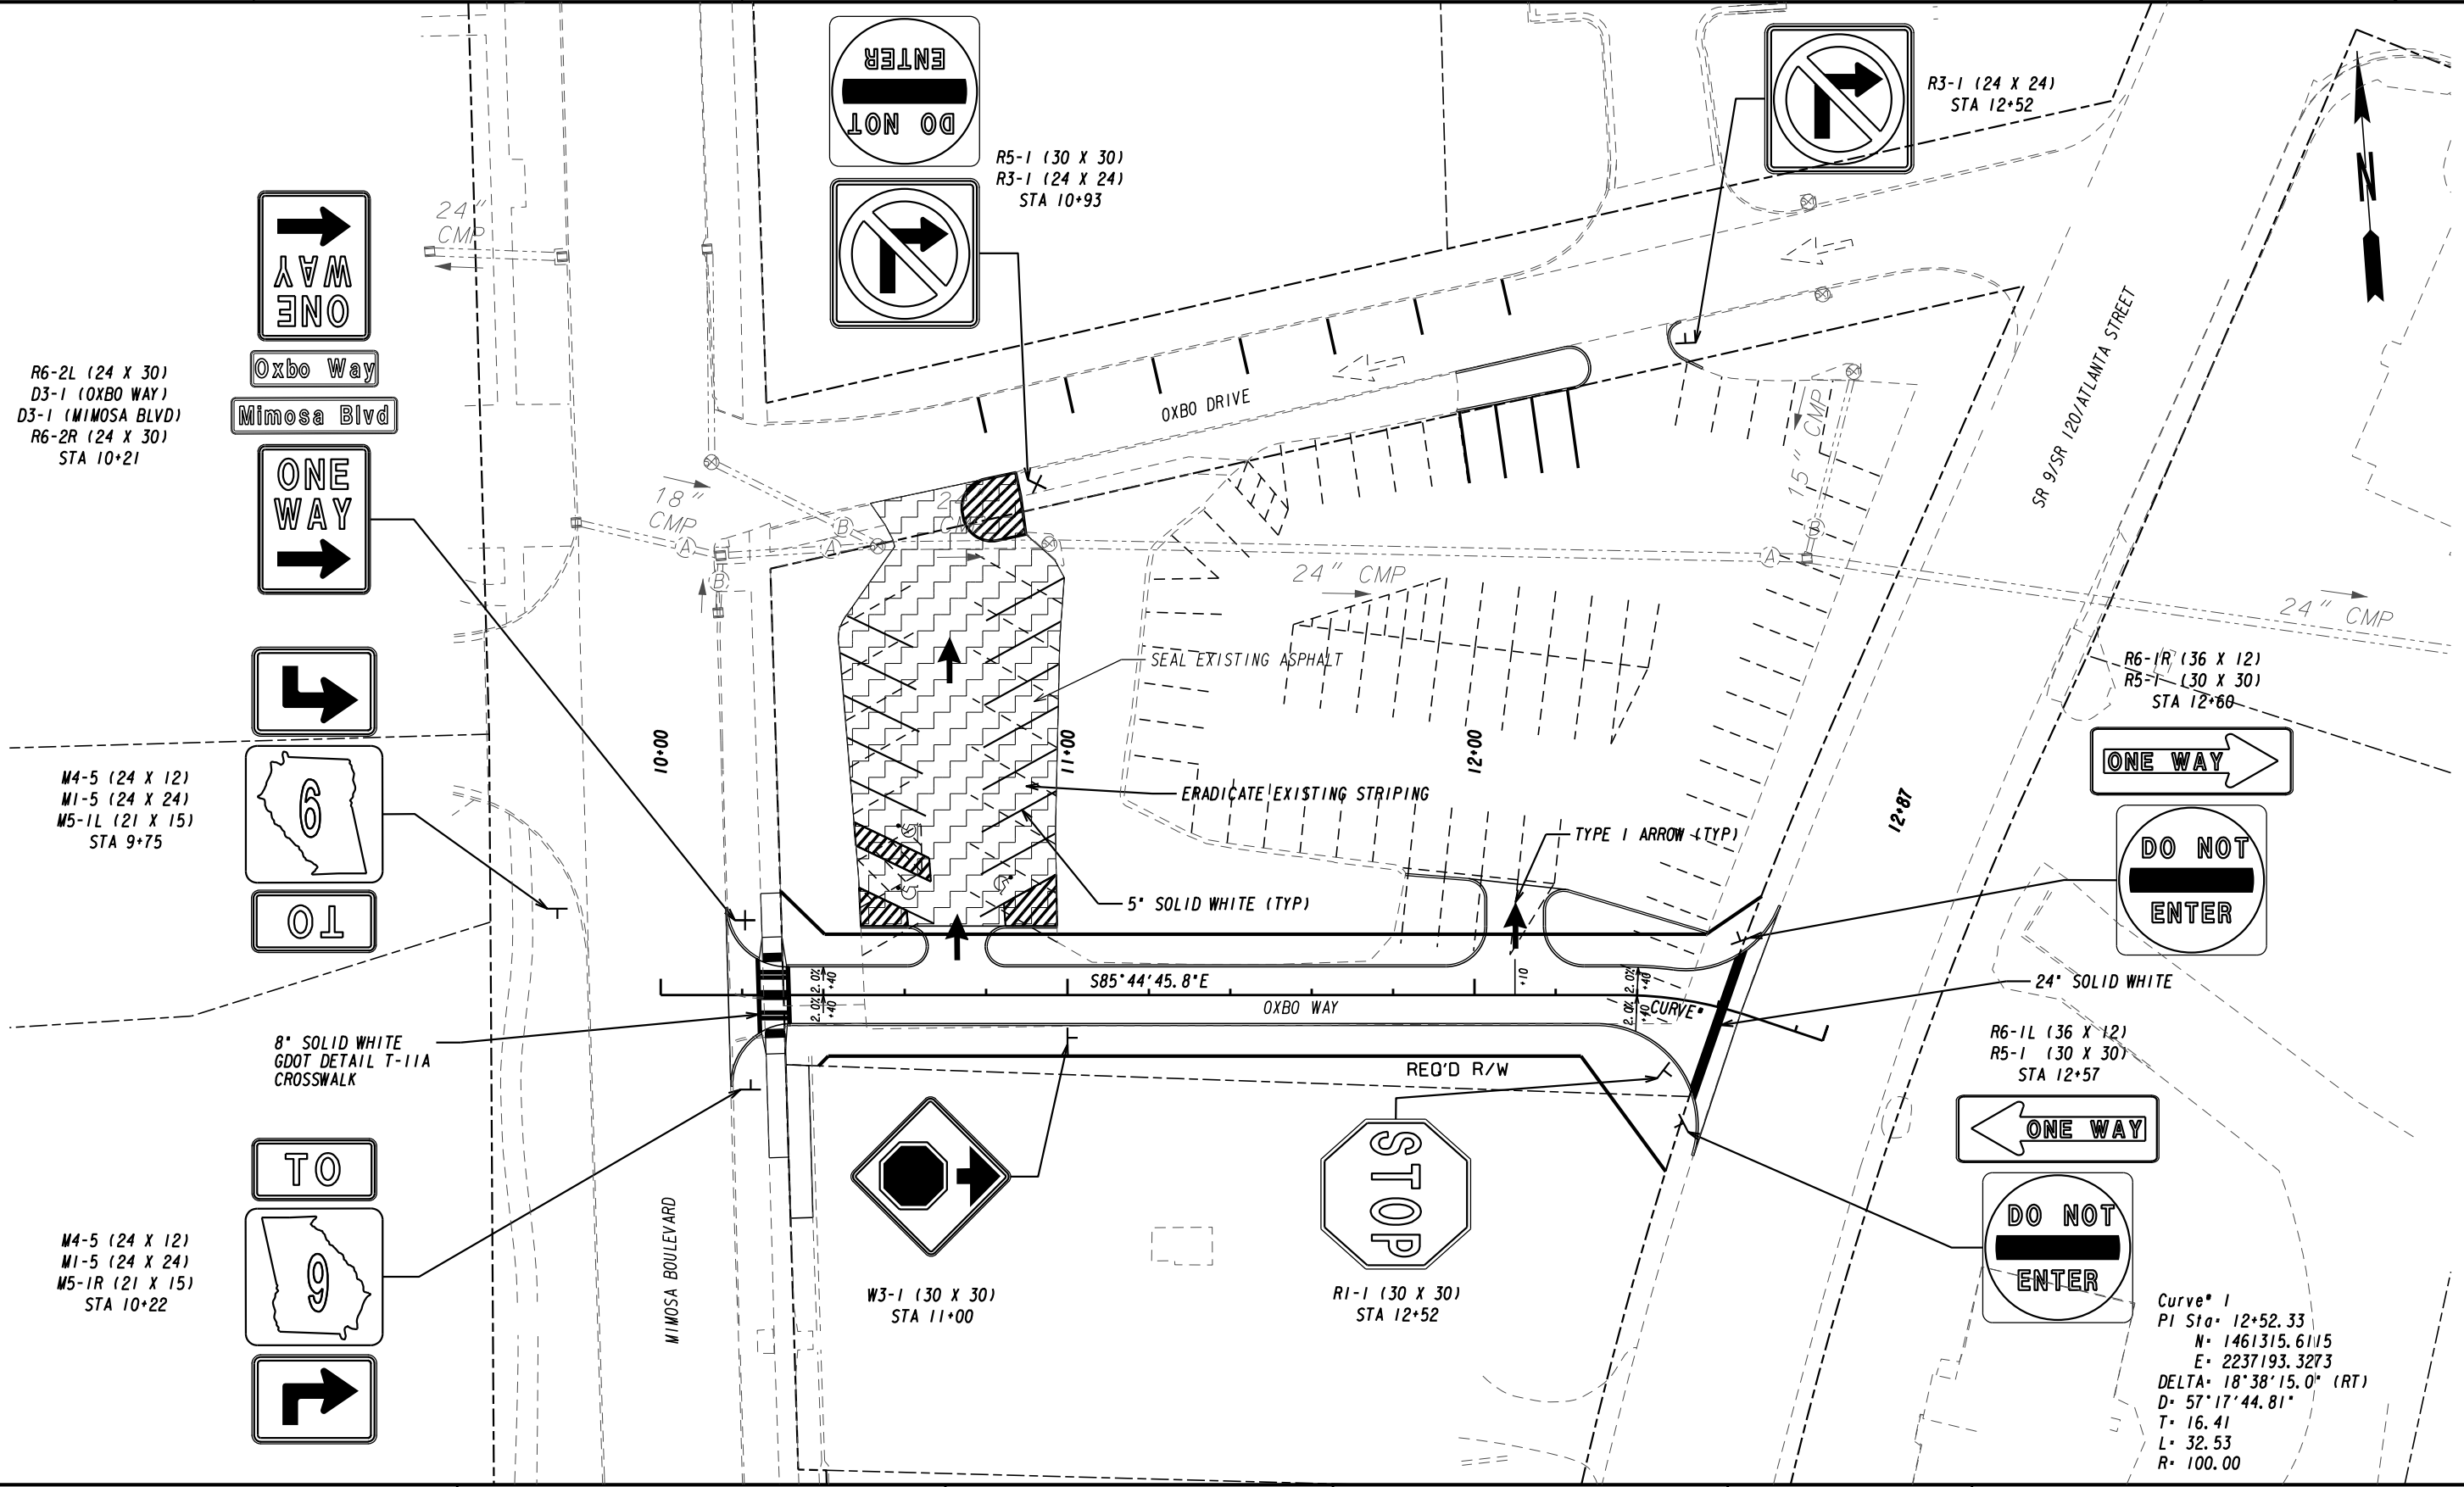


Curve 1
 PI Sta= 12+52.33
 N= 1461315.6115
 E= 2237193.3273
 DELTA= 18°38'15.0" (RT)
 D= 57°17'44.81"
 T= 16.41
 L= 32.53
 R= 100.00



REVISION DATES		SIGNING AND MARKING PLANS	
CHECKED:	DATE:	CHECKED:	DATE:
BACKCHECKED:	DATE:	CORRECTED:	DATE:
CORRECTED:	DATE:	VERIFIED:	DATE:
		DRAWING No.	
		26-001	


STATE	PROJECT NUMBER	SHEET NO.	TOTAL SHEETS
GA.			

TYPICAL LOCATIONS FOR CURB CUT RAMPS - PLAN VIEW

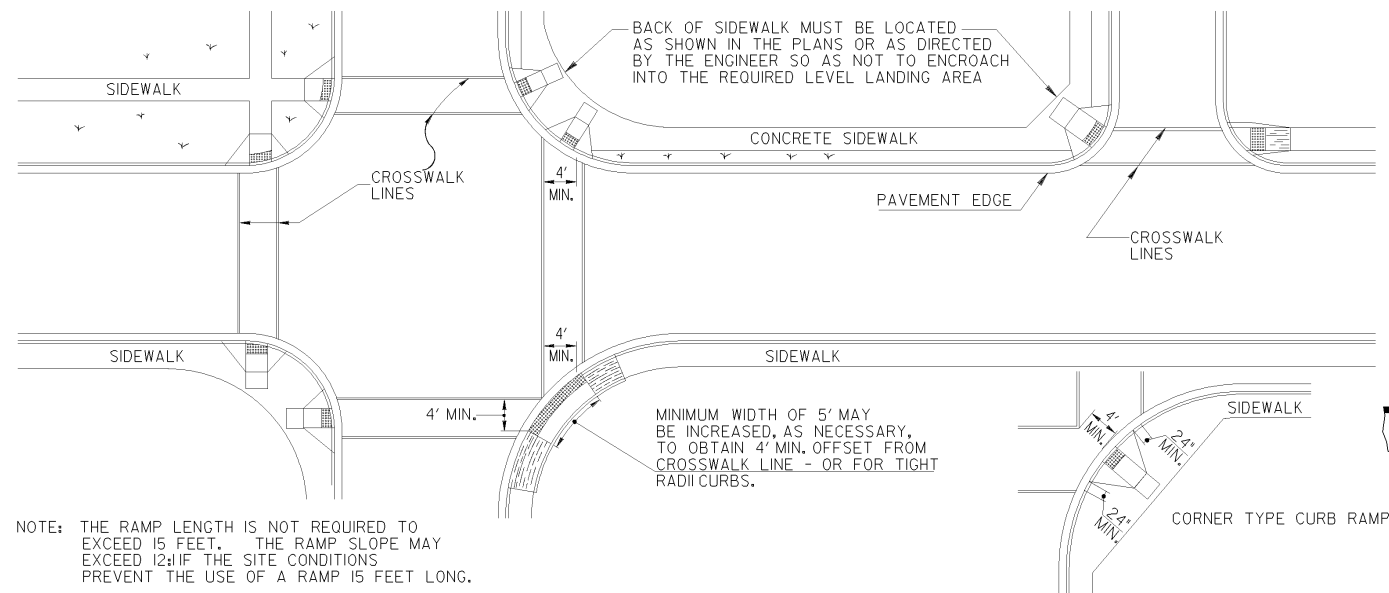


NOTE: THE RAMP LENGTH IS NOT REQUIRED TO EXCEED 15 FEET. THE RAMP SLOPE MAY EXCEED 12:1 IF THE SITE CONDITIONS PREVENT THE USE OF A RAMP 15 FEET LONG.

CONCRETE SIDEWALK DETAILS

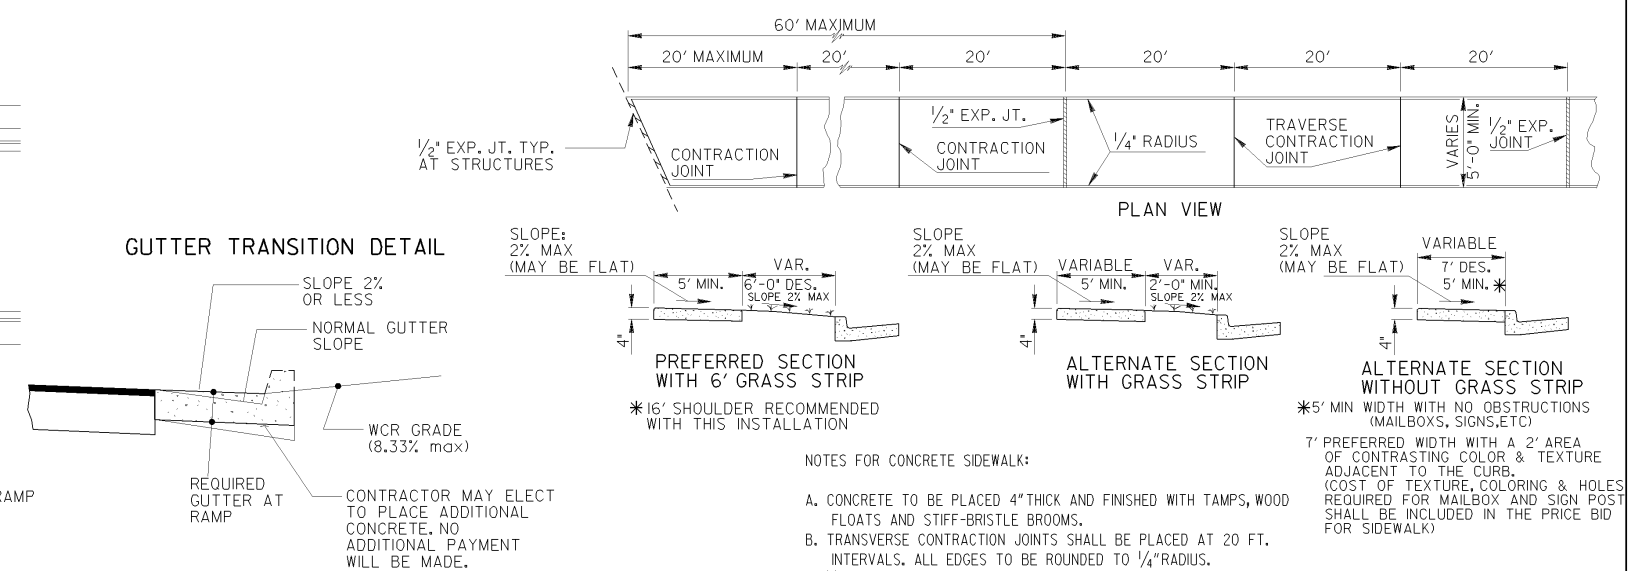


NOTES FOR CONCRETE SIDEWALK:
 A. CONCRETE TO BE PLACED 4" THICK AND FINISHED WITH TAMPS, WOOD FLOATS AND STIFF-BRISTLE BROOMS.
 B. TRANSVERSE CONTRACTION JOINTS SHALL BE PLACED AT 20 FT. INTERVALS. ALL EDGES TO BE ROUNDED TO 1/4" RADIUS.
 C. 1/2" EXPANSION JOINTS SHALL BE PLACED, WHERE SIDEWALK TIE INTO A STRUCTURE OR TERMINATE AT CURB, RAMPS OR DRIVEWAYS AND AT 60' INTERVALS.


Type A
(The Preferred Ramp)

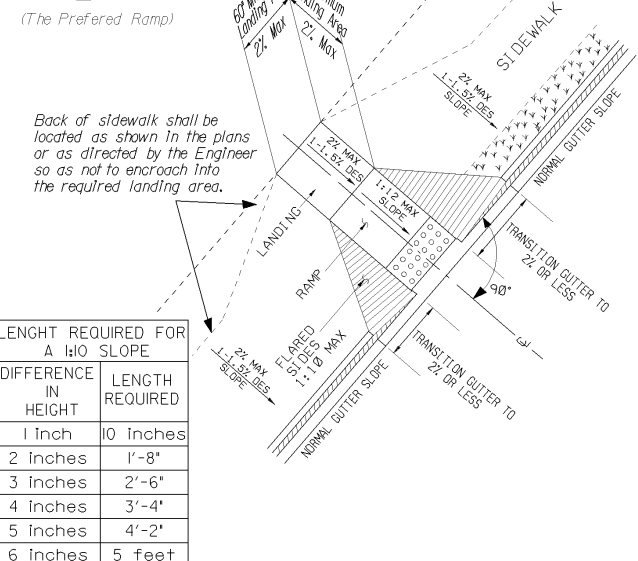


Type B
(Normally used when space is not available for a landing at the top of a Type A Ramp)

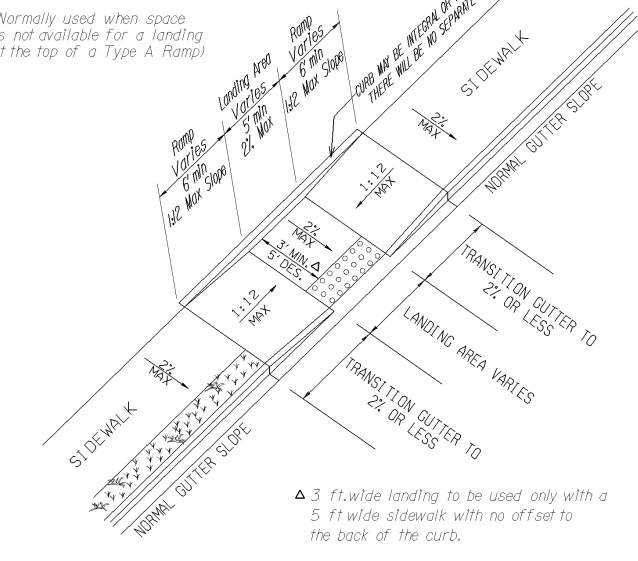


Type D
(Normally used when the sidewalk ties directly into the crosswalk)

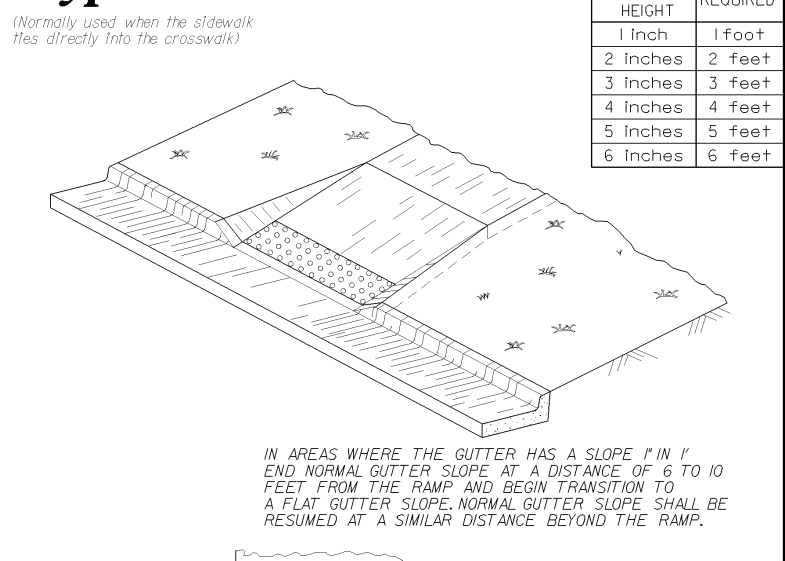

Type C

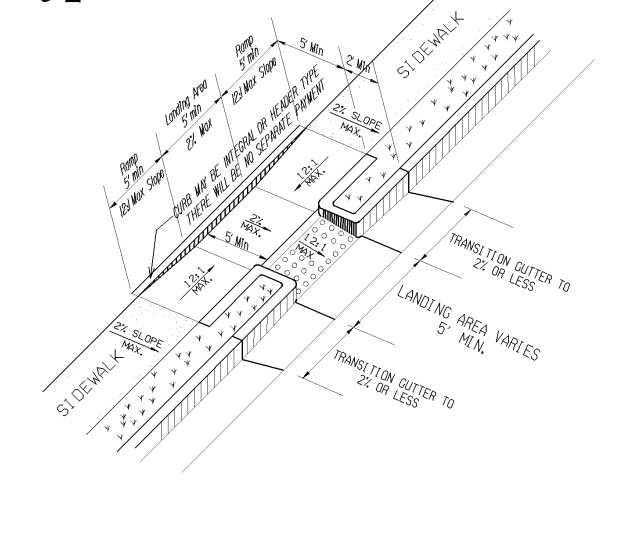


Skewed Ramp Details
(Applies to Type A & Type D Ramps Only)

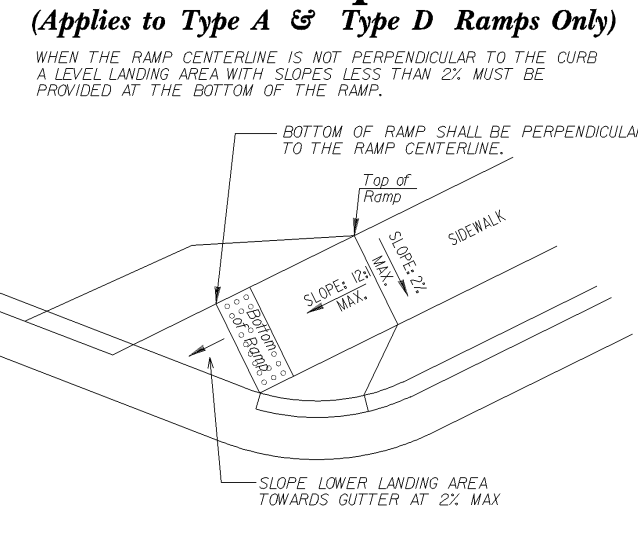

This Detail Replaces Ga Standard 9031W
Guidelines For Usage On Metric Projects



When these details are incorporated into plans and or projects that are being prepared or constructed in metric units, exact or precise conversion to metric units is not required. The dimensions shown that are in feet and inches may be converted to corresponding metric units using the following "Rounded-Off" conversion factors: 1"=25mm, 4"=100mm, and 12" or 1'=300mm. All measurement notes that refer to linear feet and square yards shall be interpreted to mean linear meters and square meters.

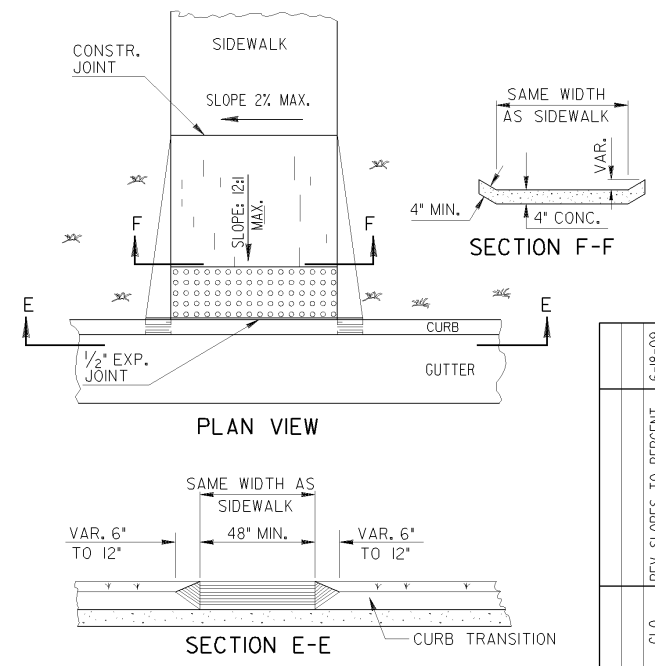




REV.	DATE	REVISION
6-18-09		
2-10-03		
7-29-02		
5-29-02		
5-23-02		
5-13-02		
4-29-02		
4-11-02		
4-3-02		
3-29-02		

DEPARTMENT OF TRANSPORTATION STATE OF GEORGIA	
SPECIAL DETAIL CONCRETE SIDEWALK DETAILS CURB CUT (WHEELCHAIR) RAMPS	
NO SCALE	MARCH 12, 2002
	NUMBER A3

STATE	PROJECT NUMBER	SHEET NO.	TOTAL SHEETS
GA.			

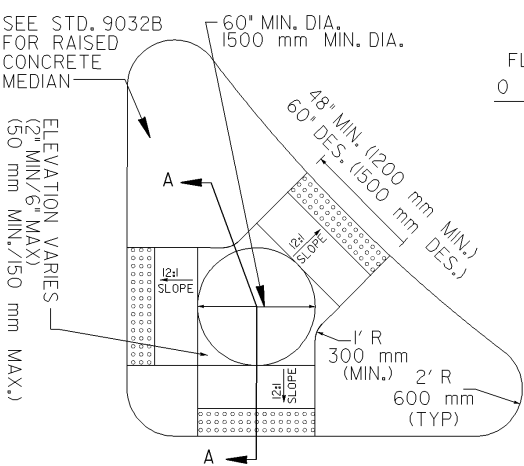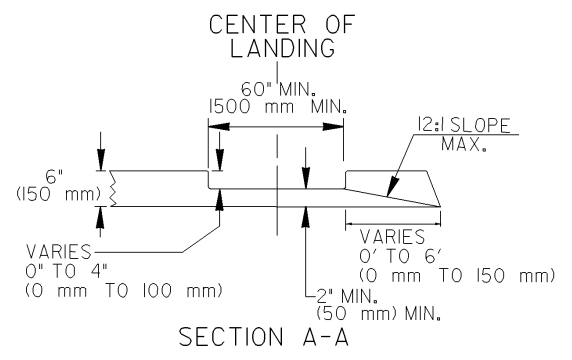

CONCRETE ISLAND WITH ELEVATED CUT THROUGH

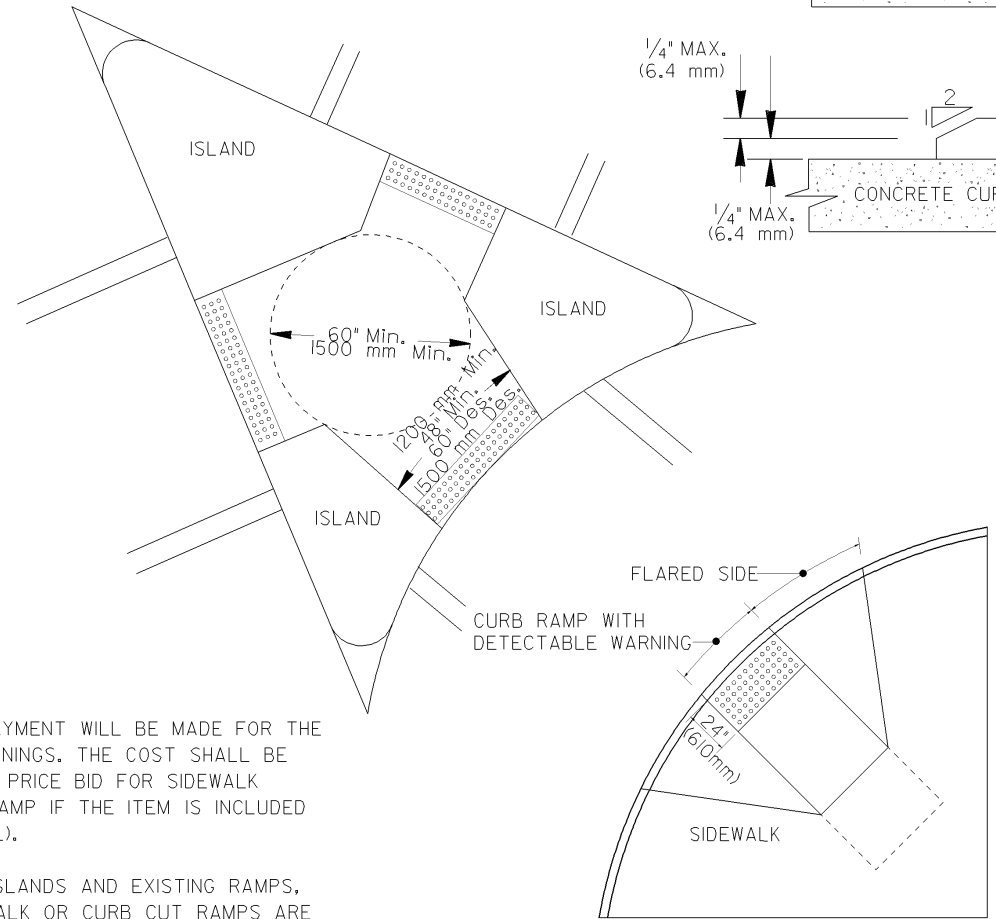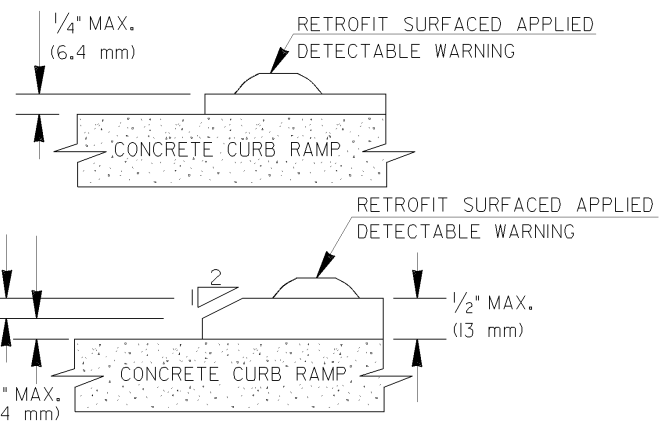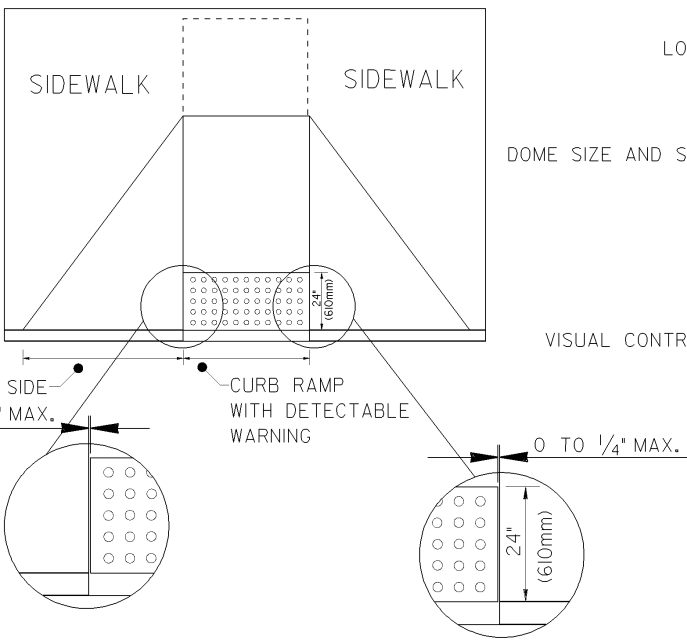




DETAIL FOR DETECTABLE WARNING AT CUT-THRU CONCRETE ISLAND

SIZE: DETECTABLE WARNINGS SHALL BE 24 INCHES (610 mm) IN THE DIRECTION OF PEDESTRAIN TRAVEL AND EXTEND THE FULL WIDTH OF THE CURB RAMP OR FLUSH SURFACE.

LOCATION: THE DETECTABLE WARNING SHALL BE LOCATED SO THAT THE EDGE NEAREST THE CURB LINE OR OTHER POTENTIAL HAZARD IS 6 TO 8 INCHES (150 mm to 180mm) FROM THE CURB LINE OR OTHER POTENTIAL HAZARD, SUCH AS A REFLECTIVE POOL EDGE OR THE DYNAMIC ENVELOPE OF RAIL OPERATIONS.

DOMES SIZE AND SPACING: TRUNCATED DOMES SHALL HAVE A BASE DIAMETER OF 0.9 INCH TO 1.4 INCH (23mm-36mm) AT THE BOTTOM, A DIAMETER OF 0.45 INCH TO 0.91 INCH (11mm-23mm) AT THE TOP, THE TOP DIAMETER SHALL BE A MINIMUM OF 50% AND A MAXIMUM OF 65% OF THE BASE DIAMETER, A HEIGHT OF 0.2 INCH (5.1mm) AND A CENTER-TO-CENTER SPACING OF 2.40 INCHES (61mm) DESIRABLE 1.60 INCHES (41mm) MINIMUM MEASURED ALONG ONE SIDE OF A SQUARE ARRANGEMENT. DOMES SHALL HAVE A SQUARE ARRANGEMENT. DOMES SHALL BE ALIGNED ON A SQUARE GRID IN THE PREDOMINANT DIRECTION OF TRAVEL TO PERMIT WHEELS TO ROLL BETWEEN DOMES.

VISUAL CONTRAST: DETECTABLE WARNING SURFACES SHALL CONTRAST VISUALLY WITH THE ADJACENT WALKING SURFACE EITHER LIGHT-ON-DARK OR DARK-ON-LIGHT. THE MATERIAL USED TO PROVIDE VISUAL CONTRAST SHALL BE AN INTEGRAL PART OF THE DETECTABLE WARNING SURFACE.

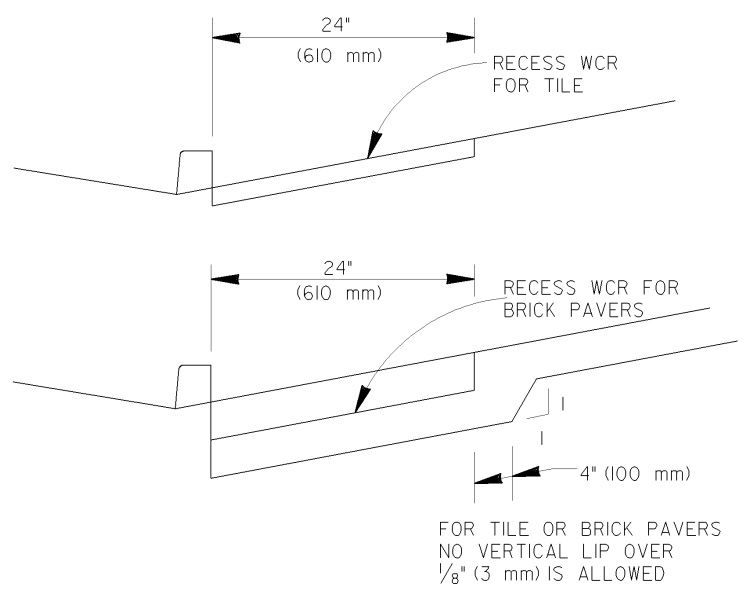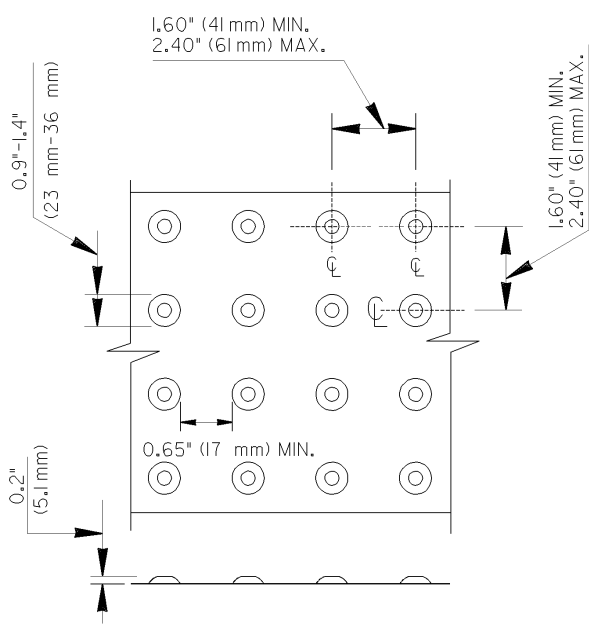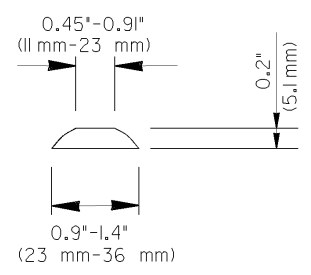

FOR TILE OR BRICK PAVERS NO VERTICAL LIP OVER 1/8" (3 mm) IS ALLOWED

NO SEPARATE PAYMENT WILL BE MADE FOR THE DETECTABLE WARNINGS. THE COST SHALL BE INCLUDED IN THE PRICE BID FOR SIDEWALK (OR CURB CUT RAMP IF THE ITEM IS INCLUDED IN THE PROPOSAL).

FOR CUT-THRU ISLANDS AND EXISTING RAMPS, WHERE NO SIDEWALK OR CURB CUT RAMPS ARE IN THE PROPOSAL. THE COST OF THE DETECTABLE WARNINGS SHALL BE INCLUDED IN THE OVERALL BID PRICE SUBMITTED.

MATERIALS:

NEW CONSTRUCTION

THE DETECTABLE WARNINGS SHALL BE MADE OF MATERIALS SPECIFIED ON OPL 87.

RETROFIT OF EXISTING RAMPS

SURFACED APPLIED MATERIALS WILL ONLY BE APPROVED TO BE USED ON EXISTING WHEELCHAIR RAMPS.

INSTALLATION:

BRICK PAVERS SHALL BE SET IN A WET MORTAR BED. THE BED SHALL BE PLACED ON CONCRETE. THE CONCRETE SHALL BE A MINIMUM OF 4" THICK.


CERAMIC TILE SHALL BE EPOXIED IN PLACE OR SET IN A WET MORTAR BED. MANUFACTURER RECOMMEND ADHESIVE OR FASTENER SHALL BE USED IN THE INSTALLATION.

ALL OTHER MATERIALS SHALL BE INSTALLED ACCORDING TO MANUFACTURES DETAILS OR INSTRUCTION.

GENERAL NOTES:


- RETROFIT SURFACED APPLIED MATERIALS ONLY:
- CHANGES IN LEVEL OF 1/4" (6.4 mm) HIGH MAXIMUM SHALL BE PERMITTED VERTICALLY ON SURFACED APPLIED MATERIALS.
 - CHANGES IN LEVEL BETWEEN 1/4" (6.4 mm) HIGH MINIMUM AND 1/2" (13mm) HIGH MAXIMUM SHALL BE BEVELED WITH A SLOPE NOT STEEPER THAN 2:1.

6-18-09		DEPARTMENT OF TRANSPORTATION	
ADDED RETROFIT DETAIL AND ADDED ALT. RAMP DETAIL AND GEN. NOTES		STATE OF GEORGIA	
10-2-06		SPECIAL DETAIL	
ADDED TOLERANCE TO DTL. REVISED TRUNCATED DOMES AND NOTES.		DETECTABLE WARNING SURFACE TRUNCATED DOME SIZE, SPACING AND ALIGNMENT REQUIREMENTS	
11-14-02		NO SCALE	
REVISED		MARCH 12, 2002	
7-29-02		REVISION	
DATE		BY	
GLO		NUMBER	
		A4	

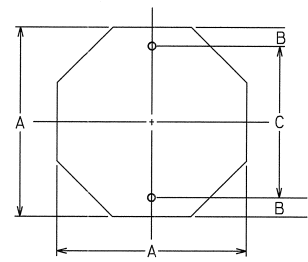


OCTAGON

A	B	C
24	3	18
30	3	24
36	3	30




A	B	C
48	9	30




EQUILATERAL TRIANGLE

A	B	C	R
30	3	18	1 1/2
36	3	21	2
48	3	27	3




A	B	C	D	R
60	3	18	15	3




DIAMOND

A	B	R
24	12	1 1/2
30	15	1 7/8
36	18	2 1/4




A	B	C	R
36	10	10	2 1/4
48	15	15	3
60	18	18	3 3/4

* FOR TWO POST ERECTION




SQUARE

A	B	C	R
18	3	12	1 1/2
24	3	18	1 1/2
30	3	24	1 7/8




A	B	C	D	E	R
36	6	24	6	24	2 1/4
48	6	36	6	36	3




VERTICAL RECTANGLE

A	B	C	D	R
12	18	1 1/2	15	1 1/2
18	24	3	18	1 1/2
24	30	3	24	1 1/2
30	36	3	30	1 7/8




A	B	C	D	E	F	R
36	48	6	36	6	24	2 1/4
48	60	6	48	9	30	3




PENTAGON

A	B	C	R
30	21	3	1 7/8
36	24	3	2 1/4




ISOSCELES TRIANGLE

A	B	C	D	R
40	30	7 1/2	12	1 7/8
48	36	9	15	2 1/4




CIRCLE

A	B
15	12
18	15




INTERSTATE SHIELD

A	B	C	D
24	24	3	18
30	24	3	18
36	36	6	24
45	36	6	24

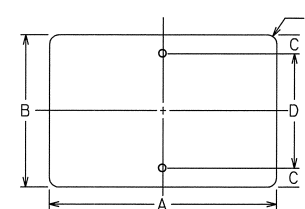

HORIZONTAL RECTANGLE



A	B	C	D	R
21	15	1 1/2	12	1 1/2
24	12	1 1/2	9	1 1/2
24	18	3	12	1 1/2
30	15	1 1/2	12	1 1/2
30	24	3	18	1 1/2
36	12	1 1/2	9	1 1/2
36	24	3	18	1 1/2
48	12	1 1/2	9	1 1/2
48	24	3	18	1 7/8

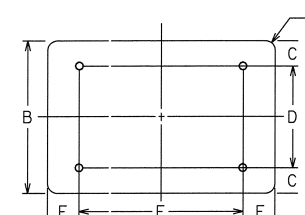

A	B	C	D	E	F	R
48	36	6	24	9	30	2 1/4
60	24	3	18	12	36	1 1/2
60	36	6	24	12	36	2 1/4

DATE	REVISIONS	GEORGIA DEPARTMENT OF TRANSPORTATION OFFICE OF TRAFFIC SAFETY & DESIGN DETAILS OF SIGN PLATES NO SCALE JANUARY 2000


STATE	PROJECT NUMBER	SHEET NO.	TOTAL SHEETS
GA.			

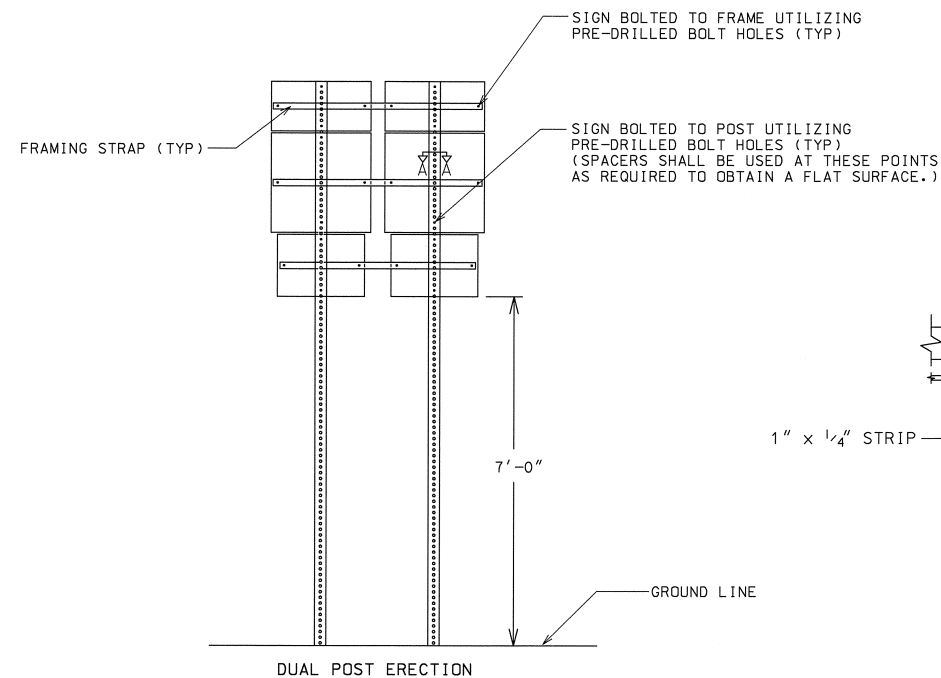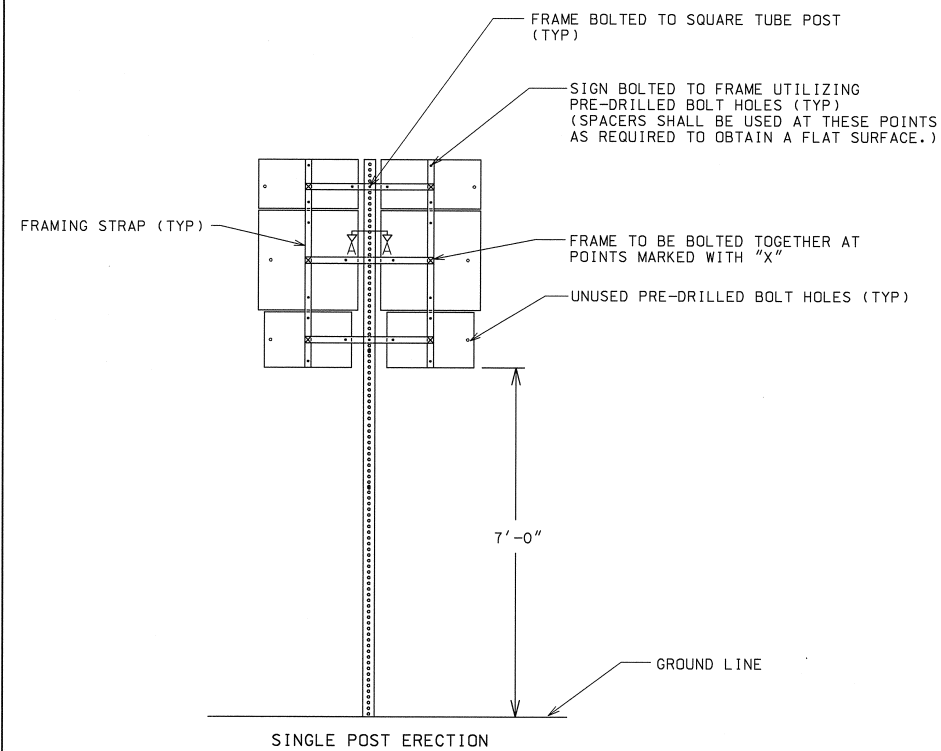


TYPICAL ASSEMBLY UNIT (BACK VIEW)

GENERAL NOTES:

1. STYLE OF FRAMING IS OPTIONAL. ALTERNATE DESIGNS ARE ACCEPTABLE UPON APPROVAL OF THE ENGINEER. FRAME SHALL BE DESIGNED SO AS TO HOLD THE ASSEMBLY IN A FIXED, RIGID POSITION.
2. FRAMING STRAPS SHALL BE GALVANIZED STEEL OR ALUMINUM.
3. STEEL SHALL BE A.S.T.M. DESIGNATION A-283, GRADE D, GALVANIZED IN ACCORDANCE WITH A.S.T.M. DESIGNATION A-123.
4. ALUMINUM SHALL BE ALLOY 6061-T6.
5. BOLTS, NUTS, WASHERS, AND SPACERS SHALL CONFORM TO THE STANDARD SPECIFICATIONS AND/OR SPECIAL PROVISIONS.
6. FRAMING STRAPS ON A DUAL POST ERECTION SHALL NOT BE BOLTED TO THE POST.

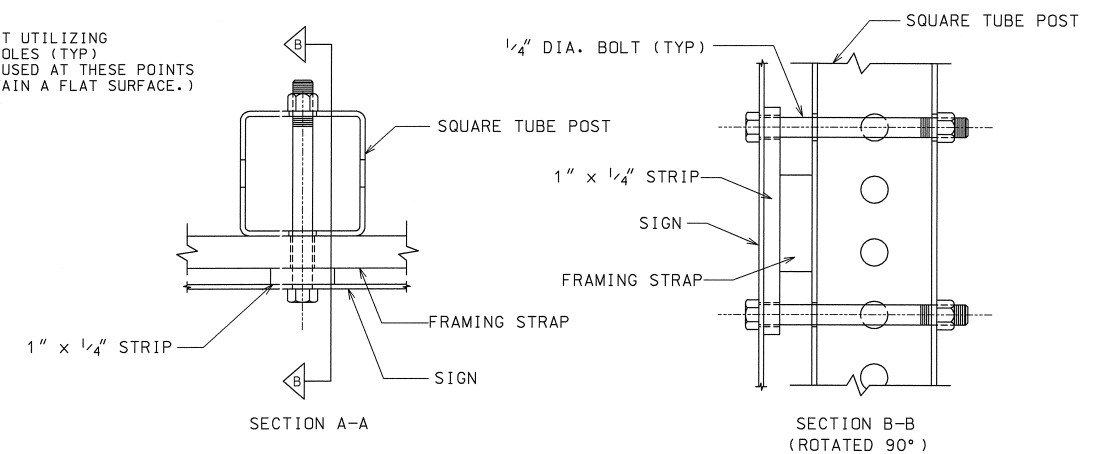

OPTION #1 - FRAMING STRAP WITHOUT MOUNTING HOLE
(ALL FRAMING STRAPS SHALL BE 1 1/2" x 1/2" x REQUIRED LENGTH)

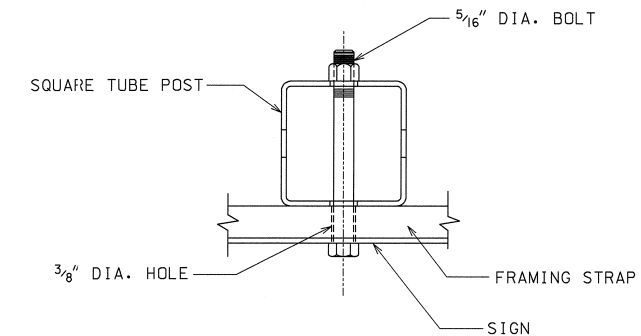


OPTION #2 - FRAMING STRAP WITH MOUNTING HOLE
(ALL FRAMING STRAPS SHALL BE 2" x 1/2" x REQUIRED LENGTH)

DATE	REVISIONS	GEORGIA DEPARTMENT OF TRANSPORTATION OFFICE OF TRAFFIC OPERATIONS
3/31/00	CHANGED U-CHANNEL POST TO SQUARE TUBE POST	

DETAILS FOR
TYPICAL FRAMING


NO SCALE JANUARY 2000

STATE	PROJECT NUMBER	SHEET NO.	TOTAL SHEETS
GA.			

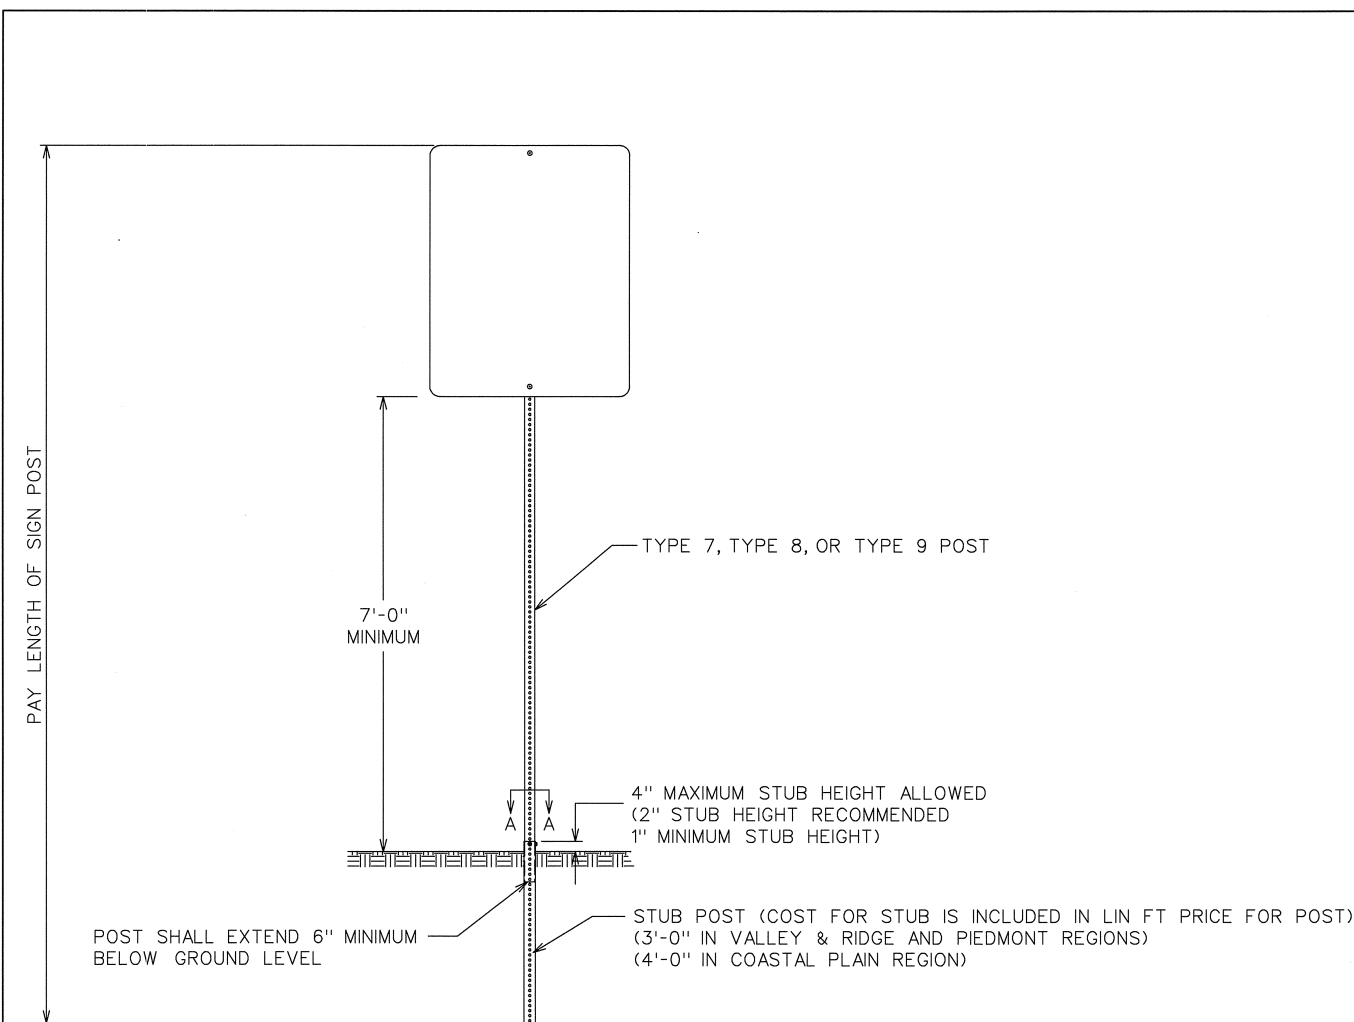

FRONT VIEW

POST	STUB SIZE
TYPE 7	2 1/4" x 2 1/4"
TYPE 8	2 3/4" x 2 3/4"
TYPE 9	2 1/2" x 2 1/2"

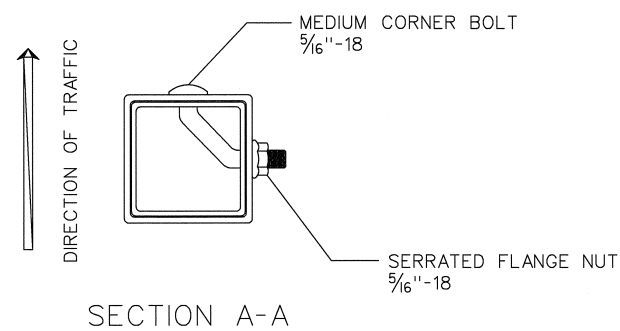

SECTION A-A

SIGN POST SELECTION CHART

70 MPH Wind Load Chart + 15% Gust Factor

Sign Centroid	SLIP BASE NOT REQUIRED				GROUND MOUNTED BREAKAWAY SIGN SUPPORT REQUIRED				
	TYPE 7 2" 14 ga.		TYPE 9 2-1/4" 14 ga	TYPE 8 2-1/2" 12 ga.	TYPE 8 2-1/2" 12 ga.		TYPE 8 w / TYPE 9 Insert* 2-1/2" 12 ga. W / 2-1/4" 14 ga.		
	1 Post	2 Post	1 Post	1 Post	2 Post	3 Post	1 Post	2 Post	3 Post
	SQUARE FOOTAGE				SQUARE FOOTAGE				
6'	13.50	27.00	19.25	30.00	60.00	90.00	49.25	98.50	147.75
7'	11.60	23.20	16.50	25.75	51.50	77.25	42.25	84.50	126.75
8'	10.15	20.30	14.45	22.55	45.10	67.65	37.00	74.00	111.00
9'	9.00	18.00	12.85	20.00	40.00	60.00	32.85	65.70	98.55
10'	8.10	16.20	11.55	18.00	36.00	54.00	29.55	59.10	88.65
11'	7.40	14.80	10.50	16.40	32.80	49.20	26.90	53.80	80.70
12'	6.80	13.60	9.65	15.00	30.00	45.00	24.65	49.30	73.95
13'	6.25	12.50	8.90	13.85	27.70	41.55	22.75	45.50	68.25
14'	5.80	11.60	8.25	12.90	25.80	38.70	21.15	42.30	63.45
15'	5.00	10.00	6.45	10.10	20.20	30.30	16.55	33.10	49.65
16'	4.70	9.40	6.05	9.45	18.90	28.35	15.50	31.00	46.50
17'	4.40	8.80	5.70	8.90	17.80	26.70	14.60	29.20	43.80
18'	4.15	8.30	5.40	8.40	16.80	25.20	13.80	27.60	41.40
19'	3.95	7.90	5.10	7.95	15.90	23.85	13.05	26.10	39.15
20'	3.75	7.50	4.85	7.55	15.10	22.65	12.40	24.80	37.20

SIGN CENTROID IS DISTANCE FROM GROUND LEVEL TO BOTTOM OF SIGN PLUS HALF THE HEIGHT OF SIGN.
 EXAMPLE: 24" X 48" SIGN THAT IS 7 FEET FROM GROUND TO BOTTOM OF SIGN. ADD HALF OF 48" (24" OR 2 FT) PLUS 7 FT. = 9' CENTROID.


SIGN PLATE SHALL NOT EXCEED 48" IN WIDTH ON A SINGLE POST.

* TYPE 9 INSERT SHALL BE A CONTINUOUS POST INSERTED INTO THE TYPE 8 POST WHERE REQUIRED. THE INSERT POST SHALL EXTEND FROM THE BOTTOM OF THE SLIP BASE UPPER ASSEMBLY TO 4" BELOW THE BOTTOM OF THE SIGN. THE INSERT POST SHALL NOT EXTEND ABOVE THE BOTTOM OF THE SIGN. PAYMENT FOR THE INSERT POST SHALL BE PER LINEAR FOOT OF TYPE 9 POST.


GROUND MOUNTED BREAKAWAY SIGN SUPPORT WILL BE MEASURED AND PAID FOR SEPARATELY. THE COST FOR THIS WORK SHALL INCLUDE THE UPPER AND LOWER ASSEMBLY, STUB POST, CLASS "A" CONCRETE, ALL HARDWARE NECESSARY TO COMPLETE THE INSTALLATION, AND BE INCLUDED IN THE BID PRICE SUBMITTED FOR ITEM 636-3010.

DATE	REVISIONS	GEORGIA DEPARTMENT OF TRANSPORTATION OFFICE OF TRAFFIC SAFETY & DESIGN
		TYPE 7, 8, AND 9 SQUARE TUBE POST INSTALLATION DETAIL
		NO SCALE JULY 2002


STATE	PROJECT NUMBER	SHEET NO.	TOTAL SHEETS
GA.			

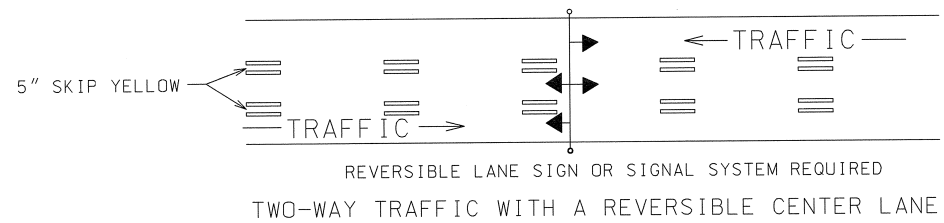


REVERSIBLE LANE SIGN OR SIGNAL SYSTEM REQUIRED
TWO-WAY TRAFFIC WITH A REVERSIBLE CENTER LANE

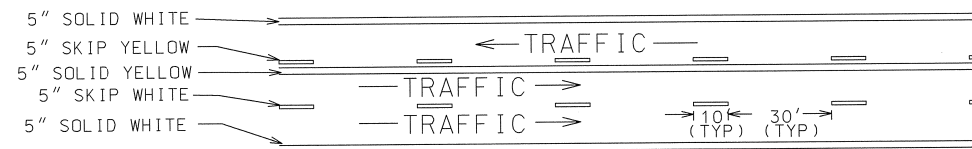


TWO-WAY TRAFFIC WHERE MOTORISTS IN A SINGLE LANE ARE PERMITTED TO PASS

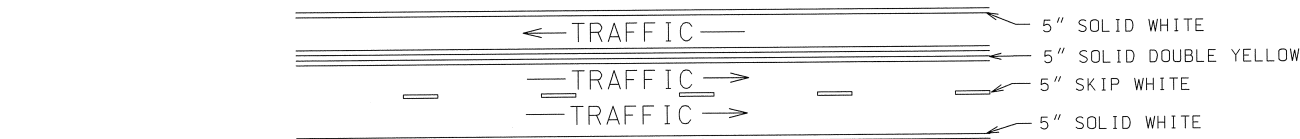


TWO-WAY TRAFFIC WHERE MOTORISTS IN A SINGLE LANE ARE NOT PERMITTED TO PASS

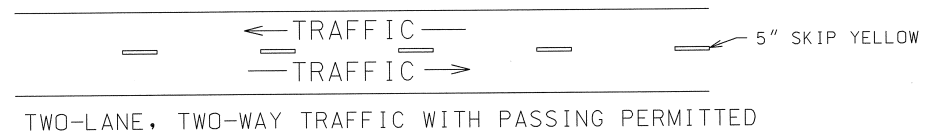

TWO-LANE, TWO-WAY TRAFFIC WITH PASSING PERMITTED

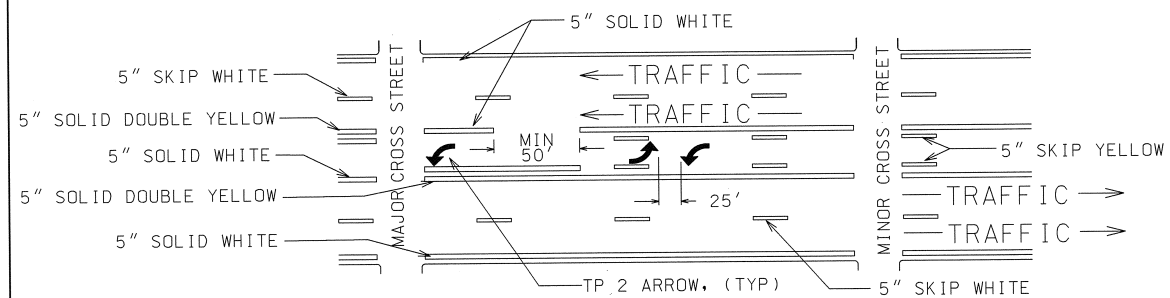


MULTI-LANE, TWO-WAY TRAFFIC WITH SINGLE LANE, TWO-WAY LEFT TURN CHANNELIZATION

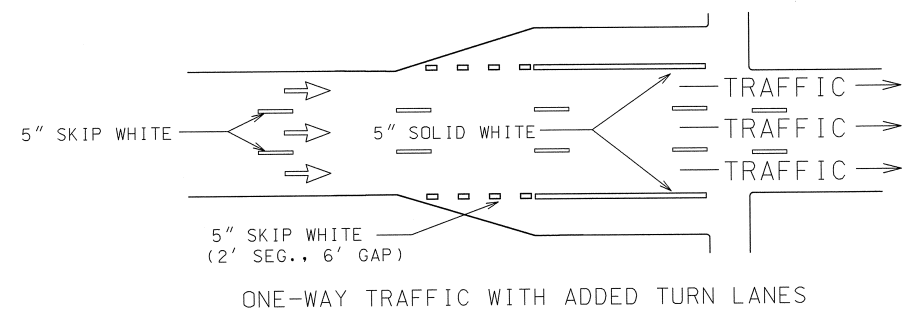


ONE-WAY TRAFFIC WITH ADDED TURN LANES

GENERAL NOTES:


1. SPACING BETWEEN DOUBLE LINES SHALL BE EQUAL TO THE LINE WIDTH.
2. EDGE LINES SHALL BE PLACED A MINIMUM OF 4 INCHES FROM THE NORMAL EDGE OF PAVEMENT.

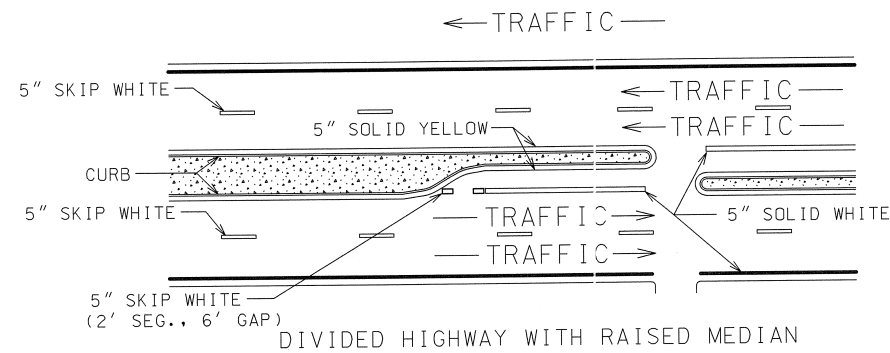

DIVIDED HIGHWAY WITH RAISED MEDIAN

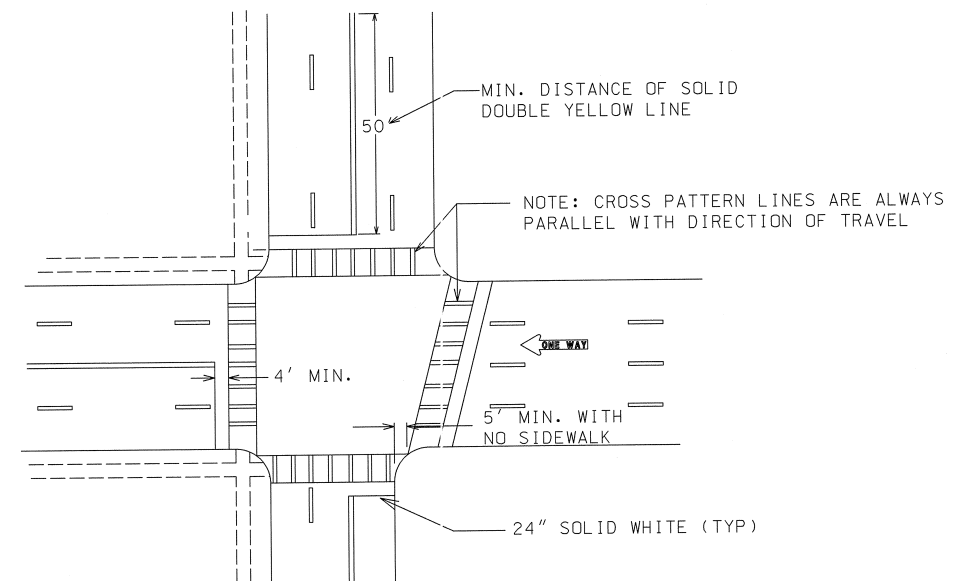

TYPICAL LOCATION OF CROSSWALKS AND STOP BARS

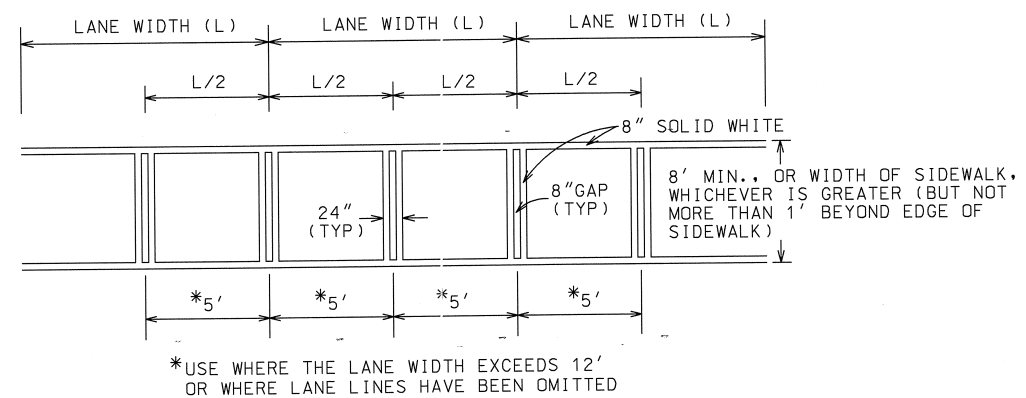

*USE WHERE THE LANE WIDTH EXCEEDS 12' OR WHERE LANE LINES HAVE BEEN OMITTED


CROSSWALK DETAIL

DATE	REVISIONS	GEORGIA DEPARTMENT OF TRANSPORTATION OFFICE OF TRAFFIC SAFETY & DESIGN
		DETAILS OF PAVEMENT MARKING PLACEMENT NON-LIMITED ACCESS ROADWAY
		NO SCALE
		JANUARY 2000

STATE	PROJECT NUMBER	SHEET NO.	TOTAL SHEETS
GA.			


RAISED EDGE WITH CONCRETE GUTTER

FACE OF CURB MUST ALIGN WITH BACK EDGE OF GUARDRAIL AND THE FACE OF THE OFFSET BLOCK.

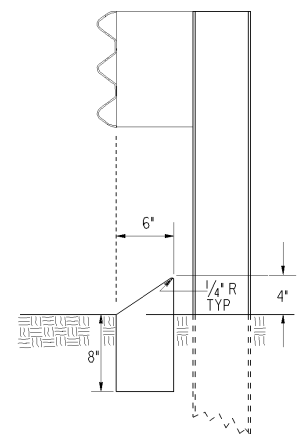

TYPE 8

TYPE 8 CURB IS USED IN CONJUNCTION WITH GUARDRAIL CONNECTIONS TO CONCRETE BARRIER AS NOTED ON GA. STD. 4012C.

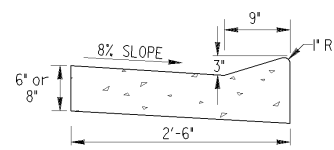


SCALE: 1" = 1 FT.

RAISED EDGE TO BE CONSTRUCTED WITH SAME CONCRETE MIX AS THE GUTTER AND SHALL BE FORMED MONOLITHIC WITH GUTTER. JOINTS IN RAISED EDGE SHALL MATCH THOSE IN THE GUTTER.

CONCRETE MEDIAN (Between Curbs)

NOTE: CURB TYPES SHOWN ARE TYPICAL. OTHER TYPES MAY BE SPECIFIED.

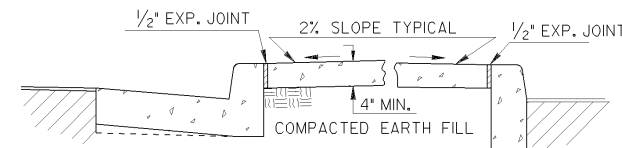


SCALE: 3/4" = 1 FT.

NOTE: WIDTH OF CONCRETE MEDIAN WILL BE AS SHOWN IN PLANS


CONCRETE MEDIANS (Integral)

SCALE: 1" = 1 FT.

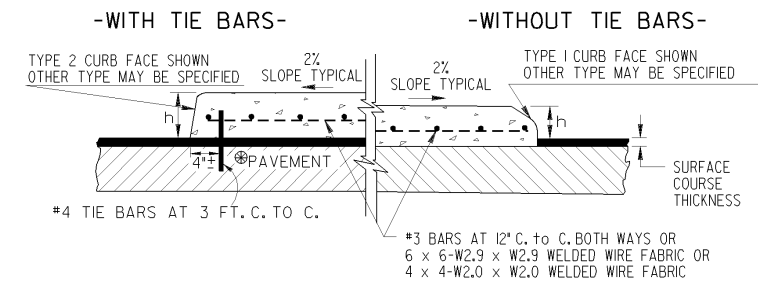


NOTE: IF FINAL SURFACE COURSE IN PRESENT OR MUST BE INSTALLED BEFORE THE CONCRETE MEDIAN CAN BE INSTALLED, THEN DOWELED IN CONCRETE MEDIAN IS REQUIRED.

CONCRETE HEADER CURBS




TYPE 1


CURB TYPE	h	d
1	4"	6" min.
2	6"	8" min.
3	8"	10" min.
4	10"	12" min.
6	6"	7" min.
7	6"	8" min.
9	4"	8" min.




TYPE 2, 3 OR 4

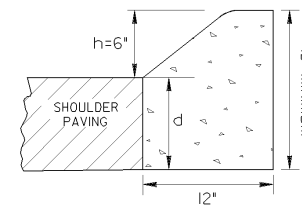

TYPE 6



TYPE 7

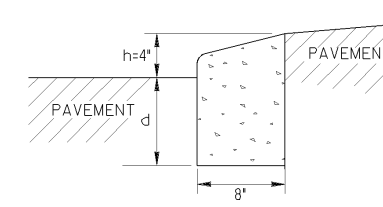


TYPE 9
TRUCK APRON
IN ROUNDABOUTS

THE DIMENSION d MAY BE INCREASED AT CONTRACTOR'S OPTION SO BOTTOM OF HEADER CURB WILL ALIGN WITH BOTTOM OF PAVEMENT TYPICAL SECTION.

SCALE: 1/2" = 1 FT.

CONCRETE DOWELED INTEGRAL CURBS

SCALE: 1" = 1 FT.

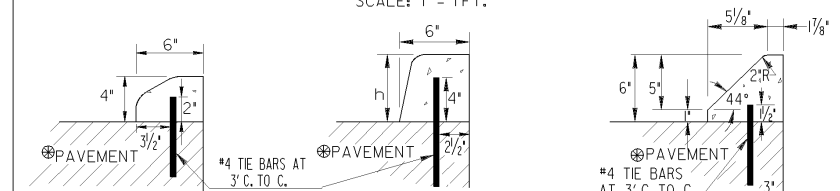


- NOTES:
- CONCRETE CURB CAN BE INSTALLED AFTER INITIAL SET AS LONG AS TIE BARS ARE DRILLED INTO UNDERLYING CONCRETE PAVEMENT.
 - CONCRETE CURB CAN BE INSTALLED BEFORE INITIAL SET WITH DOWELS THAT ARE DRIVEN INTO UNDERLYING CONCRETE PAVEMENT.
 - JOINTS IN CURB AND CONCRETE MEDIAN WILL MATCH THOSE IN THE CONCRETE PAVEMENT.
 - ALL TYPES OF CONCRETE CURB CAN BE PLACED ON ASPHALT PAVEMENTS WHERE TIE BARS MAY BE EITHER DRIVEN OR DRILLED INTO THE UNDERLYING PAVEMENT. CONTRACTION JOINTS SHALL BE CONSTRUCTED IN CURB OR CONCRETE MEDIAN AT 20 FT. SPACING.

CURB TYPE	MINIMUM TIE BAR LENGTHS (FOR CONC. DOWELED CURBS OR CONC. MEDIAN)	
	P.C. CONC. PAV.	ASPHALT PAV.
1	6"	8"
2, 3 or 4	8"	12"
7	6"	8"

NOTE: TIE BARS FOR DOWELED CURBS MAY BE UNCOATED PLAIN OR DEFORMED BILLET-STEEL BARS (GRADE 40) AS USED FOR CONCRETE REINFORCEMENT. (AASHTO M-31)

DETAILS OF RECESSED CURB FOR DRIVEWAYS

NO SCALE

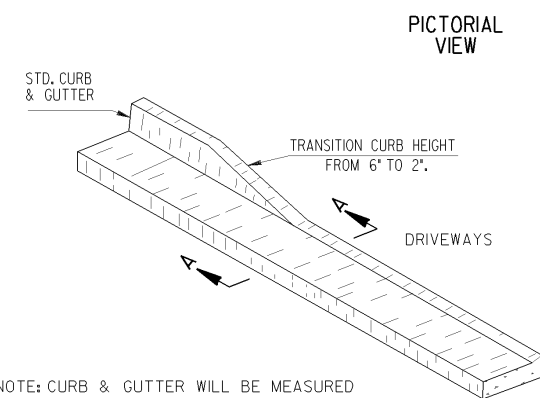


NOTE: CURB & GUTTER WILL BE MEASURED FOR PAYMENT THRU THE DRIVE



SECTIONAL VIEW
SECTION A-A

(SEE SEPARATE CONSTRUCTION DETAILS FOR DRIVEWAYS)

CONCRETE CURB & GUTTER

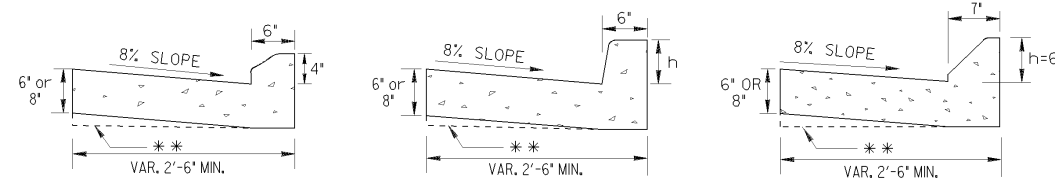

TYPE 1


TYPE 2, 3 OR 4

TYPE 7


** AT CONTRACTOR'S OPTION THE GUTTER THICKNESS MAY BE INCREASED AT EDGE OF PAVEMENT TO MAKE BOTTOM OF GUTTER PARALLEL WITH PAVING OF BASE COURSE, BUT THE GUTTER THICKNESS MUST NOT BE LESS THAN THE SPECIFIED 6" OR 8" AT ANY POINT.

SCALE: 1" = 1 FT.


CURB FACE DESIGN




TYPE 1




TYPE 2, 3 OR 4



TYPE 6




TYPE 7




TYPE 9

SCALE: 2" = 1 FT.

CONCRETE INTEGRAL CURB

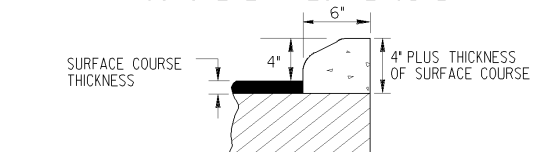

TYPE 1

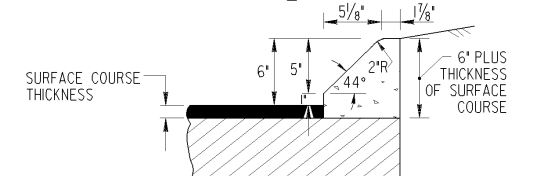


TYPE 7

SCALE: 1/2" = 1 FT.

DEPARTMENT OF TRANSPORTATION STATE OF GEORGIA			
STANDARD CONCRETE CURB & GUTTER CONCRETE CURBS, CONCRETE MEDIANS			
REV. TYPE 9 CURB DETAIL & REV. OVERALL LAYOUT	11-15-11	DATE	
REV. MEDIAN NOTE AND ADDED TYPE 9 CURB DETAIL	1-27-11	DATE	
ADDED TYPE 9 CURB DETAIL	3-03	DATE	
BY	REVISION	DATE	
DES. _____	(SUBMITTED) <i>[Signature]</i>	NUMBER	9032B
DRW. _____	STATE DESIGN POLICY ENGINEER		
TRA. _____	(APPROVED) <i>[Signature]</i>	CHIEF ENGINEER	
CHK. _____			

SCALE: AS SHOWN REVISED AND REDRAWN OCT. 2011

STATE	PROJECT NUMBER	SHEET NO.	TOTAL SHEETS
GA.			

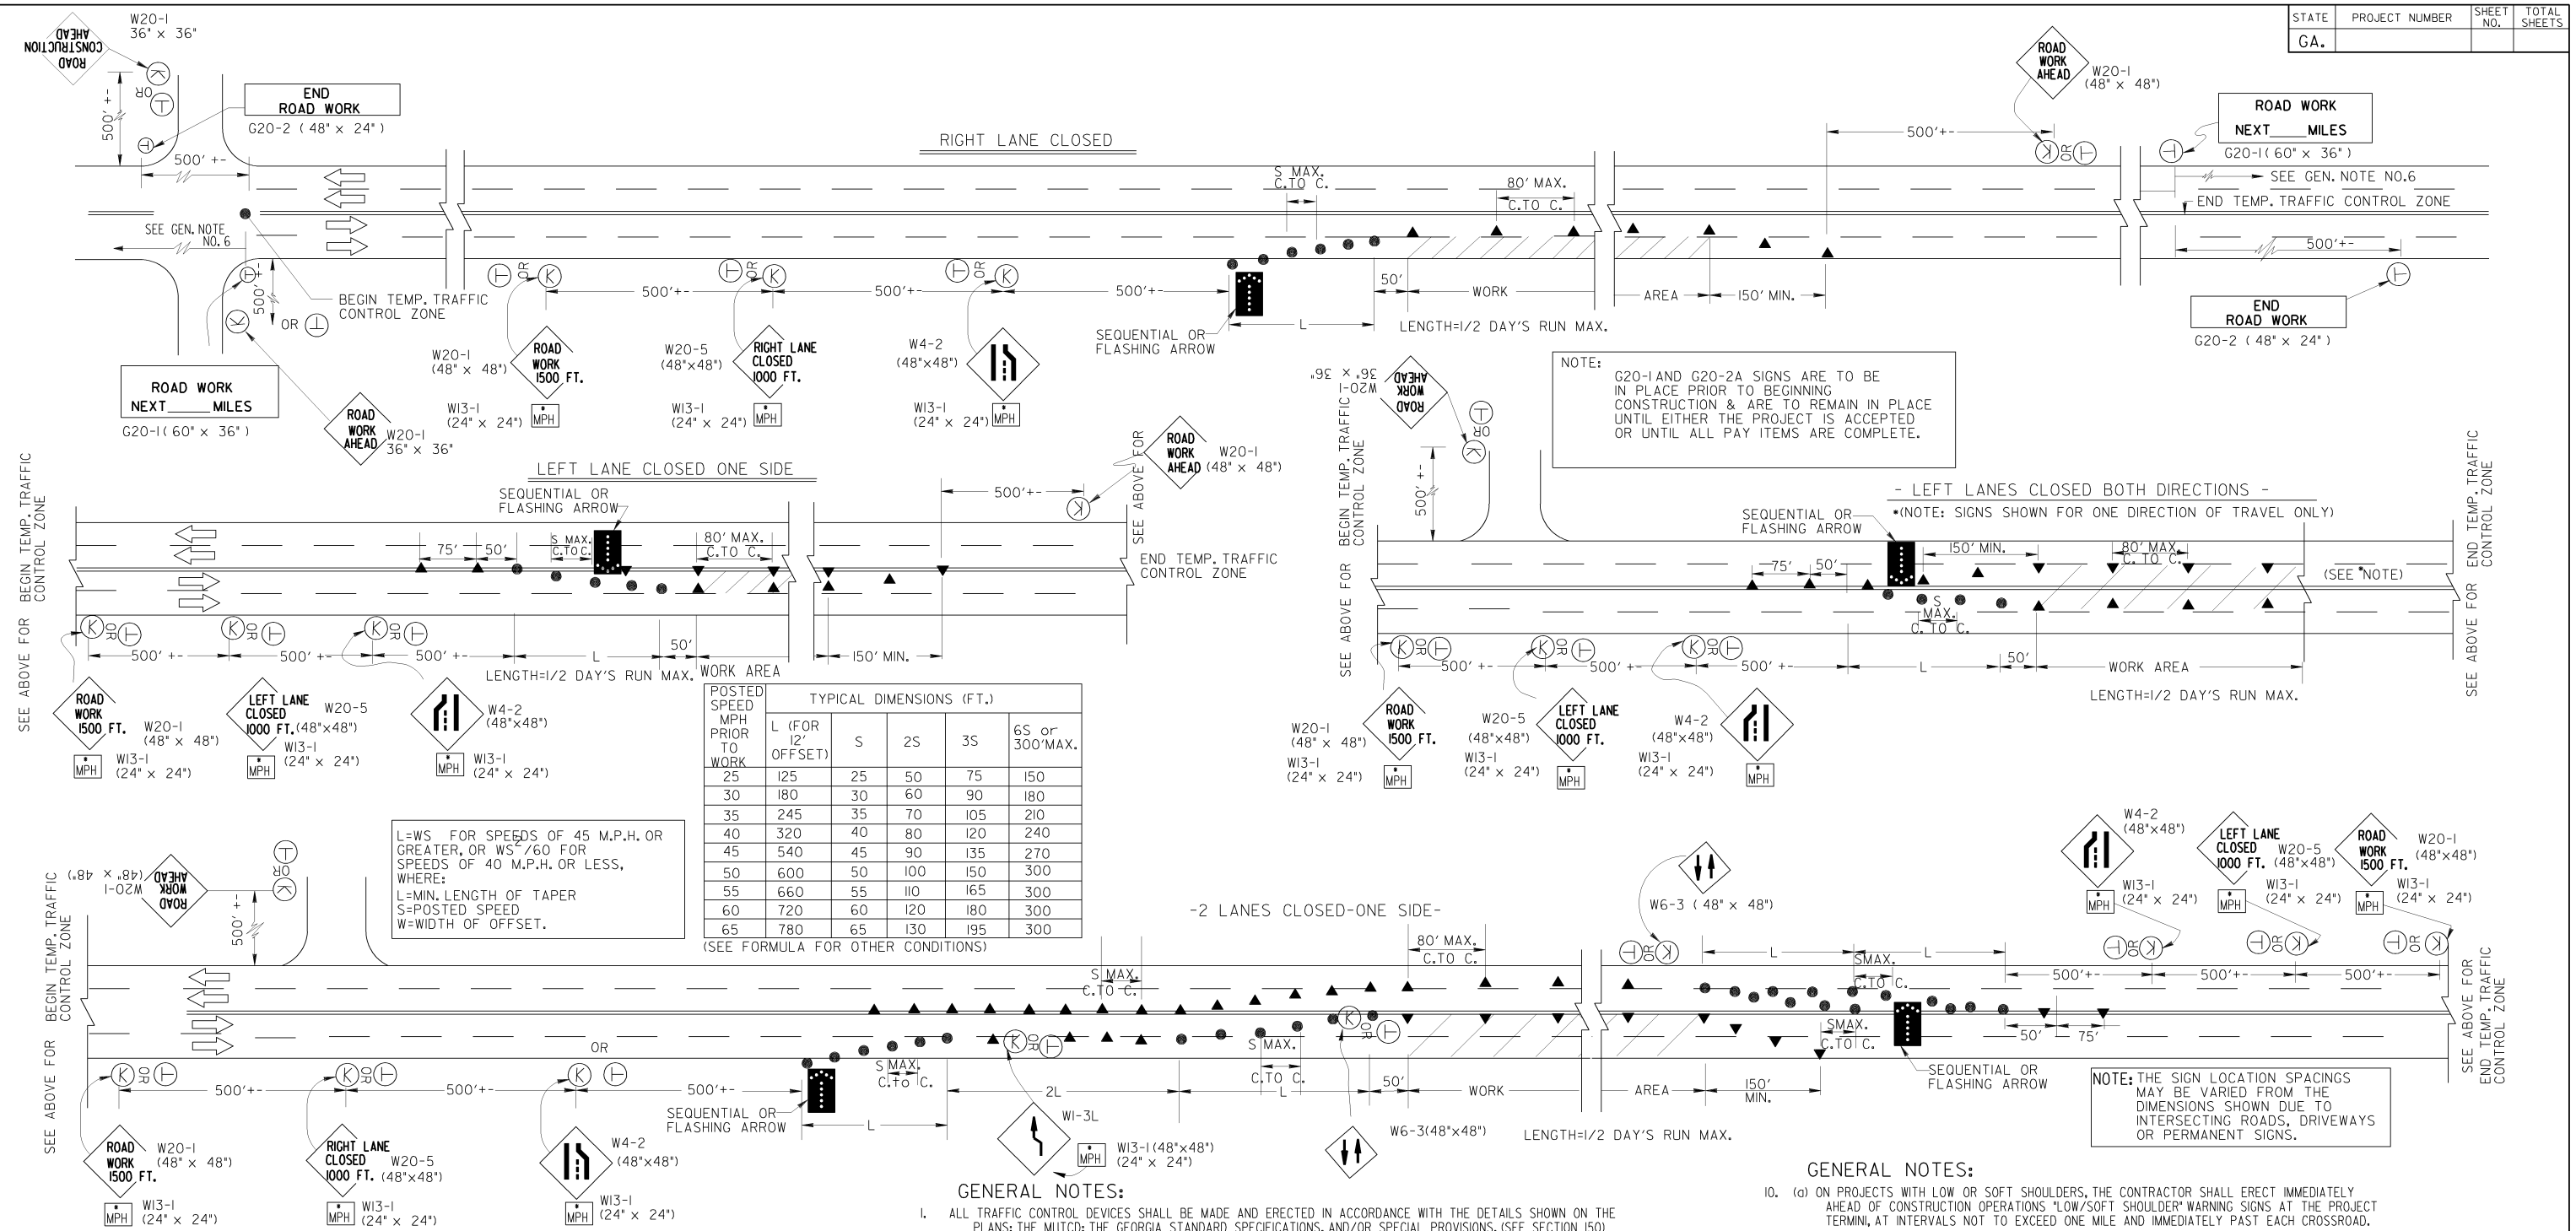


FOR LOCATIONS ON THIS PROJECT INVOLVING ADDED TURN LANES, THE DISTRICT TRAFFIC OPERATIONS OFFICE WILL FURNISH A SCHEMATIC DRAWING OF THE TEMPORARY PAVEMENT MARKINGS AT THE PRE-CONSTRUCTION CONFERENCE.

WHEN TEMPORARY OPERATING SPEEDS ARE LESS THAN THE POSTED SPEED LIMIT, THE ADVISORY SPEED PLATES (W3-I) SHALL BE USED IN 10 M.P.H. INCREMENTS, UNTIL THE SPEED IS REDUCED TO THE TEMPORARY OPERATING SPEED.

STANDARD LEGEND

- STRIPED DRUM
- ⊕ TEMPORARY POST MOUNTED SIGN (OFF SHOULDER) --FOR LONG TERM LANE CLOSURE SUCH AS STATIONARY OPERATIONS, BRIDGE WIDENING PROJECTS ETC. - (7' MOUNT HEIGHT)
- Ⓚ PORTABLE MOUNTED SIGN (ON SHOULDER) --FOR SHORT TERM LANE CLOSURE SUCH AS MOVING OPERATIONS, RESURFACING PROJECTS, ETC. (SEE GENERAL NOTE, NO. 3)
- ▲ TRAFFIC CONE - 28" MIN. (DAYTIME USE ONLY)
- ▬ SEQUENTIAL OR FLASHING ARROW
- ▨ WORK AREA

DETAIL OF TEMPORARY TRAFFIC STRIPE

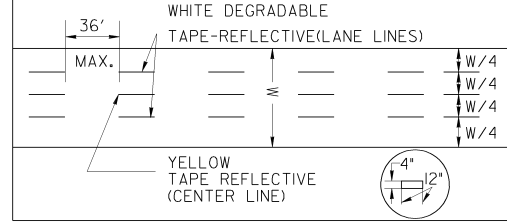

DEPARTMENT OF TRANSPORTATION
STATE OF GEORGIA

STANDARD TRAFFIC CONTROL DETAIL
FOR LANE CLOSURE ON MULTI-LANE UNDIVIDED HIGHWAY

NO SCALE REV. & REDR. JULY, 1999

REVISED	DATE	BY	CHK.
3-30-06			
REMOVED FLAGS AND REV. GENERAL NOTES, REV. SIGN			
G20-2A TO G20-2			

DES. (SUBMITTED) *[Signature]*
STATE ROAD & AIRPORT DESIGN ENGINEER

TRA. (APPROVED) *[Signature]*
CHIEF ENGINEER

NUMBER 9107

PRIMARY PERMITEE:
 CITY OF ROSWELL
 STEVE ACENBRAK
 38 HILL STREET, SUITE 235
 ROSWELL GA, 30076
 770-594-6510



ESPCP GENERAL NOTES

I certify under penalty of law that this Plan was prepared after a site visit to the locations described herein by myself or my authorized agent, under my supervision.

The escape of sediment from the site shall be prevented by the installation of erosion and sedimentation control measures and practices prior to, or concurrent with, land-disturbing activities.

Erosion and sedimentation control measures will be maintained at all times during this project. If full implementation of this approved plan does not provide effective erosion and sedimentation control, additional erosion and sedimentation control measures shall be implemented to control or treat the sediment source.

Any disturbed area left exposed for a period greater than 14 days shall be stabilized with mulch or temporary seeding.

The receiving waters for this project is the Big Creek. The stream buffers are not impacted by this project.

The total disturbed area for this project is 0.19 acres. A Notice of Intent (NOI) is not required.

The Runoff Coefficient of the disturbed area before construction activities ("C Before") is 0.70
 The Runoff Coefficient of the disturbed area after construction activities ("C After") is 0.66

The main construction activities involved in this project include grading, paving, and reestablishment of permanent grassing in the disturbed area.

Non-exempt activities shall not be conducted within the 25 or 50-foot undisturbed stream buffers as measured from the point of wretched vegetation without first acquiring the necessary variances and permits.

SOIL SERIES INFORMATION

The following is a summary of the soils that are expected to be found on the project site:

MAP UNIT SYMBOL	MAP UNIT NAME
Ub	Urban land
UmC2	Urban land-Madison-Bethlehem complex, 2-10% slopes, moderately eroded

Due to the size and scope of this project and the nature of soil series maps, it is not reasonably practical to delineate the precise locations of the above listed soils on the construction plans. The NRCS soil survey and soil series maps for the project site are also available online at <http://websoilsurvey.nrcs.usda.gov/>.

CONTOUR DISPLAY AND WATERSHED NOTE:

Due to the size and scope of this project, it is not practical to display the existing and proposed contour lines in the project vicinity on a USGS 1":2000' topographical sheet. The existing and proposed contours are shown with greater clarity on sheet 54-001 at 1":20' scale.

VEGETATION AND PLANTING SCHEDULE

All temporary and permanent vegetative practices including plant species, planting dates, seeding, fertilizing, liming and mulching for this project can be found in section 700 of the current edition of the Department's Standard Specifications (or Special Provisions) and other applicable contract documents, or landscaping plans.

PETROLEUM STORAGE, SPILLS AND LEAKS

These plans expressly delegate the responsibility of proper on-site hazardous material management to the Contractor. The Contractor shall at a minimum provide an action plan and keep the necessary materials on site for the capture, clean up, and disposal of any petroleum product, or other hazardous material, leaks or spills associated with the servicing, refueling or operation of any equipment utilized at the site. A copy of the action plan shall be submitted to the Project Engineer and maintained on the project site. All personnel operating or servicing equipment shall be familiar with the action plan. The Contractor shall not park, refuel, or maintain equipment within stream buffers.

EROSION, SEDIMENTATION & POLLUTION CONTROL PLAN CHECKLIST
INFRASTRUCTURE CONSTRUCTION PROJECTS

SWCD: District 4 - Fulton County

Project Name: Oxbo One-Way Pair Address: Oxbo Drive, Roswell, GA 30075

City/County: Roswell/Fulton Date on Plans: 2/5/2016

Plan Page #	Included Y/N	TO BE SHOWN ON ES&PC PLAN	Plan Page #	Included Y/N	TO BE SHOWN ON ES&PC PLAN
51-001	Y	2 Level II certification number issued by the Commission, signature and seal of the certified design professional. (Signature, seal and Level II number must be on each sheet pertaining to ES&PC Plan or the Plan will not be reviewed)		N/A	27 Description of the practices that will be used to reduce the pollutants in storm water discharges.*
51-001	Y	3 The name and phone number of the 24-hour local contact responsible for erosion, sedimentation and pollution controls.	51-001	Y	28 Description and chart or timeline of the intended sequence of major activities which disturb soils for the major portions of the site (i.e., initial perimeter and sediment storage BMPs, clearing and grubbing activities, excavation activities, utility activities, temporary and final stabilization).
51-001	Y	4 Provide the name, address and phone number of primary permittee.		N/A	29 Provide complete requirements of inspections and record keeping by the primary permittee.*
51-001	Y	5 Note total and disturbed acreage of the project or phase under construction.		N/A	30 Provide complete requirements of sampling frequency and reporting of sampling results.*
51-001	Y	6 Provide the GPS locations of the beginning and end of the Infrastructure project. Give the Latitude and Longitude in decimal degrees.		N/A	31 Provide complete details for retention of records as per Part IV.F. of the permit.*
51-001	Y	7 Initial date of the Plan and the dates of any revisions made to the Plan including the entity who requested the revisions.		N/A	32 Description of analytical methods to be used to collect and analyze the samples from each location.*
51-001	Y	8 Description of the nature of construction activity.		N/A	33 Appendix B rationale for NTU values at all outfall sampling points where applicable.*
01-001	Y	9 Provide vicinity map showing site's relation to surrounding areas. Include designation of specific phase, if necessary.		N/A	34 Delineate all sampling locations, perennial and intermittent streams and other water bodies into which storm water is discharged also provide a summary chart of the justification and analysis for the representative sampling as applicable.*
	N/A	10 Identify the project receiving waters and describe all sensitive adjacent areas including streams, lakes, residential areas, wetlands, marshlands, etc. which may be affected.		N/A	35 A description of appropriate controls and measures that will be implemented at the construction site including: (1) initial sediment storage requirements and perimeter control BMPs, (2) intermediate grading and drainage BMPs, and (3) final BMPs. For construction sites where there will be no mass grading and the initial perimeter control BMPs, intermediate grading and drainage BMPs, and final BMPs are the same, the plan may combine all of the BMPs into a single phase.*
51-001	Y	11 Design professional's certification statement and signature that the site was visited prior to development of the ES&PC Plan as stated on page 15 of the permit.		Y	36 Graphic scale and North arrow.
	N/A	12 Design professional's certification statement and signature that the permittee's ES&PC Plan provides for an appropriate and comprehensive system of BMPs and sampling to meet permit requirements as stated on page 15 of the permit.*	54-001	Y	37 Existing and proposed contour lines with contour lines drawn at an interval in accordance with the following: Existing Contours USGS 1":2000' Topographical Sheets Proposed Contours 1":400' Centerline Profile
	N/A	13 Design professional certification statement and signature that the permittee's ES&PC Plan provides for representative sampling as stated on page 26 of permit as applicable.*	54-001	Y	38 Use of alternative BMPs whose performance has been documented to be equivalent to or superior to conventional BMPs as certified by a Design Professional (unless disapproved by EPD or the Georgia Soil and Water Conservation Commission). Please refer to the Alternative BMP Guidance Document found at www.gaswcc.org .
	N/A	14 Clearly note the statement that "The design professional who prepared the ES&PC Plan is to inspect the installation of the initial sediment storage requirements, perimeter control BMPs, and sediment basins in accordance with part IV.A.5. within 7 days after installation.**"		N/A	39 Use of alternative BMP for application to the Equivalent BMP List. Please refer to Appendix A-2 of the Manual for Erosion & Sediment Control in Georgia 2016 Edition.*
	N/A	15 Clearly note the statement that "Non-exempt activities shall not be conducted within the 25 or 50-foot undisturbed stream buffers as measured from the point of wretched vegetation or within 25-foot of the coastal marshland buffer as measured from the Jurisdictional Determination Line without first acquiring the necessary variances and permits."		N/A	40 Delineation of the applicable 25-foot or 50-foot undisturbed buffers adjacent to State waters and any additional buffers required by the Local Issuing Authority. Clearly note and delineate all areas of impact.
	N/A	16 Provide a description of any buffer encroachments and indicate whether a buffer variance is required.		N/A	41 Delineation of on-site wetlands and all State waters located on and within 200 feet of the project site.
	N/A	17 Clearly note the statement that "Amendments/revisions to the ES&PC Plan which have a significant effect on BMPs with a hydraulic component must be certified by the design professional.**"		N/A	42 Delineation and acreage of contributing drainage basins on the project site.
	N/A	18 Clearly note the statement that "Waste materials shall not be discharged to waters of the State, except as authorized by a section 404 permit.**"		N/A	43 Delineate on-site drainage and off-site watersheds using USGS 1" :2000' topographical sheets.
51-001	Y	19 Clearly note statement that "The escape of sediment from the site shall be prevented by the installation of erosion and sediment control measures and practices prior to land disturbing activities."	51-001	Y	44 An estimate of the runoff coefficient or peak discharge flow of the site prior to and after construction activities are completed.
51-001	Y	20 Clearly note statement that "Erosion control measures will be maintained at all times. If full implementation of the approved Plan does not provide for effective erosion control, additional erosion and sediment control measures shall be implemented to control or treat the sediment source."		N/A	45 Storm-drain pipe and weir velocities with appropriate outlet protection to accommodate discharges without erosion. Identify/Delineate all storm water discharge points.
51-001	Y	21 Clearly note the statement "Any disturbed area left exposed for a period greater than 14 days shall be stabilized with mulch or temporary seeding."	54-001	Y	46 Soil series for the project site and their delineation.
	N/A	22 Any construction activity which discharges storm water into an Impaired Stream Segment or within 1 linear mile upstream of and within the same watershed as, any portion of an Impaired Stream Segment must comply with Part III. C. of the Permit. Include the completed Appendix 1 listing all the BMPs that will be used for those areas of the site which discharge to the Impaired Stream Segment.*	54-001	Y	47 The limits of disturbance for each phase of construction.
	N/A	23 If a TMDL Implementation Plan for sediment has been finalized for the Impaired Stream Segment (identified in item 22 above) at least six months prior to submittal of NOI, the ES&PC Plan must address any site-specific conditions or requirements included in the TMDL Implementation Plan.*		N/A	48 Provide a minimum of 67 cubic yards of sediment storage per acre drained using a temporary sediment basin, rerouted detention pond, and/or excavated inlet sediment traps for each common drainage location. Sediment storage volume must be in place prior to and during all land disturbance activities until final stabilization of the site has been achieved. A written justification explaining the decision to use equivalent controls when a sediment basin is not attainable must be included in the plan for each common drainage location in which a sediment basin is not provided. A written justification as to why 67 cubic yards of storage is not attainable must also be given. Worksheets from the Manual must be included for structural BMPs and all calculations used by the design professional to obtain the required sediment storage when using equivalent controls. When discharging from sediment basins and impoundments, permittees are required to utilize outlet structures that withdraw water from the surface, unless infeasible. If outlet structures that withdraw water from the surface are not feasible, a written justification explaining this decision must be included in the plan.
	N/A	24 BMPs for concrete washdown of tools, concrete mixer chutes, hoppers and the rear of the vehicles. Washout of the drum at the construction site is prohibited.*		Y	49 Location of Best Management Practices that are consistent with and no less stringent than the Manual for Erosion and Sediment Control in Georgia. Use uniform coding symbols from the Manual, Chapter 6, with legend.
54-001	Y	25 Provide BMPs for the remediation of all petroleum spills and leaks.	54-001	Y	50 Provide detailed drawings for all structural practices. Specifications must, at a minimum, meet the guidelines set forth in the Manual for Erosion and Sediment Control in Georgia.
	N/A	26 Description of the measures that will be installed during the construction process to control pollutants in storm water that will occur after construction operations have been completed.*	51-001	Y	51 Provide vegetative plan, noting all temporary and permanent vegetative practices. Include species, planting dates and seeding, fertilizer, lime and mulching rates. Vegetative plan shall be site specific for appropriate time of year that seeding will take place and for the appropriate geographic region of Georgia.

*If using this checklist for a project that is less than 1 acre and not part of a common development but within 200 ft of a perennial stream the * checklist items would be N/A. Effective January 1, 2016

24 HOUR CONTACT:
 JOE VITALE
 770-594-6105











GREGORY J. NICOLAS
 GSWCC LEVEL II CERTIFICATION
 NUMBER 000065865











REVISION DATES

ESPCP GENERAL NOTES

CHECKED:	DATE:	DRAWING No.
BACKCHECKED:	DATE:	51-001
CORRECTED:	DATE:	
VERIFIED:	DATE:	











CODE	PRACTICE STD : SPC'S : SECTION	DETAIL	DESCRIPTION
(Dn2-2)	PERMANENT DOWN DRAIN STRUCTURE GA. STD. 9017J TP2, D-26 TP2 SECTION 576, 577.		CONCRETE DRAIN INLET AND METAL PIPE IS USED TO DRAIN CURB, IN A SAG, DOWN TO A LOWER ELEVATION. THIS IS A PERMANENT STRUCTURE, REQUIRING OUTLET PROTECTION, TEMPORARY AND PERMANENT. INLETS SHALL BE SPACED ACCORDING TO GDOT GUIDELINES (REGARDING GUTTER SPREAD AND OR OTHER CRITERIA).
		LINE CODE 	
Ds1	MULCH SECTION 163		THIS IS AN APPLICATION OF STRAW MULCH USED TO REDUCE SOIL EROSION AND STABILIZE THE SOIL. IT IS USED TO CONTROL EROSION IN AREAS WHERE PERMANENT VEGETATION IS OUT OF SEASON OR TO TEMPORARILY STABILIZE AREAS PRIOR TO FINAL GRADING.
		LINE CODE 	
Ds2	TEMPORARY GRASSING SECTION 163		THE SOWING OF A QUICK GROWING SPECIES OF GRASS SUITABLE TO THE AREA AND SEASON IS TO BE USED ON ALL PROJECTS.
		LINE CODE 	
Ds3	PERMANENT GRASSING SECTION 700		THE SOWING OF PERMANENT VEGETATION, SUCH AS GRASS, SUITABLE TO THE AREA AND SEASON IS TO BE USED ON ALL PROJECTS. PERMANENT VEGETATIVE REQUIREMENTS ARE ADDRESSED BY STANDARD SPECIFICATIONS AND ARE NOT TYPICALLY SHOWN ON THE PLANS; HOWEVER, THEY MAY BE SHOWN ON THE PLANS FOR HIGHLY SENSITIVE AREAS WHERE THESE VEGETATIVE PRACTICES ARE CRITICAL.
		LINE CODE 	
Ds4	SODDING SECTION 700		THE INSTALLATION OF A SPECIES OF GRASS SODDING SUITABLE TO THE AREA AND SEASON TO PROVIDE IMMEDIATE PERMANENT VEGETATION. SODDING MAY BE SHOWN FOR HIGHLY SENSITIVE AREAS, TO IMPROVE AESTHETICS, OR FOR SPECIAL PLANTING REQUIREMENTS ON THE BASIS OF ENVIRONMENTAL COMMITMENTS OR LANDSCAPING REQUIREMENTS.
		PATTERN 	









CODE	PRACTICE STD : SPC'S : SECTION	DETAIL	DESCRIPTION
(Fr)	FILTER RING CONSTRUCTION DETAIL		A TEMPORARY STONE BARRIER CONSTRUCTED AT DRAINAGE STRUCTURE INLETS. THIS REDUCES THE VELOCITY OF THE RUNOFF AND FILTERS SEDIMENT FROM THE RUNOFF. SEE CHAPTER 6 OF THE MANUAL FOR EROSION AND SEDIMENT CONTROL IN GEORGIA FOR DESIGN CRITERIA AND DETAILS.
		LINE CODE 	
Mb	EROSION CONTROL MATS CONSTRUCTION DETAIL SECTION 716		ALL CUT OR FILL SLOPES OF 2.5:1 OR STEEPER AND WITHIN 50' OF ALL CROSS DRAINS AND CULVERTS.
		PATTERN 	
(Ps)	PERMANENT SOIL REINFORCING MAT CONSTRUCTION DETAIL SECTION 710		THIS THREE DIMENSIONAL EROSION CONTROL MAT IS USED IN DITCHES TO STABILIZE THE SOIL BY REINFORCING THE GRASS ROOTS TO PROVIDE LONG-TERM PROTECTION FOR SHEAR STRESSES. (THIS IS ALSO CALLED "Mb" IN THE MANUAL FOR EROSION & SEDIMENT CONTROL IN GEORGIA.)
		LINE CODE 	
(Rd)	ROCK FILTER DAM CONSTRUCTION DETAIL SECTION 163, 603.		ROCK FILTER DAMS ARE CONSTRUCTED OF TYPE 3 STONE RIP RAP AND ARE USED TO PROTECT SMALL STREAMS OR DRAINAGEWAYS. TO BE USED IN SMALL DRAINAGE CHANNELS OF 50 ACRES OR LESS. THE RIP RAP SHOULD BE PLACED ON A GEOTEXTILE UNDERLINER.
		LINE CODE 	

NOTE:
 1. DO NOT USE EROSION CONTROL ITEMS IN A FLOWING STREAM OR IN A TIDAL AREA BELOW HIGH TIDE.
 2. FOR ADDITIONAL INFORMATION ON THE DESIGN AND APPLICATION OF EROSION CONTROL MEASURES, SEE THE GEORGIA SOIL AND WATER CONSERVATION COMMISSION, "MANUAL FOR EROSION AND SEDIMENT CONTROL IN GEORGIA".

DEPARTMENT OF TRANSPORTATION STATE OF GEORGIA	
EROSION CONTROL LEGEND AND UNIFORM CODE SHEET SHEET 3 OF 6	
NO SCALE	JANUARY 2007
NUMBER EC-L3	DRAWING NO. 52-003


TC	ISSUED DRAWING NO. 52-003 (2-2-03)
TC	Ds1 & Dn2 COPIES, RELUC. Rd & R-P COPIES TO DRAWING NO. 52-004.
TC	RELOCATED RA, Rn, & R-P CODES FROM ECLCUC SHEET 4 OF 6.
CUO	DELETED F4, REVISED ORDER R13-07
CUO	DELETED F4, REVISED ORDER R13-07
BY	REVISED TITLE BLOCK R13-07
BY	REVISION
BY	DATE

CODE	PRACTICE STD : SPC'S : SECTION	DETAIL	DESCRIPTION
St	STORM DRAIN OUTLET PROTECTION GA. STD. 1125 & 2532	 LINE CODE 	A PIPE OR BOX CULVERT OUTLET HEADWALL WITH AN APRON AND DISSIPATOR BLOCKS IS USED TO PREVENT EROSION AND TO SLOW WATER. IT IS USED ON THE OUTLET OF ALL BOX CULVERTS AND ON 48" AND LARGER PIPES. MAY BE USED ON INLET FOR FLOWING STREAMS. USE ON SMALL PIPES WHEN OUTLET VELOCITY IS 12 fps AND GREATER.
St-Rp	STORM DRAIN OUTLET PROTECTION SECTION 603	 PATTERN 	THIS ITEM IS ADDED TO 'St' WHEN ADDITIONAL PROTECTION IS NEEDED. TYPE 1 RIP RAP PLACED ON FILTER FABRIC SHOULD BE USED AT A 24" THICKNESS. MAY BE USED ON INLETS FOR FLOWING STREAMS. REFER TO CHARTS IN 'MANUAL FOR EROSION AND SEDIMENT CONTROL IN GEORGIA' FOR QUANTITY DETERMINATION.
Su	SURFACE ROUGHENING SERRATED SLOPES CONSTRUCTION DETAIL SECTION 205	 LINE CODE  (LINE CODE Su IS SHOWN ON THE PLANS FOR SERRATED SLOPES WHERE SPECIFIED IN THE SOIL SURVEY.)	PROVIDING A ROUGH SOIL SURFACE WITH HORIZONTAL DEPRESSIONS, BY OPERATING A CLEATED DOZER ON THE SLOPE IN A VERTICAL DIRECTION, CREATING SERRATED SLOPES IN THE GRADING PROCESS TO CONSTRUCT BENCHES WILL REDUCE RUNOFF VELOCITY AND INCREASE INFILTRATION OF WATER. IN MOST CASES THIS ITEM IS NOT REQUIRED TO BE SHOWN ON THE PLANS, BUT REQUIRED TO BE COMPLETED BY THE CONTRACTOR UNDER ALL PROJECTS. IF SERRATED SLOPES ARE USED ON THE PROJECT, THEN THIS ITEM SHALL BE SHOWN WHERE SERRATED SLOPES ARE TO BE USED.
Trm-1	TURF REINFORCEMENT MAT CONSTRUCTION DETAIL SECTION 711	 LINE CODE 	THIS THREE DIMENSIONAL EROSION CONTROL MAT IS USED IN DITCHES TO STABILIZE THE SOIL BY REINFORCING THE GRASS ROOTS TO PROVIDE LONG-TERM PROTECTION FOR SHEAR STRESSES 0-2 psf. (THIS IS ALSO CALLED 'Mb' IN THE MANUAL FOR EROSION & SEDIMENT CONTROL IN GEORGIA.)
Trm-2	TURF REINFORCEMENT MAT CONSTRUCTION DETAIL SECTION 711	 LINE CODE 	THIS THREE DIMENSIONAL EROSION CONTROL MAT IS USED IN DITCHES TO STABILIZE THE SOIL BY REINFORCING THE GRASS ROOTS TO PROVIDE LONG-TERM PROTECTION FOR SHEAR STRESSES 0-4 psf. (THIS IS ALSO CALLED 'Mb' IN THE MANUAL FOR EROSION & SEDIMENT CONTROL IN GEORGIA.)

CODE	PRACTICE STD : SPC'S : SECTION	DETAIL	DESCRIPTION
Trm-3	TURF REINFORCEMENT MAT CONSTRUCTION DETAIL SECTION 711	 LINE CODE 	THIS THREE DIMENSIONAL EROSION CONTROL MAT IS USED IN DITCHES TO STABILIZE THE SOIL BY REINFORCING THE GRASS ROOTS TO PROVIDE LONG TERM PROTECTION FOR SHEAR STRESSES 0-6 psf. (THIS IS ALSO CALLED 'Mb' IN THE MANUAL FOR EROSION & SEDIMENT CONTROL IN GEORGIA.)
Trm-4	TURF REINFORCEMENT MAT CONSTRUCTION DETAIL SECTION 711	 LINE CODE 	THIS THREE DIMENSIONAL EROSION CONTROL MAT IS USED IN DITCHES TO STABILIZE THE SOIL BY REINFORCING THE GRASS ROOTS TO PROVIDE LONG-TERM PROTECTION FOR SHEAR STRESSES 0-8 psf. (THIS IS ALSO CALLED 'Mb' IN THE MANUAL FOR EROSION & SEDIMENT CONTROL IN GEORGIA.)
Trm-5	TURF REINFORCEMENT MAT CONSTRUCTION DETAIL SECTION 711	 LINE CODE 	THIS THREE DIMENSIONAL EROSION CONTROL MAT IS USED IN DITCHES TO STABILIZE THE SOIL BY REINFORCING THE GRASS ROOTS TO PROVIDE LONG-TERM PROTECTION FOR SHEAR STRESSES 0-10 psf. (THIS IS ALSO CALLED 'Mb' IN THE MANUAL FOR EROSION & SEDIMENT CONTROL IN GEORGIA.)
Trm-6	TURF REINFORCEMENT MAT CONSTRUCTION DETAIL SECTION 711	 LINE CODE 	THIS THREE DIMENSIONAL EROSION CONTROL MAT IS USED IN DITCHES TO STABILIZE THE SOIL BY REINFORCING THE GRASS ROOTS TO PROVIDE LONG-TERM PROTECTION FOR SHEAR STRESSES 0-12 psf. (THIS IS ALSO CALLED 'Mb' IN THE MANUAL FOR EROSION & SEDIMENT CONTROL IN GEORGIA.)

NOTE:
 1. DO NOT USE EROSION CONTROL ITEMS IN A FLOWING STREAM OR IN A TIDAL AREA BELOW HIGH TIDE.
 2. FOR ADDITIONAL INFORMATION ON THE DESIGN AND APPLICATION OF EROSION CONTROL MEASURES, SEE THE GEORGIA SOIL AND WATER CONSERVATION COMMISSION, 'MANUAL FOR EROSION AND SEDIMENT CONTROL IN GEORGIA'.

DEPARTMENT OF TRANSPORTATION STATE OF GEORGIA	
EROSION CONTROL LEGEND AND UNIFORM CODE SHEET SHEET 6 OF 6	
NO SCALE	NOV., 2007
NUMBER EC-L6	DRAWING No. 52-006

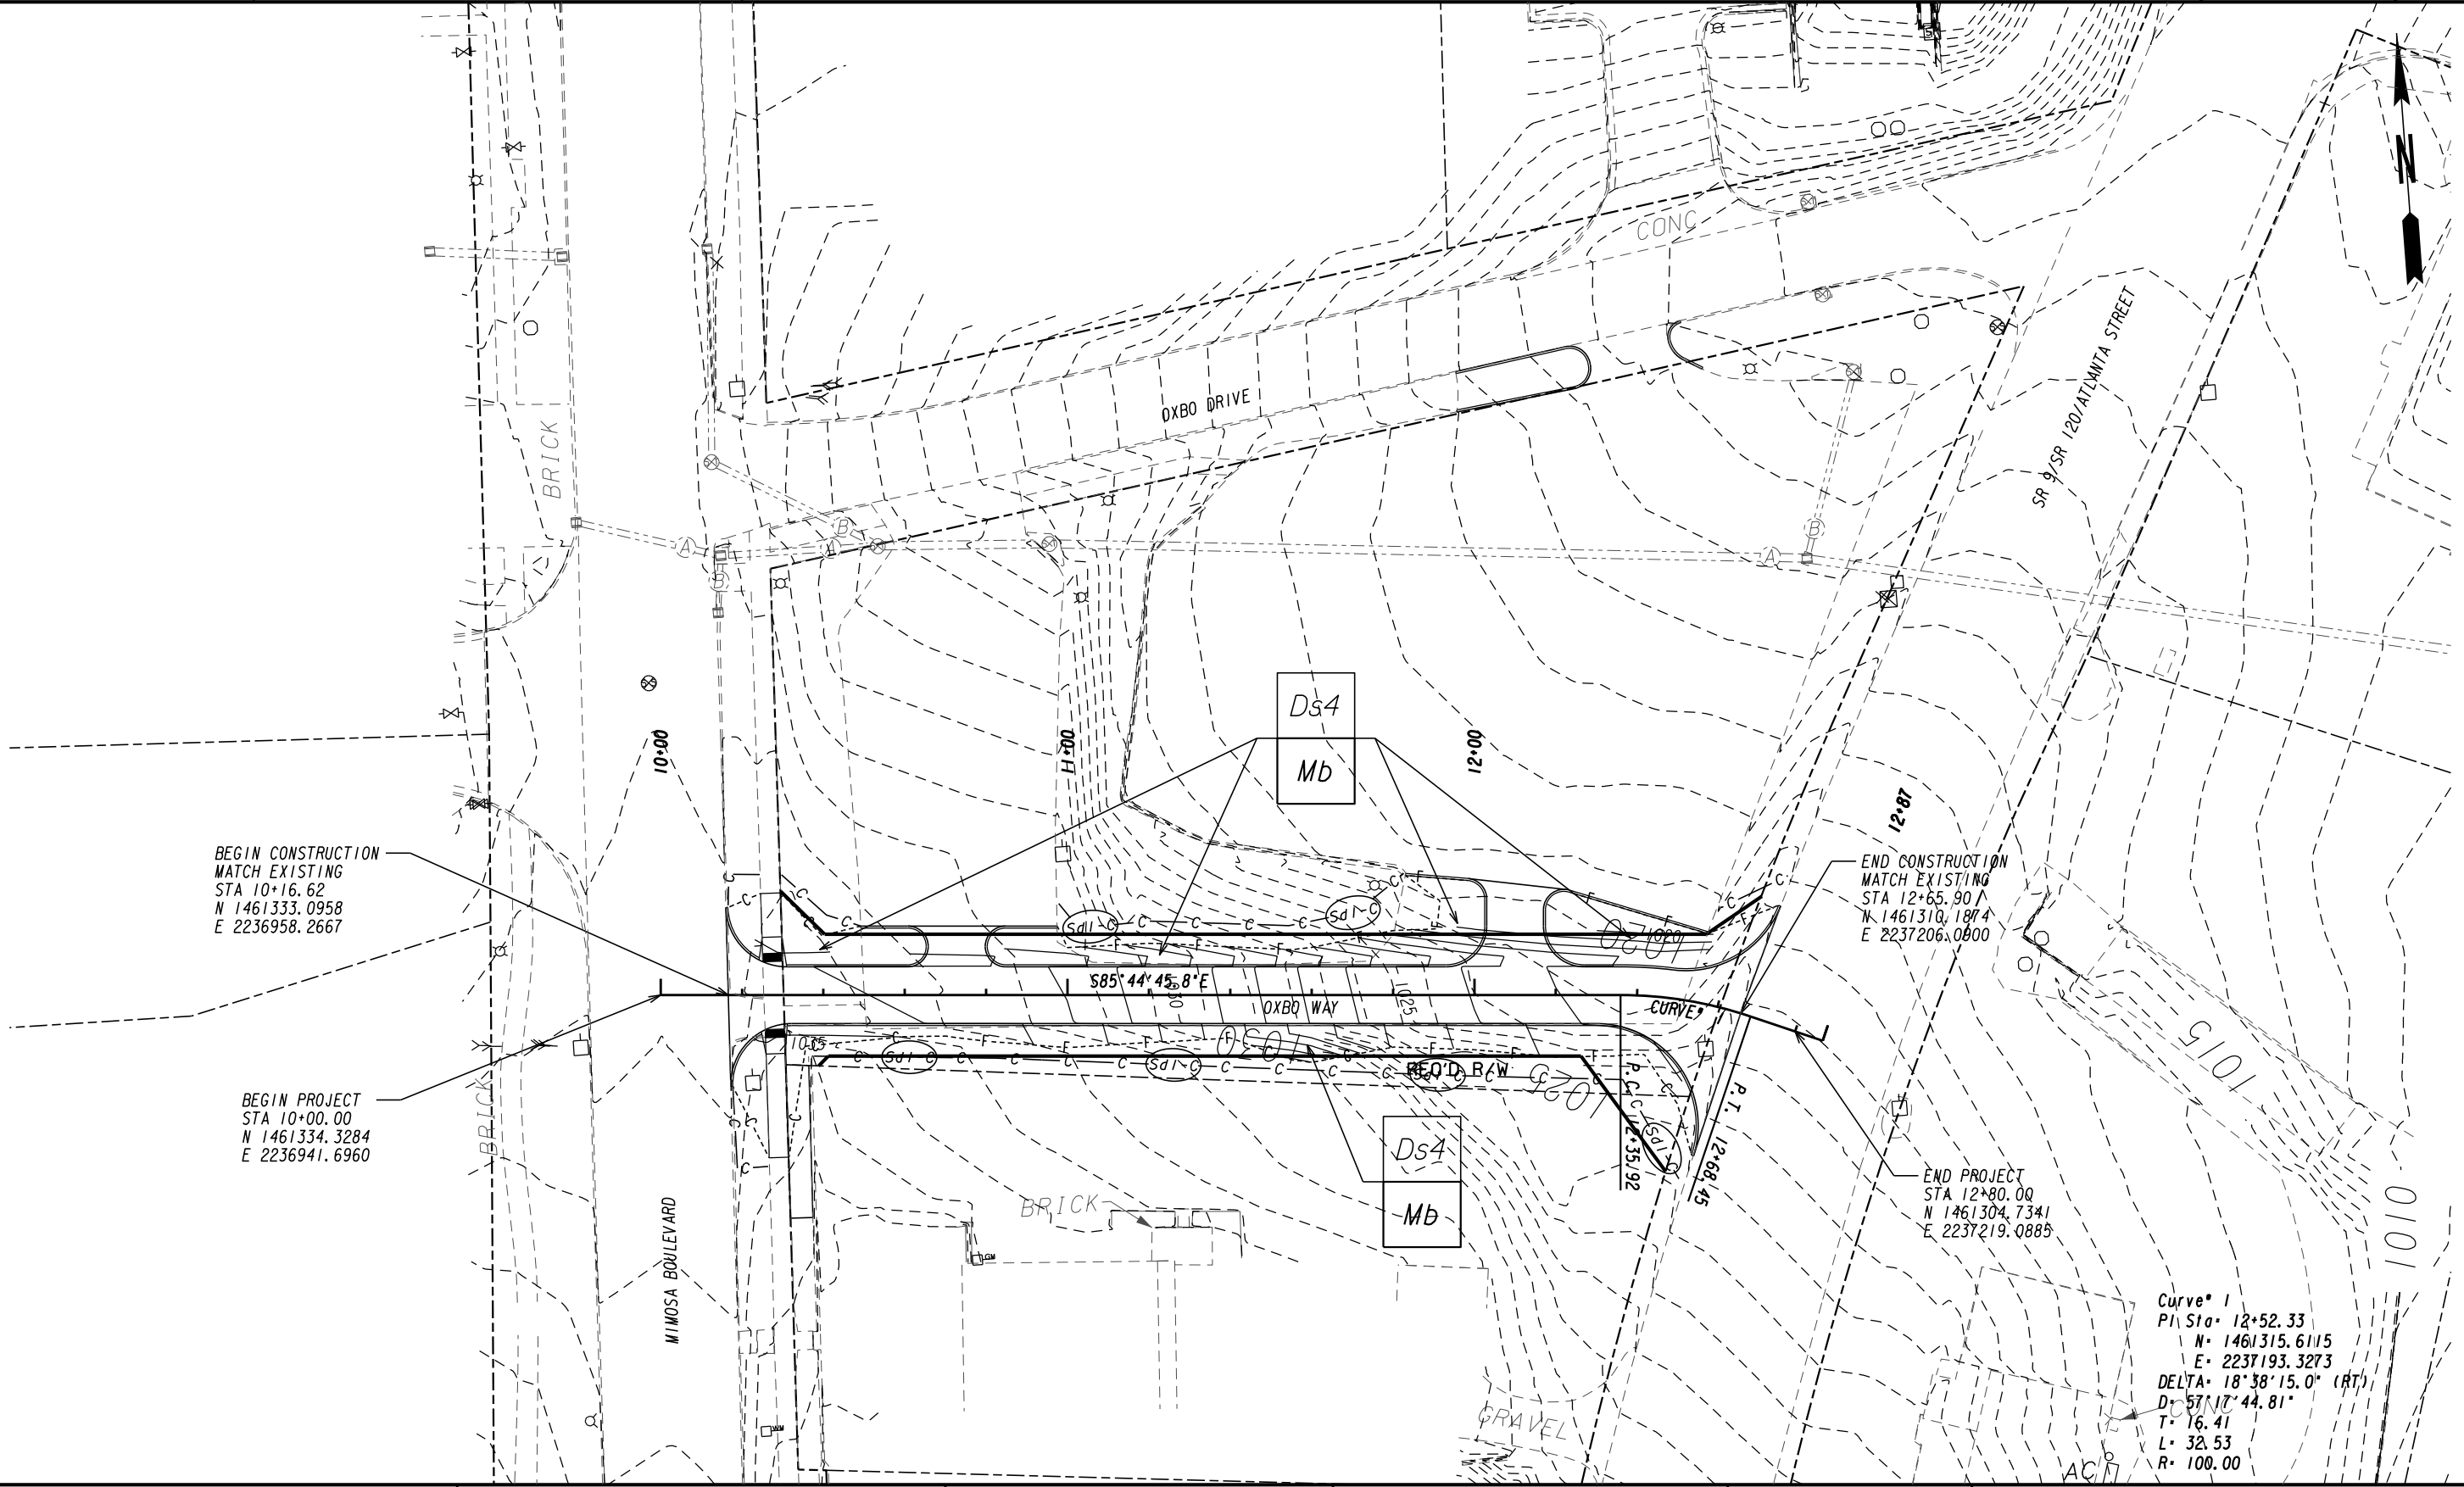


BEGIN CONSTRUCTION
MATCH EXISTING
STA 10+16.62
N 1461333.0958
E 2236958.2667

BEGIN PROJECT
STA 10+00.00
N 1461334.3284
E 2236941.6960

END CONSTRUCTION
MATCH EXISTING
STA 12+65.90
N 1461310.1874
E 2237206.0800




END PROJECT
STA 12+80.00
N 1461304.7341
E 2237219.0885

Curve 1
PI Sta: 12+52.33
N: 1461315.6115
E: 2237193.3273
DELTA: 18°38'15.0" (RT)
D: 571.7' 44.81"
T: 16.41
L: 32.53
R: 100.00



REVISION DATES	

BMP LOCATION DETAILS		
CHECKED:	DATE:	DRAWING No.
BACKCHECKED:	DATE:	54-001
CORRECTED:	DATE:	
VERIFIED:	DATE:	

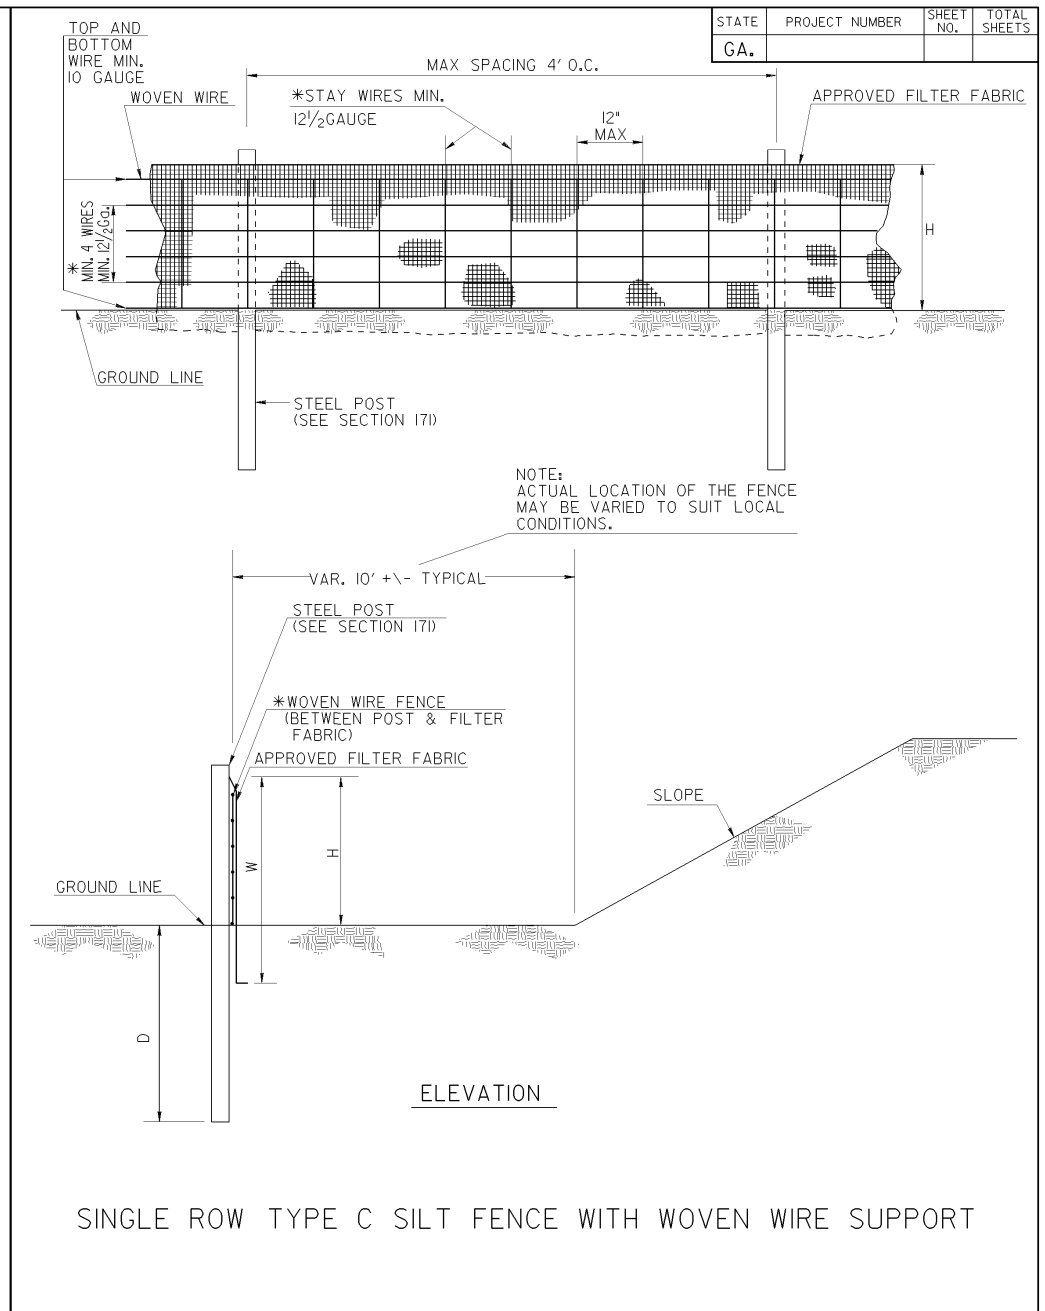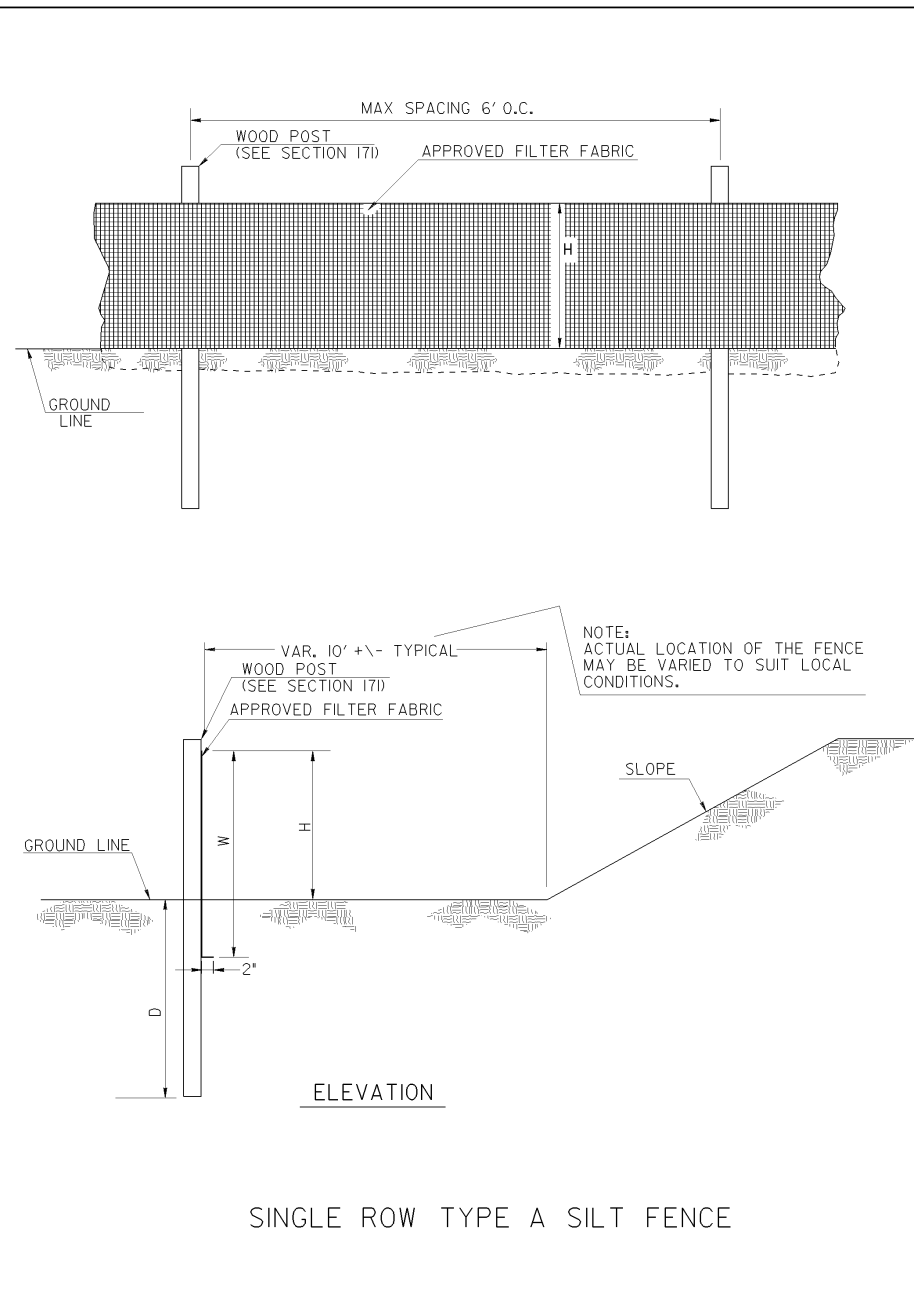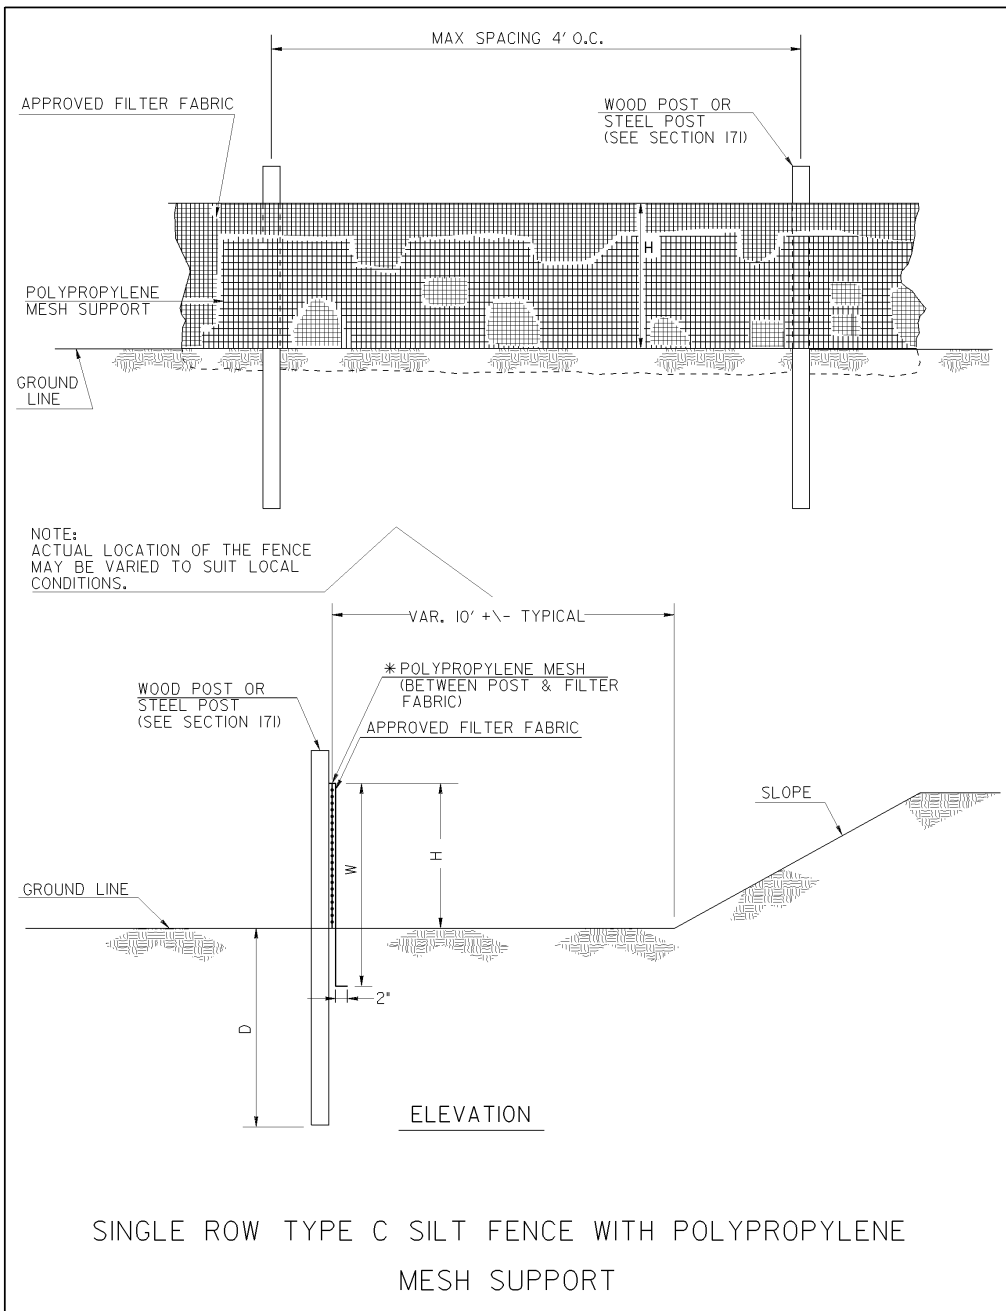

FENCE TYPE	POST LENGTH	H	D	W	TYPICAL USES
TYPE "A"	4 FT.	2'-4"	1'-6"	3'-0"	
TYPE "C"	4 FT.	2'-4"	1'-6"	3'-0"	AT BRIDGE END ROLLS, DOUBLE ROW ALONG STREAMS, WETLANDS AND ENVIRONMENTALLY SENSITIVE AREAS FOR USE OF THIS MATERIAL IN FABRIC CHECKDAMS SEE D-24D.

NOTES:

1. WIRE STAPLES SHALL BE AT LEAST 17 GAUGE, WITH LEGS AT LEAST 1/2 INCHES LONG AND A CROWN AT LEAST 3/4 INCHES WIDE. NAILS SHALL BE AT LEAST 14 GAUGE, 1 INCH LONG, WITH BUTTON HEADS AT LEAST 3/4 INCHES WIDE.
2. NAILS OR STAPLES SHALL BE EVENLY PLACED WITH AT LEAST 5 PER POST FOR TYPE A FENCE AND 4 PER POST FOR TYPE C FENCE.
3. THE VERTICAL WIRES FOR THE WOVEN WIRE SUPPORT FENCE SHALL HAVE A MAXIMUM SPACING OF 12 INCHES. THE TOP AND BOTTOM WIRES SHALL BE AT LEAST 10 GAUGE AND ALL OTHER WIRES SHALL BE AT LEAST 12 1/2 GAUGE.
4. TEMPORARY SILT FENCE INSTALLATION IS DIFFERENT THAN THE SILT RETENTION BARRIER INSTALLATION.
5. SEE SECTION 171 FOR SILT FENCE SPECIFICATIONS.
6. SEE SECTION 894 FOR FENCING SPECIFICATIONS.
7. SEE QPL-36 FOR A LIST APPROVED SILT FENCE FABRIC.
8. TEMPORARY SILT FENCE SHALL NOT BE PLACED WITHIN STATE WATERS UNLESS PERMITTED.

DATE	DEPARTMENT OF TRANSPORTATION STATE OF GEORGIA		
REVISION	CONSTRUCTION DETAILS TEMPORARY SILT FENCE		
BY	NO SCALE	REV. AND REDRAWN JAN. 2011	NUMBER D-24A (SHEET 1 OF 4)